

REFRIGERANT R32
INVERTER

AIR CONDITIONER

Ceiling type

DESIGN & TECHNICAL MANUAL

INDOOR



ABYG18KRTA
ABYG22KRTA

ABYG24KRTA
ABYG30KRTA

ABYG36KRTA
ABYG45KRTA

OUTDOOR



AOYG18KBTB
AOYG22KBTB



AOYG24KBTB



AOYG30KBTB
AOYG36KBTB



AOYG45KBTB

FUJITSU GENERAL LIMITED

DR_AB010EF_03
2020.11.18

Notices:

- Product specifications and design are subject to change without notice for future improvement.
- For further details, please check with our authorized dealer.

Trademarks

FGLair™ is trademark of Fujitsu General Limited in the United States, other countries or both.

Google Play™ is trademark of Google Inc.

App Store® is a service mark of Apple Inc., registered in the U.S. and other countries.

CONTENTS

Part 1. INDOOR UNIT	1
1. Specifications	2
2. Dimensions	8
2-1. Models: ABYG18KRTA and ABYG22KRTA	8
2-2. Models: ABYG24KRTA and ABYG30KRTA	9
2-3. Models: ABYG36KRTA and ABYG45KRTA	10
2-4. Installation space requirement	11
3. Wiring diagrams	12
3-1. Models: ABYG18KRTA, ABYG22KRTA, ABYG24KRTA, and ABYG30KRTA	12
3-2. Models: ABYG36KRTA and ABYG45KRTA	13
4. Capacity table	14
4-1. Cooling capacity	14
4-2. Heating capacity	16
5. Fan performance	18
5-1. Air velocity and temperature distributions	18
5-2. Airflow	24
5-3. Fresh air characteristics	30
6. Operation noise (sound pressure)	33
6-1. Noise level curve	33
6-2. Sound level check point	36
7. Safety devices	37
8. External input and output	38
8-1. External input	38
8-2. External output	40
8-3. Combination of external input and output	41
8-4. Details of function	43
9. Group connection	49
10. Function settings	50
10-1. Function settings by using remote controller	50
11. Accessories	55
11-1. Models: ABYG18KRTA and ABYG22KRTA	55
11-2. Models: ABYG24KRTA, ABYG30KRTA, ABYG36KRTA, and ABYG45KRTA	56
12. Optional parts	57
12-1. Controllers	57
12-2. Others	58

CONTENTS (continued)

Part 2. OUTDOOR UNIT.....	61
1. Specifications.....	62
2. Dimensions.....	65
2-1. Models: AOYG18KBTB and AOYG22KBTB	65
2-2. Model: AOYG24KBTB	66
2-3. Models: AOYG30KBTB and AOYG36KBTB	67
2-4. Model: AOYG45KBTB	68
3. Installation space	69
3-1. Models: AOYG18KBTB, AOYG22KBTB, and AOYG24KBTB	69
3-2. Models: AOYG30KBTB, AOYG36KBTB, and AOYG45KBTB	72
4. Refrigerant circuit	75
4-1. Model: AOYG18KBTB	75
4-2. Model: AOYG22KBTB	76
4-3. Models: AOYG24KBTB and AOYG30KBTB	77
4-4. Models: AOYG36KBTB and AOYG45KBTB	78
5. Wiring diagrams	79
5-1. Model: AOYG18KBTB	79
5-2. Models: AOYG22KBTB and AOYG24KBTB	79
5-3. Model: AOYG30KBTB	80
5-4. Model: AOYG36KBTB	81
5-5. Model: AOYG45KBTB	81
6. Capacity compensation rate for pipe length and height difference.....	82
6-1. Model: AOYG18KBTB	82
6-2. Model: AOYG22KBTB	83
6-3. Model: AOYG24KBTB	84
6-4. Model: AOYG30KBTB	85
6-5. Model: AOYG36KBTB	86
6-6. Model: AOYG45KBTB	87
7. Additional charge calculation	88
7-1. Model: AOYG18KBTB	88
7-2. Models: AOYG22KBTB and AOYG24KBTB	88
7-3. Models: AOYG30KBTB and AOYG36KBTB	88
7-4. Model: AOYG45KBTB	88
8. Airflow	89
8-1. Model: AOYG18KBTB	89
8-2. Model: AOYG22KBTB	89
8-3. Model: AOYG24KBTB	89
8-4. Models: AOYG30KBTB and AOYG36KBTB	90
8-5. Model: AOYG45KBTB	90
9. Operation noise (sound pressure).....	91
9-1. Noise level curve.....	91

CONTENTS (continued)

9-2. Sound level check point	94
10. Electrical characteristics	95
11. Safety devices	96
12. External input and output	98
12-1.External input	98
12-2.External output.....	100
13. Function settings	102
13-1.Control PCB and switch buttons location	102
13-2.Local setting procedure	104
14. Accessories	106
14-1.Models: AOYG18KBTB, AOYG22KBTB, and AOYG24KBTB	106
14-2.Models: AOYG30KBTB, AOYG36KBTB, and AOYG45KBTB	106
15. Optional parts	107

Part 1. INDOOR UNIT

CEILING TYPE:

ABYG18KRTA

ABYG22KRTA

ABYG24KRTA

ABYG30KRTA

ABYG36KRTA

ABYG45KRTA

1. Specifications

Type	Ceiling				
	Inverter heat pump				
Model name			ABYG18KRTA	ABYG22KRTA	
Power supply			230 V ~ 50 Hz		
Power supply intake			Outdoor unit		
Available voltage range			198—264 V		
Capacity	Cooling	Rated	kW	5.2	
			Btu/h	17,700	
		Min.—Max.	kW	0.9—5.9	
			Btu/h	3,100—20,100	
	Heating	Rated	kW	6.0	
			Btu/h	20,500	
		Min.—Max.	kW	0.9—7.5	
			Btu/h	3,100—25,600	
Input power	Cooling	Rated	kW	1.55	
			Max.	2.32	
	Heating	Rated	kW	1.62	
			Max.	2.41	
Current	Cooling	Rated	A	6.9	
	Heating			7.2	
EER	Cooling		kW/kW	3.35	
COP	Heating			3.70	
Power factor	Cooling	%	%	97.6	
	Heating			97.9	
Moisture removal	L/h (pints/h)		2.0 (3.5)		
Maximum operating current *1	Cooling	A	12.1		
	Heating		12.1		
Fan	Airflow rate	Cooling	HIGH	840	
			MED	790	
			LOW	710	
			QUIET	650	
		Heating	HIGH	840	
			MED	790	
			LOW	710	
			QUIET	650	
	Type × Q'ty		Sirocco × 2		
	Motor output		50		
Sound pressure level *2	Cooling	HIGH	dB (A)	38	
				36	
				33	
				31	
		MED		38	
				36	
				33	
				31	
	Heating	HIGH		42	
				37	
				34	
				31	
Heat exchanger type	Dimensions (H × W × D)		mm	294 × 715 × 39.9	
	Fin pitch		mm	1.30	
	Rows × Stages			3 × 14	
	Pipe type			Copper	
	Fin type			Aluminum	
	Material			Steel sheet	
Enclosure	Color			White	
				Approximate color of Munsell N9.25/	
Dimensions (H × W × D)	Net		mm	235 × 1,080 × 705	
	Gross			330 × 1,165 × 825	
Weight	Net		kg	24	
	Gross			33	
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)	
		Gas		Ø12.70 (Ø1/2)	
Drain hose	Method			Flare	
	Material			PVC	
Operation range	Tip diameter		mm	Ø25 (I.D.), Ø32 (O.D.)	
	Cooling	°C		18 to 32	
			%RH	80 or less	
	Heating	°C		16 to 30	
Remote controller (Option)			Wired remote controller, Wireless remote controller, Mobile app*3 (FGLair™)		

NOTES:

- Specifications are based on the following conditions:
 - Cooling: Indoor temperature of 27 °CDB/19 °CWB, and outdoor temperature of 35 °CDB/24 °CWB.
 - Heating: Indoor temperature of 20 °CDB/15 °CWB, and outdoor temperature of 7 °CDB/6 °CWB.
 - Pipe length: 5 m, Height difference: 0 m. (Between outdoor unit and indoor unit.)
 - Protective function might work when using it outside the operation range.
 - *1: Maximum current is maximum value when operated within the operation range.
 - *2: Sound pressure level:
 - Measured values in manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
 - *3: Available on Google Play™ store or on App Store®. Optional WLAN adapter is also required. For details, refer to the setting manual.
 - This data is based on EN 14511 standard.

Specifications for ErP Lot10					
Model name		ABYG18KRTA		ABYG22KRTA	
Energy efficiency class		A++		A++	
Heating (Average)		A+		A+	
Pdesign	Cooling	kW	5.2 (35°C)	6.0 (35°C)	
	Heating (Average)		4.4 (-10°C)	4.8 (-10°C)	
SEER	Cooling	kWh/kWh	6.2	6.1	
	Heating (Average)		4.1	4.0	
Annual energy consumption	QCE	kWh/a	293	344	
	QHE (Average)		1,501	1,677	
Sound power level	Cooling	dB (A)	53	57	
	Heating		53	57	
HIGH					

Type	Ceiling					
Model name	Inverter heat pump					
Power supply	230 V ~ 50 Hz					
Power supply intake	Outdoor unit					
Available voltage range	198—264 V					
Capacity	Cooling	Rated	kW	6.8		
			Btu/h	23,200		
		Min.—Max.	kW	0.9—8.0		
			Btu/h	3,100—27,300		
	Heating	Rated	kW	7.5		
			Btu/h	25,600		
		Min.—Max.	kW	0.9—9.1		
			Btu/h	3,100—31,000		
Input power	Cooling	Rated	kW	2.14		
		Max.		2.92		
	Heating	Rated		1.97		
		Max.		2.59		
Current	Cooling	Rated	A	9.5		
	Heating			8.7		
EER	Cooling		kW/kW	3.18		
COP	Heating			3.81		
Power factor	Cooling		%	98.3		
	Heating			98.4		
Moisture removal		L/h (pints/h)		2.2 (3.9)		
Maximum operating current *1	Cooling		A	13.6		
	Heating			13.6		
Fan	Airflow rate	HIGH	m³/h	1,230		
		MED		990		
		LOW		860		
		QUIET		700		
	Heating	HIGH		1,230		
		MED		990		
		LOW		860		
		QUIET		700		
	Type × Q'ty		Sirocco × 3			
Motor output		W	80			
Sound pressure level *2	Cooling	HIGH	dB (A)	41		
		MED		36		
		LOW		32		
		QUIET		29		
	Heating	HIGH		41		
		MED		36		
		LOW		32		
		QUIET		29		
	Dimensions (H × W × D)		mm			
Heat exchanger type	Fin pitch		mm			
	Rows × Stages		3 × 14			
	Pipe type		Copper			
	Fin type		Aluminum			
	Material					
Enclosure	Color					
	White Approximate color of Munsell N9.25/					
Dimensions (H × W × D)	Net		mm	235 × 1,390 × 705		
	Gross			330 × 1,475 × 825		
Weight	Net		kg	31		
	Gross			41		
Connection pipe	Size	Liquid	mm (in)	Ø6.35 (Ø1/4)		
		Gas		Ø12.70 (Ø1/2)		
Drain hose	Method		Flare			
	Material		PVC			
Operation range	Tip diameter		mm	Ø25 (I.D.), Ø32 (O.D.)		
	Cooling			18 to 32		
	Heating		%RH	80 or less		
			°C	16 to 30		
Remote controller (Option)			Wired remote controller, Wireless remote controller, Mobile app*3 (FGLair™)			

NOTES:

- Specifications are based on the following conditions:
 - Cooling: Indoor temperature of 27 °CDB/19 °CWB, and outdoor temperature of 35 °CDB/24 °CWB.
 - Heating: Indoor temperature of 20 °CDB/15 °CWB, and outdoor temperature of 7 °CDB/6 °CWB.
 - Pipe length: 5 m, Height difference: 0 m. (Between outdoor unit and indoor unit.)
- Protective function might work when using it outside the operation range.
- *1: Maximum current is maximum value when operated within the operation range.
- *2: Sound pressure level:
 - Measured values in manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *3: Available on Google Play™ store or on App Store®. Optional WLAN adapter is also required. For details, refer to the setting manual.
- This data is based on EN 14511 standard.

Specifications for ErP Lot10					
Model name		ABYG24KRTA		ABYG30KRTA	
Energy efficiency class		A++		A++	
Heating (Average)		A+		A+	
Pdesign	Cooling	kW	6.8 (35°C)	8.5 (35°C)	
	Heating (Average)		6.0 (-10°C)	8.0 (-10°C)	
SEER	Cooling	kWh/kWh	6.2	6.1	
SCOP	Heating (Average)		4.1	4.0	
Annual energy consumption	QCE	kWh/a	384	486	
	QHE (Average)		2,042	2,796	
Sound power level	Cooling	dB (A)	56	60	
	Heating		56	60	
HIGH					

Type			Ceiling		
Model name			Inverter heat pump		
Power supply			230 V ~ 50 Hz		
Power supply intake			Outdoor unit		
Available voltage range			198–264 V		
Capacity	Cooling	Rated	kW	9.5	
			Btu/h	32,400	
		Min.—Max.	kW	2.8–11.2	
			Btu/h	9,600–38,200	
				13,600–46,000	
	Heating	Rated	kW	10.8	
			Btu/h	36,900	
		Min.—Max.	kW	2.7–12.7	
			Btu/h	9,200–43,300	
				14,300–55,300	
Input power	Cooling	Rated	kW	2.96	
		Max.		4.52	
	Heating	Rated		2.88	
		Max.		4.31	
Current	Cooling	Rated	A	13.1	
	Heating			12.7	
EER	Cooling		kW/kW	3.21	
COP	Heating			3.75	
Power factor	Cooling		%	98.9	
	Heating			98.8	
Moisture removal		L/h (pints/h)		2.6 (4.6)	
Maximum operating current *1	Cooling		A	22.6	
	Heating			22.6	
Fan	Airflow rate	HIGH	m³/h	1,850	
		MED		1,470	
		LOW		1,300	
		QUIET		1,050	
	Heating	HIGH		1,800	
		MED		1,470	
		LOW		1,300	
		QUIET		1,050	
	Type × Q'ty		Sirocco × 4		
Motor output		W	110		
Sound pressure level *2	Cooling	HIGH	dB (A)	44	
		MED		40	
		LOW		37	
		QUIET		32	
	Heating	HIGH		44	
		MED		40	
		LOW		37	
		QUIET		32	
	Dimensions (H × W × D)		294 × 1,335 × 39.9		
Heat exchanger type		mm			
Fin pitch		mm	1.30		
Rows × Stages			3 × 14		
Pipe type			Copper		
Fin type			Aluminum		
Enclosure	Material			Steel sheet	
	Color			White Approximate color of Munsell N9.25/	
Dimensions (H × W × D)	Net		mm	235 × 1,700 × 705	
	Gross			330 × 1,785 × 825	
Weight	Net		kg	38	
	Gross			48	
Connection pipe	Size	Liquid	mm (in)	Ø9.52 (Ø3/8)	
		Gas		Ø15.88 (Ø5/8)	
Method			Flare		
Drain hose		Material	PVC		
Tip diameter		mm	Ø25 (I.D.), Ø32 (O.D.)		
Operation range	Cooling	°C	18 to 32		
		%RH	80 or less		
	Heating	°C	16 to 30		
Remote controller (Option)			Wired remote controller, Wireless remote controller, Mobile app*3 (FGLair™)		

NOTES:


- Specifications are based on the following conditions:
 - Cooling: Indoor temperature of 27 °CDB/19 °CWB, and outdoor temperature of 35 °CDB/24 °CWB.
 - Heating: Indoor temperature of 20 °CDB/15 °CWB, and outdoor temperature of 7 °CDB/6 °CWB.
 - Pipe length: 5 m, Height difference: 0 m. (Between outdoor unit and indoor unit.)
- Protective function might work when using it outside the operation range.
- *1: Maximum current is maximum value when operated within the operation range.
- *2: Sound pressure level:
 - Measured values in manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- *3: Available on Google Play™ store or on App Store®. Optional WLAN adapter is also required. For details, refer to the setting manual.
- This data is based on EN 14511 standard.

Specifications for ErP Lot10			
Model name		ABYG36KRTA	
Energy efficiency class	Cooling		A++
	Heating (Average)		A+
Pdesign	Cooling	kW	9.5 (35°C)
	Heating (Average)		8.7 (-10°C)
SEER	Cooling	kWh/kWh	6.37
SCOP	Heating (Average)		4.21
Annual energy consump-	QCE	kWh/a	524
tion	QHE (Average)		2,904
Sound power level	Cooling	dB (A)	59
	Heating		59

2. Dimensions


2-1. Models: ABYG18KRTA and ABYG22KRTA

Unit: mm

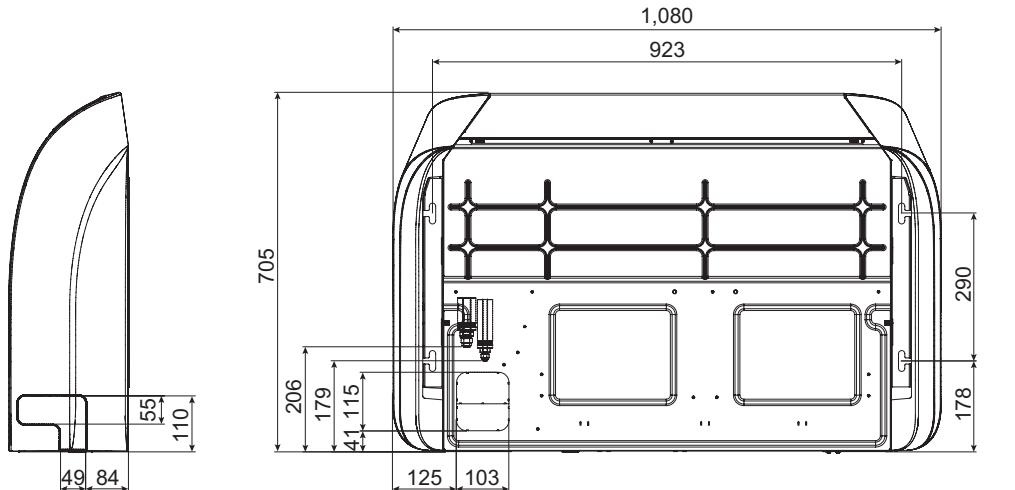


Side view

Top view


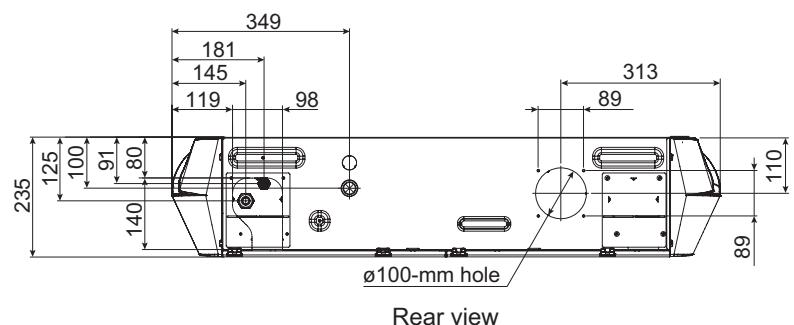


Rear view

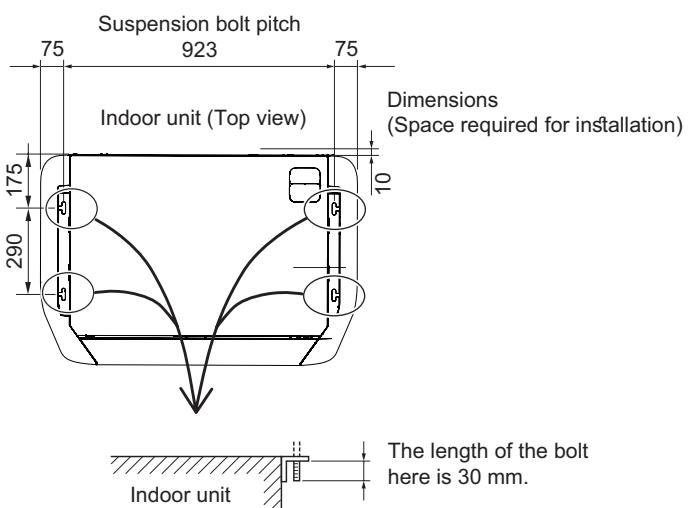


2-2. Models: ABYG24KRTA and ABYG30KRTA

Unit: mm

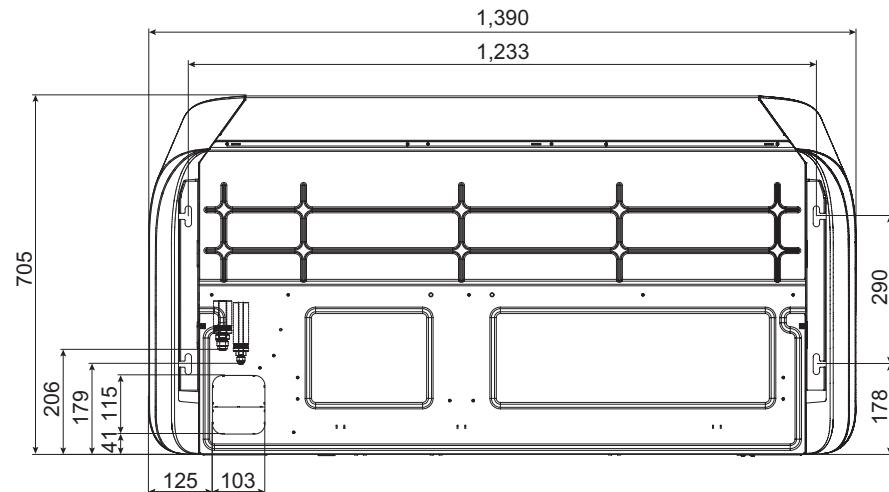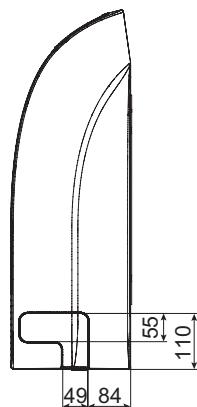


Side view

Top view


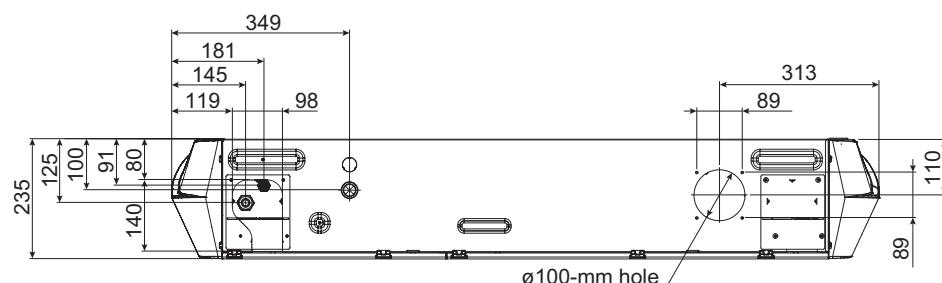


Rear view

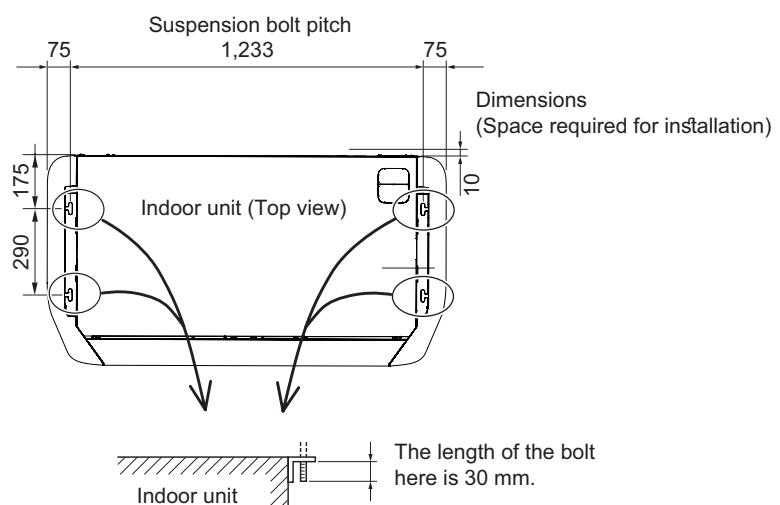


2-3. Models: ABYG36KRTA and ABYG45KRTA

Unit: mm

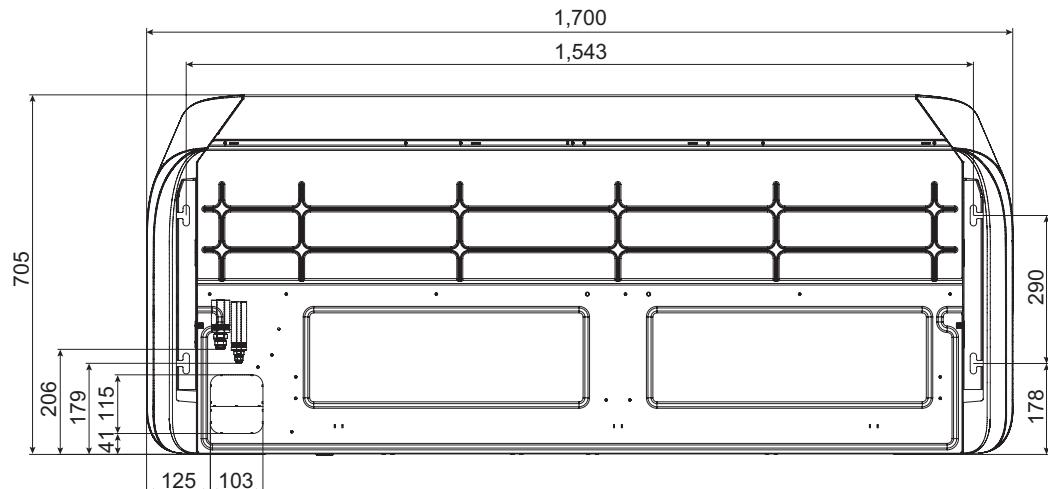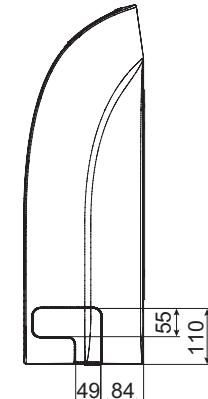


Side view

Top view

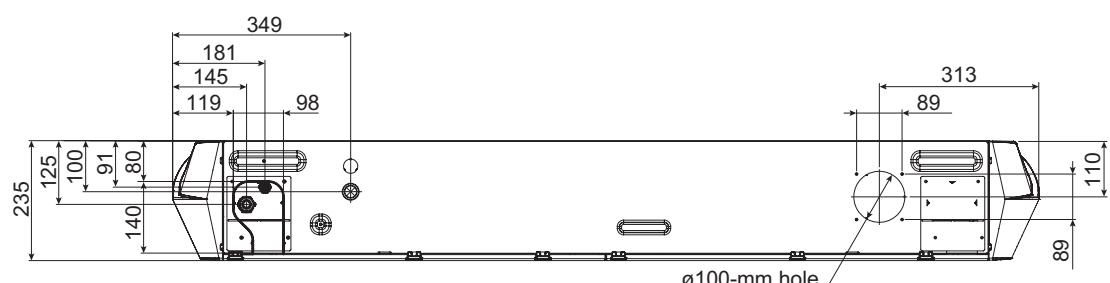


Rear view

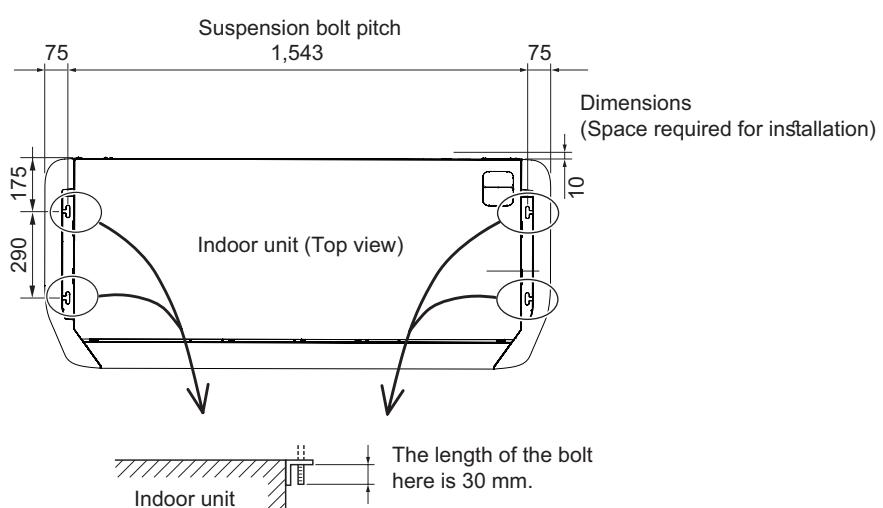

2-4. Installation space requirement

Unit: mm

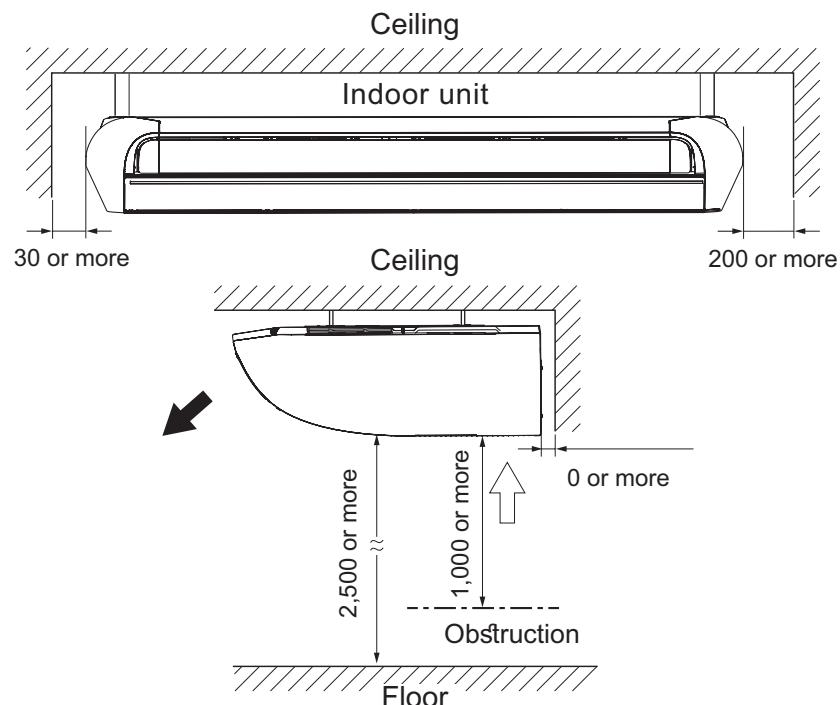


Required ceiling height varies according to the ceiling mode setting of function setting No. 20.


Ceiling height (m)		
Ceiling mode	Standard	High ceiling
18, 22, 24, and 30 models	2.7	3.5
36 and 45 models	3.5	4.3

3. Wiring diagrams

3-1. Models: ABYG18KRTA, ABYG22KRTA, ABYG24KRTA, and ABYG30KRTA

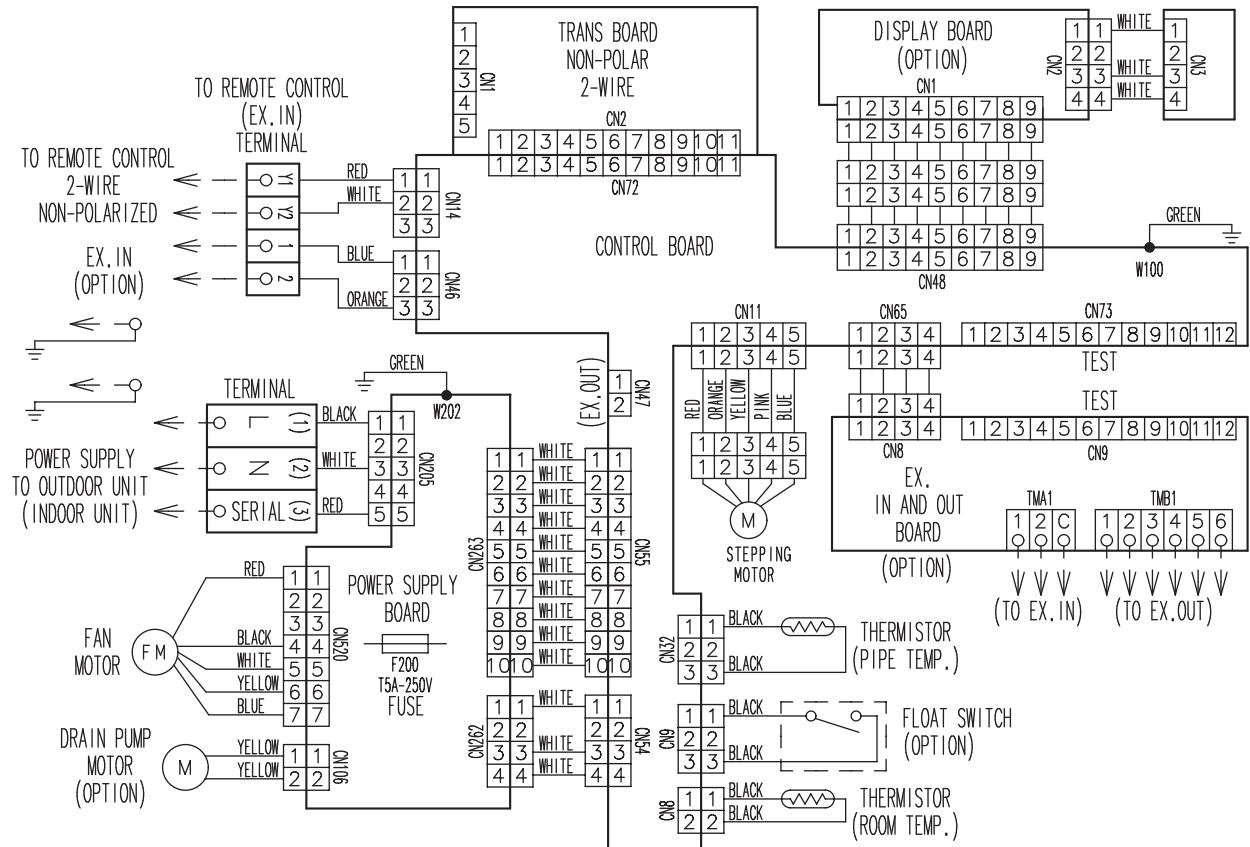

3-2. Models: ABYG36KRTA and ABYG45KRTA

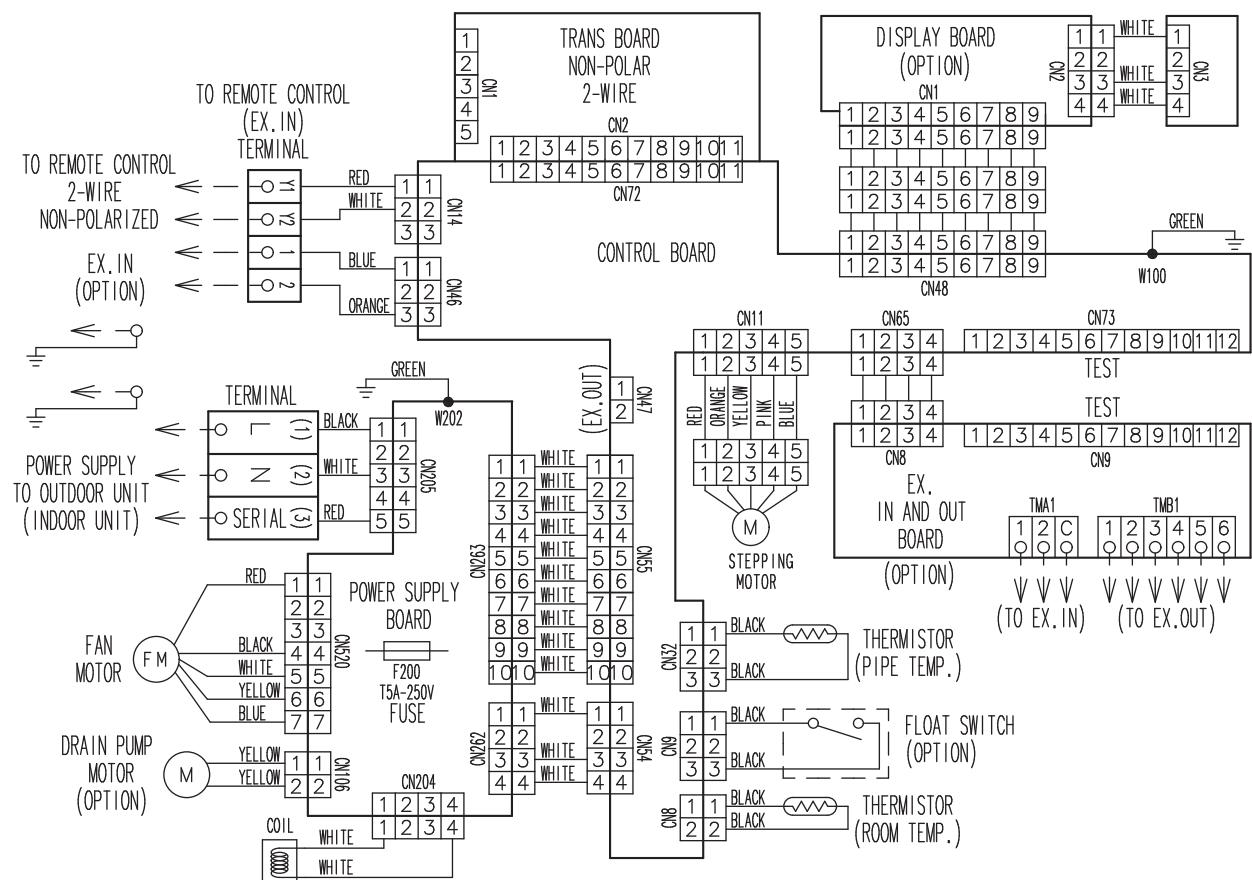

4-2. Heating capacity

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

■ Model: ABYG18KRTA

AFR		m³/h		Indoor temperature							
Outdoor temperature	°CDB			16		18		20		22	
		°CWB	TC	IP	kW	TC	IP	kW	TC	IP	kW
-15	-16	5.05	1.77	4.93	1.81	4.81	1.85	4.69	1.88	4.57	1.92
-10	-11	5.69	1.89	5.56	1.93	5.42	1.96	5.28	2.00	5.15	2.04
-5	-7	6.33	2.00	6.18	2.04	6.03	2.08	5.88	2.12	5.73	2.17
0	-2	6.97	2.12	6.81	2.17	6.64	2.21	6.47	2.25	6.31	2.30
5	3	7.61	2.22	7.43	2.27	7.25	2.32	7.07	2.36	6.89	2.41
7	6	7.88	2.27	7.69	2.31	7.50	2.36	7.31	2.41	7.13	2.45
10	8	8.51	2.36	8.30	2.41	8.10	2.46	7.90	2.51	7.70	2.55
15	10	8.46	2.08	8.26	2.12	8.06	2.17	7.86	2.21	7.66	2.24
20	15	7.96	1.64	7.77	1.67	7.58	1.71	7.39	1.74	7.20	1.77
24	17	8.40	1.63	8.20	1.66	8.00	1.70	7.80	1.73	7.60	1.76

■ Model: ABYG22KRTA

AFR		m³/h		Indoor temperature							
Outdoor temperature	°CDB			16		18		20		22	
		°CWB	TC	IP	kW	TC	IP	kW	TC	IP	kW
-15	-16	5.60	2.13	5.46	2.17	5.33	2.22	5.20	2.26	5.06	2.30
-10	-11	6.14	2.21	6.00	2.26	5.85	2.31	5.70	2.35	5.56	2.40
-5	-7	6.70	2.29	6.54	2.34	6.38	2.39	6.22	2.44	6.06	2.48
0	-2	7.26	2.36	7.08	2.41	6.91	2.46	6.74	2.51	6.56	2.56
5	3	7.81	2.44	7.63	2.49	7.44	2.54	7.25	2.59	7.07	2.64
7	6	8.40	2.44	8.20	2.49	8.00	2.54	7.80	2.59	7.60	2.64
10	8	8.05	2.30	7.86	2.35	7.67	2.40	7.48	2.45	7.29	2.49
15	10	7.49	2.08	7.31	2.12	7.13	2.17	6.95	2.21	6.77	2.24
20	15	7.04	1.77	6.87	1.80	6.70	1.84	6.53	1.88	6.37	1.91
24	17	7.32	1.75	7.14	1.79	6.97	1.82	6.80	1.86	6.62	1.89

■ Model: ABYG24KRTA

AFR		m³/h		Indoor temperature							
Outdoor temperature	°CDB			16		18		20		22	
		°CWB	TC	IP	kW	TC	IP	kW	TC	IP	kW
-15	-16	6.37	2.12	6.21	2.16	6.06	2.21	5.91	2.25	5.76	2.30
-10	-11	6.99	2.21	6.82	2.25	6.65	2.30	6.49	2.34	6.32	2.39
-5	-7	7.62	2.28	7.44	2.33	7.26	2.38	7.08	2.43	6.89	2.47
0	-2	8.25	2.35	8.06	2.40	7.86	2.45	7.66	2.50	7.47	2.55
5	3	8.89	2.43	8.67	2.48	8.46	2.53	8.25	2.58	8.04	2.63
7	6	9.56	2.43	9.33	2.48	9.10	2.53	8.87	2.58	8.65	2.63
10	8	9.16	2.29	8.94	2.34	8.72	2.39	8.51	2.44	8.29	2.48
15	10	8.52	2.07	8.31	2.11	8.11	2.16	7.91	2.20	7.70	2.23
20	15	8.00	1.76	7.81	1.80	7.62	1.83	7.43	1.87	7.24	1.90
24	17	8.32	1.74	8.13	1.78	7.93	1.81	7.73	1.85	7.53	1.88

■ Model: ABYG30KRTA

AFR	m ³ /h	1,400									
		Indoor temperature									
°CDB		16		18		20		22			
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		
-15	-16	7.10	2.80	7.07	2.81	7.04	2.81	6.86	2.81	6.40	2.82
-10	-11	8.12	3.03	8.09	3.03	8.05	3.04	7.84	3.04	7.33	3.05
-5	-7	9.14	3.26	9.10	3.26	9.07	3.26	8.83	3.27	8.25	3.28
0	-2	9.71	3.50	9.67	3.51	9.63	3.51	9.38	3.52	8.76	3.54
5	3	10.84	3.56	10.80	3.57	10.75	3.57	10.47	3.57	9.78	3.59
7	6	11.30	3.58	11.25	3.59	11.20	3.59	10.91	3.59	10.19	3.61
10	8	11.64	3.58	11.59	3.59	11.54	3.59	11.25	3.59	10.50	3.61
15	10	12.11	3.58	12.06	3.59	12.01	3.59	11.70	3.59	10.93	3.61
20	15	12.90	3.59	12.84	3.59	12.79	3.60	12.46	3.60	11.64	3.61
24	17	13.53	3.60	13.47	3.60	13.41	3.61	13.07	3.61	12.20	3.62

■ Model: ABYG36KRTA

AFR	m ³ /h	1,800									
		Indoor temperature									
°CDB		16		18		20		22			
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		
-15	-16	8.05	2.95	8.01	2.96	7.98	2.96	7.77	2.96	7.26	2.97
-10	-11	9.21	3.19	9.17	3.20	9.13	3.20	8.89	3.20	8.31	3.22
-5	-7	10.37	3.43	10.32	3.44	10.28	3.44	10.02	3.45	9.35	3.46
0	-2	11.01	3.71	10.97	3.72	10.92	3.72	10.64	3.73	9.94	3.74
5	3	12.30	3.77	12.24	3.77	12.19	3.78	11.88	3.78	11.09	3.79
7	6	12.81	3.79	12.75	3.80	12.70	3.80	12.37	3.80	11.56	3.82
10	8	13.20	3.79	13.15	3.80	13.09	3.80	12.75	3.80	11.91	3.82
15	10	13.73	3.79	13.68	3.80	13.62	3.80	13.27	3.80	12.39	3.82
20	15	14.63	3.80	14.56	3.81	14.50	3.81	14.13	3.81	13.19	3.83
24	17	15.34	3.81	15.27	3.81	15.21	3.82	14.82	3.82	13.84	3.83

■ Model: ABYG45KRTA

AFR	m ³ /h	1,850									
		Indoor temperature									
°CDB		16		18		20		22			
Outdoor temperature	°CDB	°CWB	TC	IP	TC	IP	TC	IP	TC	IP	
			kW		kW		kW		kW		
-15	-16	12.04	4.74	11.75	4.76	11.46	4.78	11.19	4.78	10.53	4.78
-10	-11	13.37	4.93	13.05	4.97	12.73	4.99	12.43	4.99	11.69	4.99
-5	-7	14.70	5.14	14.35	5.16	14.00	5.19	13.67	5.19	12.86	5.19
0	-2	15.48	5.34	15.11	5.36	14.74	5.39	14.40	5.39	13.54	5.39
5	3	16.57	4.67	16.18	4.69	15.78	4.72	15.42	4.72	14.50	4.72
7	6	17.01	4.67	16.61	4.69	16.20	4.71	15.82	4.71	14.88	4.71
10	8	17.72	4.66	17.29	4.68	16.87	4.70	16.48	4.70	15.50	4.70
15	10	18.89	4.64	18.44	4.66	17.99	4.69	17.57	4.69	16.53	4.69
20	15	20.07	4.63	19.59	4.65	19.11	4.67	18.66	4.67	17.55	4.67
24	17	21.01	4.60	20.50	4.64	20.00	4.66	19.54	4.66	18.38	4.66


5. Fan performance

5-1. Air velocity and temperature distributions


■ Model: ABYG18KRTA

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view
Vertical airflow direction louver: Up
Horizontal airflow direction louver: Center

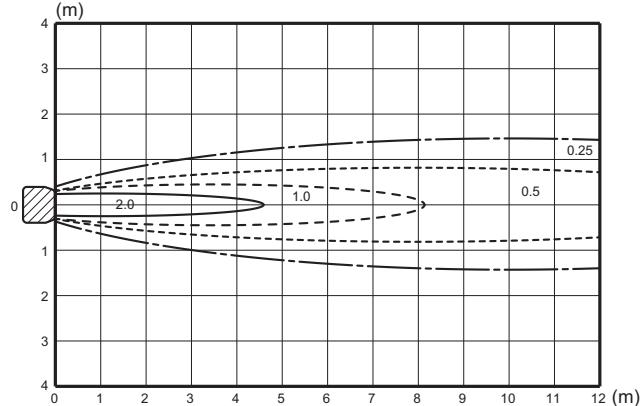


Top view
Vertical airflow direction louver: Up
Horizontal airflow direction louver: Left & Right

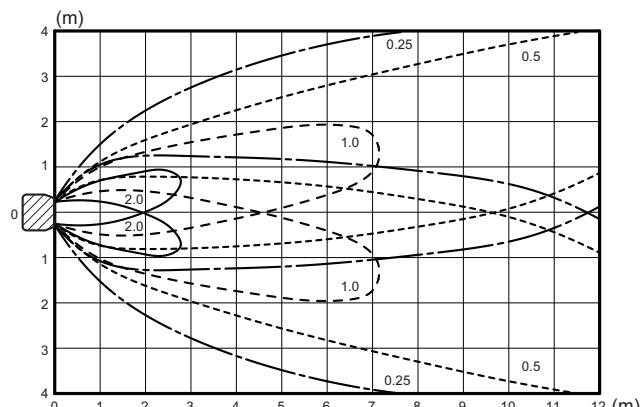

Side view
Vertical airflow direction louver: Up
Horizontal airflow direction louver: Center

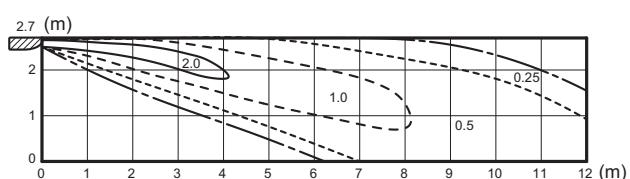


Side view
Vertical airflow direction louver: Down
Horizontal airflow direction louver: Center

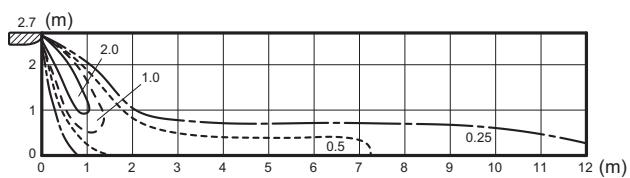


■ Model: ABYG22KRTA


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

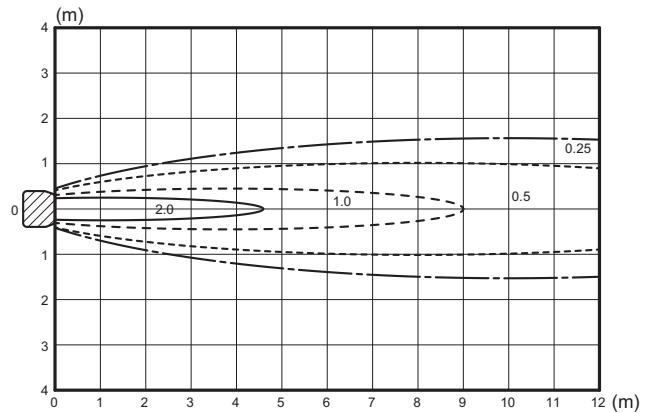


Top view
Vertical airflow direction louver: Up
Horizontal airflow direction louver: Center

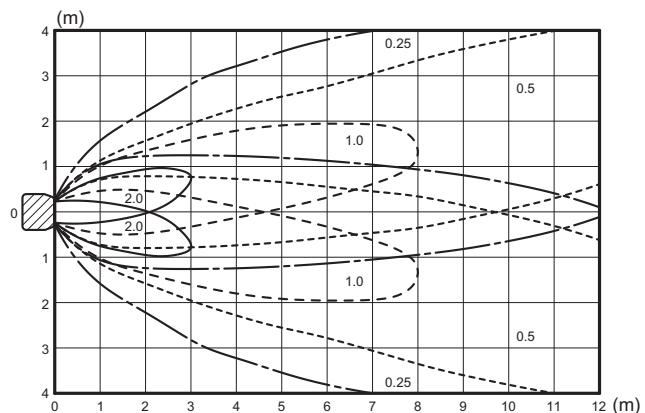

Top view
Vertical airflow direction louver: Up
Horizontal airflow direction louver: Left & Right

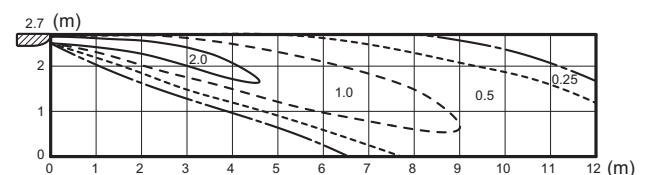





Side view
Vertical airflow direction louver: Up
Horizontal airflow direction louver: Center

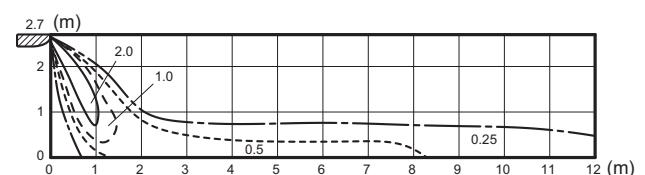

Side view
Vertical airflow direction louver: Down
Horizontal airflow direction louver: Center





■ Model: ABYG24KRTA

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

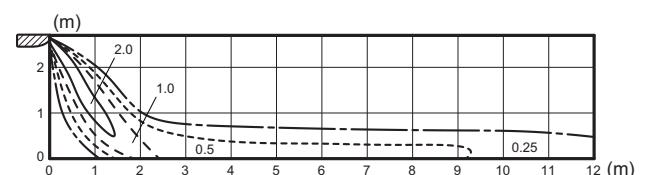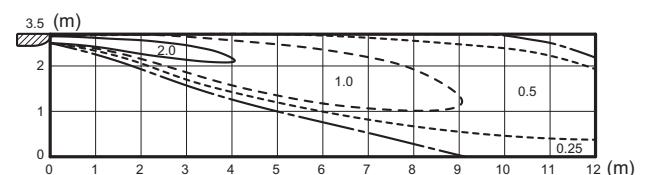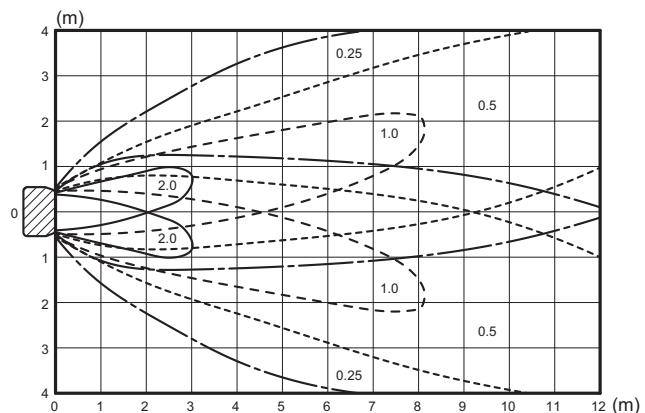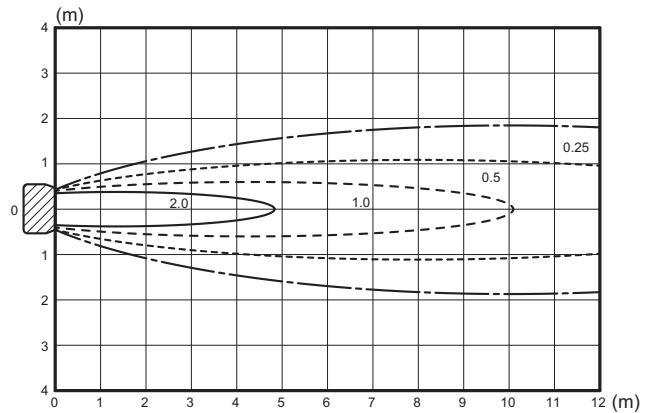

■ Model: ABYG30KRTA


Measuring conditions	Fan speed	Operation mode
	HIGH	FAN

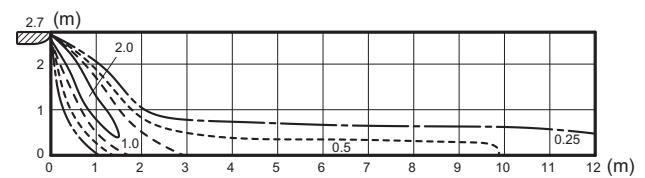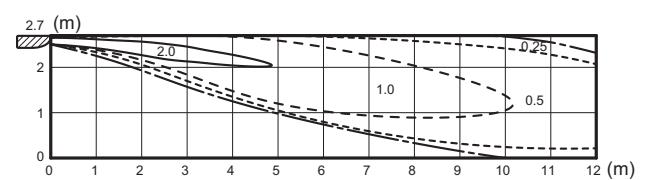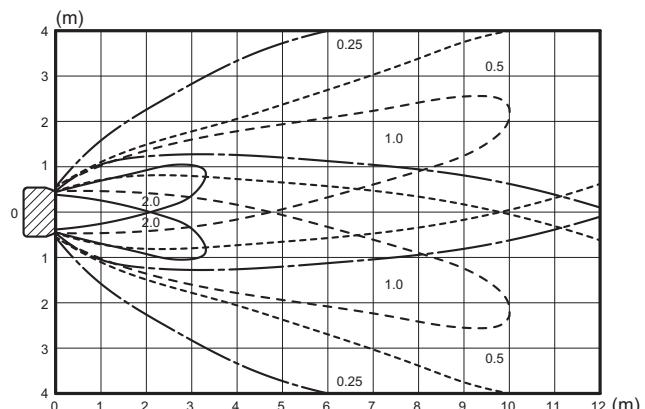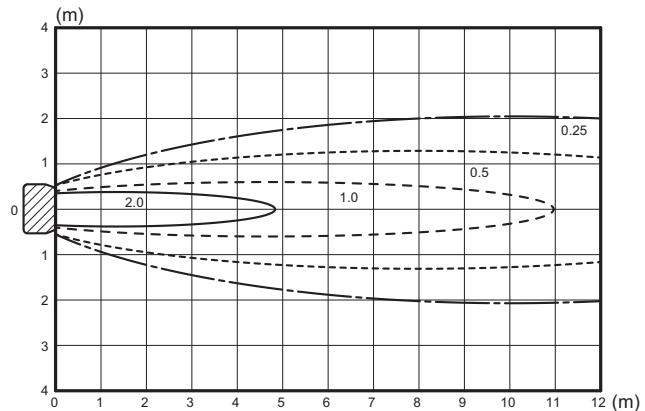


■ Model: ABYG36KRTA

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view
 Vertical airflow direction louver: Up
 Horizontal airflow direction louver: Center

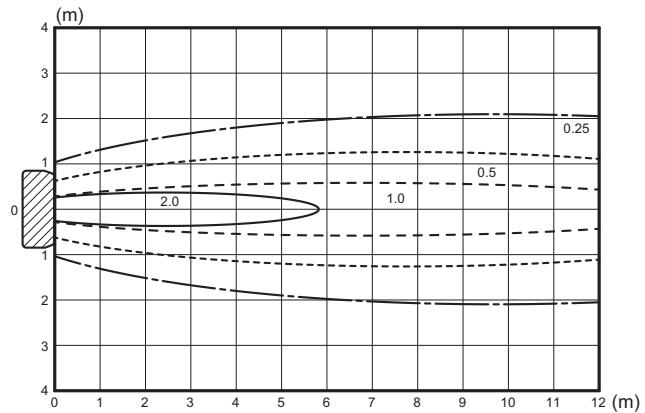


Top view
 Vertical airflow direction louver: Up
 Horizontal airflow direction louver: Left & Right

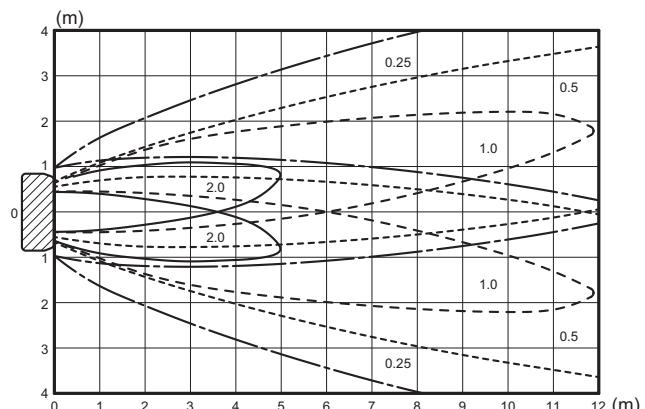

Side view
 Vertical airflow direction louver: Up
 Horizontal airflow direction louver: Center

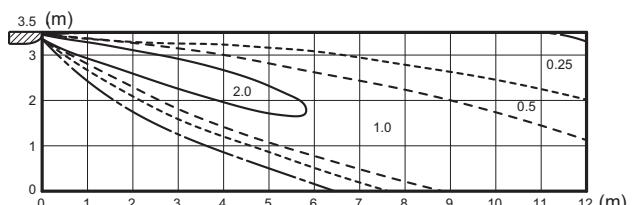


Side view
 Vertical airflow direction louver: Down
 Horizontal airflow direction louver: Center

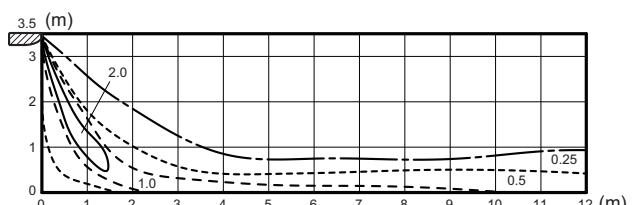


■ Model: ABYG45KRTA

Measuring conditions	Fan speed	Operation mode
	HIGH	FAN


Top view
 Vertical airflow direction louver: Up
 Horizontal airflow direction louver: Center

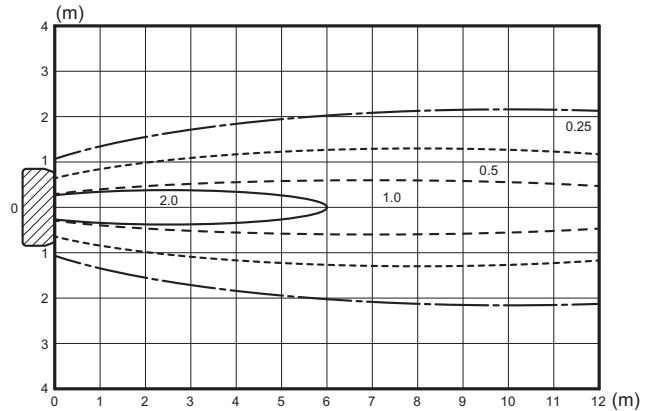


Top view
 Vertical airflow direction louver: Up
 Horizontal airflow direction louver: Left & Right

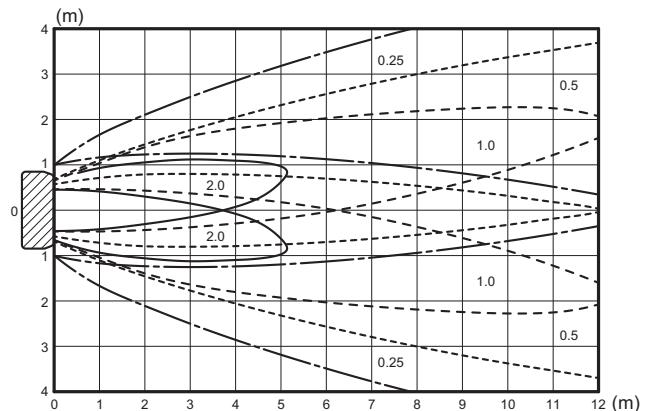

Side view
 Vertical airflow direction louver: Up
 Horizontal airflow direction louver: Center

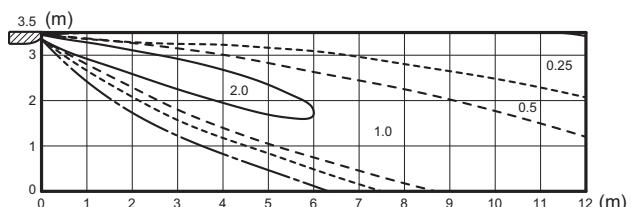

Side view
 Vertical airflow direction louver: Down
 Horizontal airflow direction louver: Center

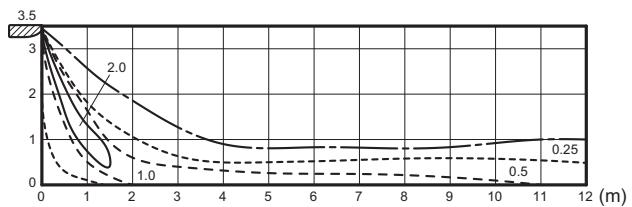

5-2. Airflow

Conversion factor:

- $1 \text{ m}^3/\text{h} = 0.2778 \text{ l/s} = 0.5886 \text{ CFM}$
- $3.6 \text{ m}^3/\text{h} = 1 \text{ l/s}$
- $1.699 \text{ m}^3/\text{h} = 1 \text{ CFM}$

■ Model: ABYG18KRTA

● Cooling

Fan speed	Airflow	
HIGH	m^3/h	840
	l/s	233
	CFM	494
MED	m^3/h	790
	l/s	219
	CFM	465
LOW	m^3/h	710
	l/s	197
	CFM	418
QUIET	m^3/h	650
	l/s	181
	CFM	383

● Heating

Fan speed	Airflow	
HIGH	m^3/h	840
	l/s	233
	CFM	494
MED	m^3/h	790
	l/s	219
	CFM	465
LOW	m^3/h	710
	l/s	197
	CFM	418
QUIET	m^3/h	650
	l/s	181
	CFM	383

■ Model: ABYG22KRTA**● Cooling**

Fan speed	Airflow	
HIGH	m ³ /h	900
	l/s	250
	CFM	530
MED	m ³ /h	790
	l/s	219
	CFM	465
LOW	m ³ /h	710
	l/s	197
	CFM	418
QUIET	m ³ /h	650
	l/s	181
	CFM	383

● Heating

Fan speed	Airflow	
HIGH	m ³ /h	900
	l/s	250
	CFM	530
MED	m ³ /h	790
	l/s	219
	CFM	465
LOW	m ³ /h	710
	l/s	197
	CFM	418
QUIET	m ³ /h	650
	l/s	181
	CFM	383

■ Model: ABYG24KRTA**● Cooling**

Fan speed	Airflow	
HIGH	m ³ /h	1,230
	l/s	342
	CFM	724
MED	m ³ /h	990
	l/s	275
	CFM	583
LOW	m ³ /h	860
	l/s	239
	CFM	506
QUIET	m ³ /h	700
	l/s	194
	CFM	412

● Heating

Fan speed	Airflow	
HIGH	m ³ /h	1,230
	l/s	342
	CFM	724
MED	m ³ /h	990
	l/s	275
	CFM	583
LOW	m ³ /h	860
	l/s	239
	CFM	506
QUIET	m ³ /h	700
	l/s	194
	CFM	412

■ Model: ABYG30KRTA**● Cooling**

Fan speed	Airflow	
HIGH	m ³ /h	1,400
	l/s	389
	CFM	824
MED	m ³ /h	1,120
	l/s	311
	CFM	659
LOW	m ³ /h	980
	l/s	272
	CFM	577
QUIET	m ³ /h	800
	l/s	222
	CFM	471

● Heating

Fan speed	Airflow	
HIGH	m ³ /h	1,400
	l/s	389
	CFM	824
MED	m ³ /h	1,120
	l/s	311
	CFM	659
LOW	m ³ /h	980
	l/s	272
	CFM	577
QUIET	m ³ /h	800
	l/s	222
	CFM	471

■ Model: ABYG36KRTA**● Cooling**

Fan speed	Airflow	
HIGH	m ³ /h	1,850
	l/s	514
	CFM	1,089
MED	m ³ /h	1,470
	l/s	408
	CFM	865
LOW	m ³ /h	1,300
	l/s	361
	CFM	765
QUIET	m ³ /h	1,050
	l/s	292
	CFM	618

● Heating

Fan speed	Airflow	
HIGH	m ³ /h	1,800
	l/s	500
	CFM	1,059
MED	m ³ /h	1,470
	l/s	408
	CFM	865
LOW	m ³ /h	1,300
	l/s	361
	CFM	765
QUIET	m ³ /h	1,050
	l/s	292
	CFM	618

■ Model: ABYG45KRTA**● Cooling**

Fan speed	Airflow	
HIGH	m ³ /h	1,900
	l/s	528
	CFM	1,118
MED	m ³ /h	1,510
	l/s	419
	CFM	889
LOW	m ³ /h	1,380
	l/s	383
	CFM	812
QUIET	m ³ /h	1,130
	l/s	314
	CFM	665


● Heating

Fan speed	Airflow	
HIGH	m ³ /h	1,850
	l/s	514
	CFM	1,089
MED	m ³ /h	1,510
	l/s	419
	CFM	889
LOW	m ³ /h	1,380
	l/s	383
	CFM	812
QUIET	m ³ /h	1,130
	l/s	314
	CFM	665


5-3. Fresh air characteristics

■ Airflow volume - Static pressure of Fresh air intake characteristics


- Models: ABYG18KRTA and ABYG22KRTA

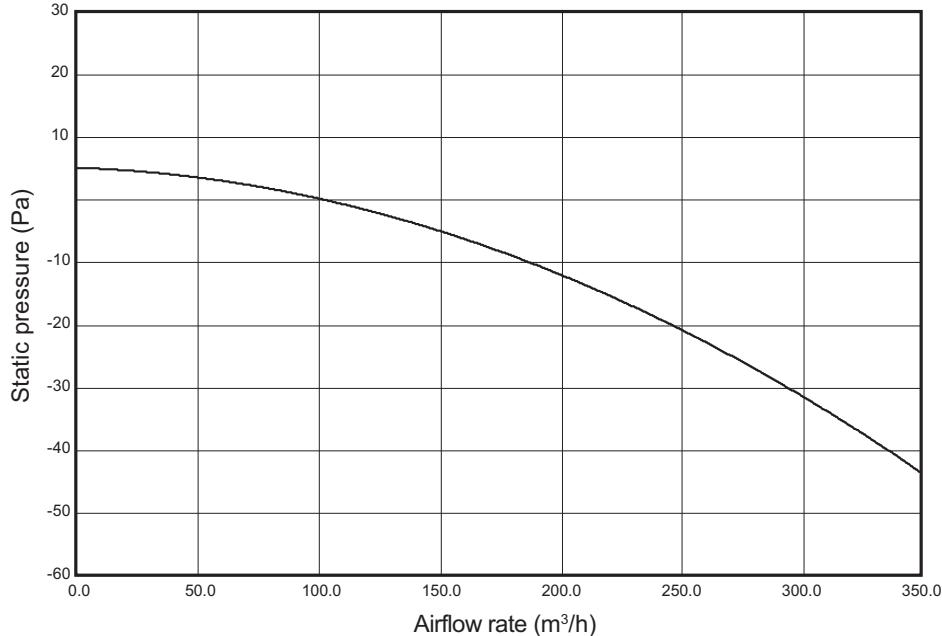


- Models: ABYG24KRTA and ABYG30KRTA

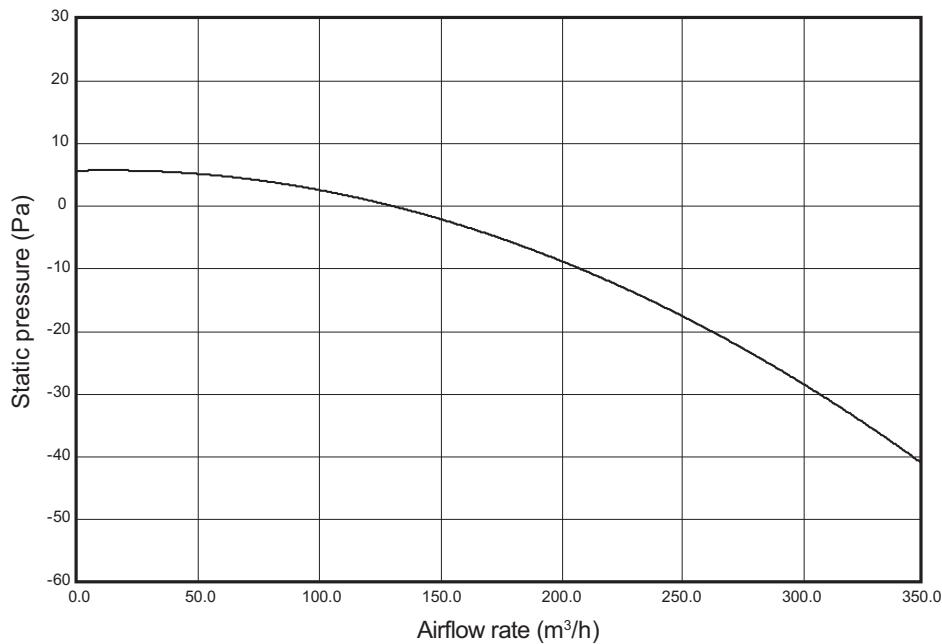

● Models: ABYG36KRTA and ABYG45KRTA

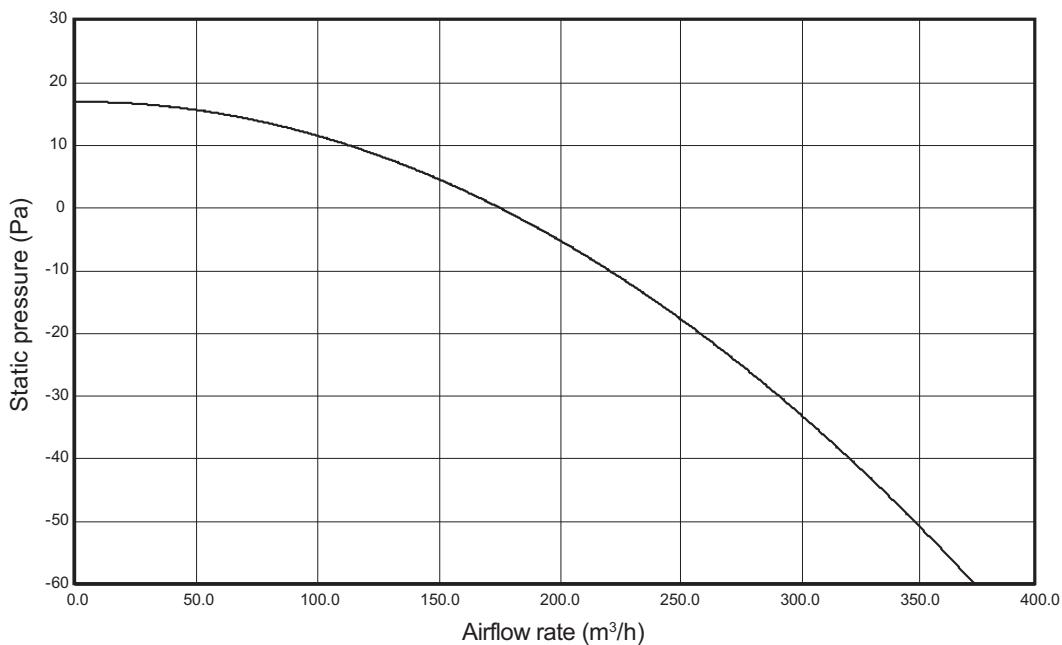


■ How to read curve

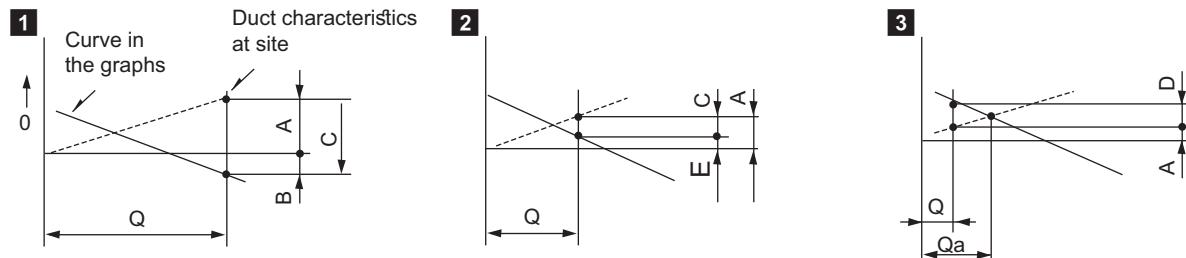

- Q: Designed amount of fresh air intake (m^3/h)
- A: Static pressure loss of fresh air intake duct system with airflow amount Q (Pa)
- B: Forced static pressure at air conditioner inlet with airflow amount Q (Pa)
- C: Static pressure of booster fan with airflow amount Q (Pa)
- D: Static pressure loss increase amount of fresh air intake duct system for airflow amount Q (Pa)
- E: Static pressure of indoor unit with airflow amount Q (Pa)
- Qa: Estimated amount of fresh air intake without D (m^3/h)

■ Installation

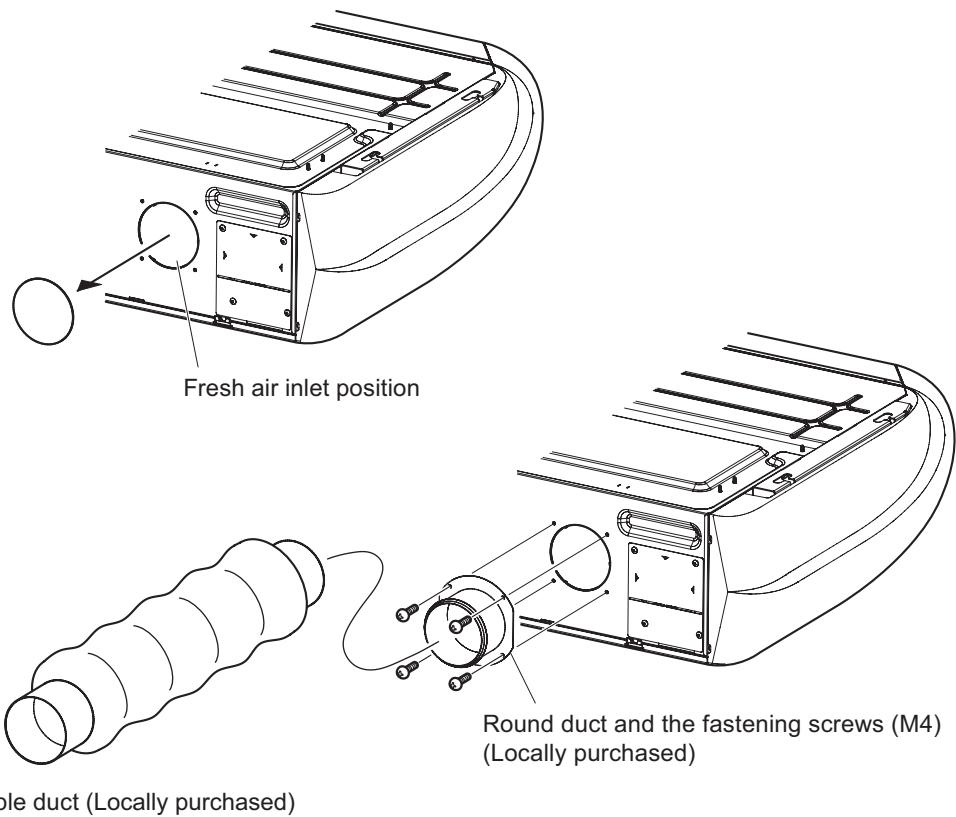


NOTE: When taking in the fresh air, thermal insulation is required to avoid the product malfunction caused by dew condensation.

6. Operation noise (sound pressure)


6-1. Noise level curve

■ Model: ABYG18KRTA

● Cooling

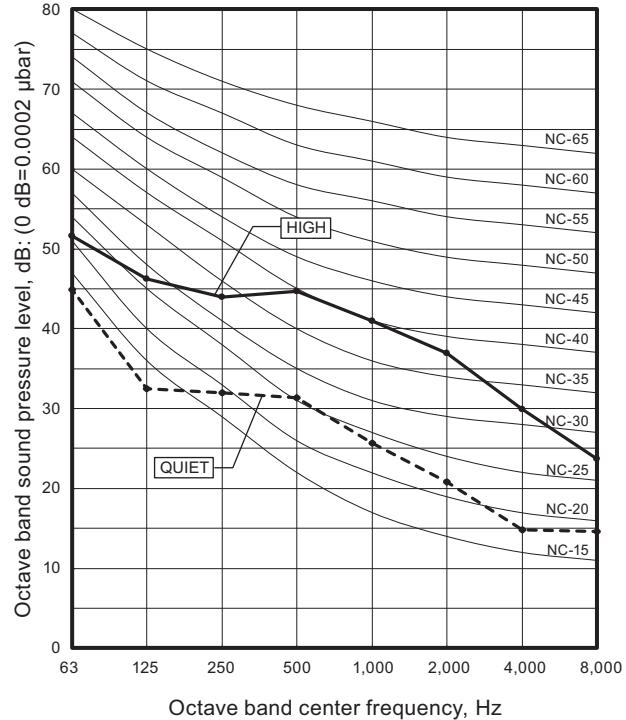


● Heating

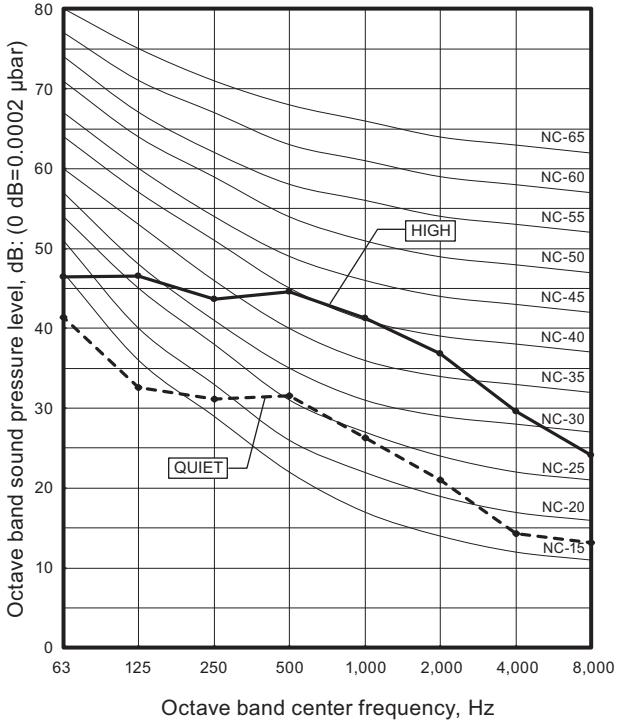






■ Model: ABYG22KRTA





● Cooling

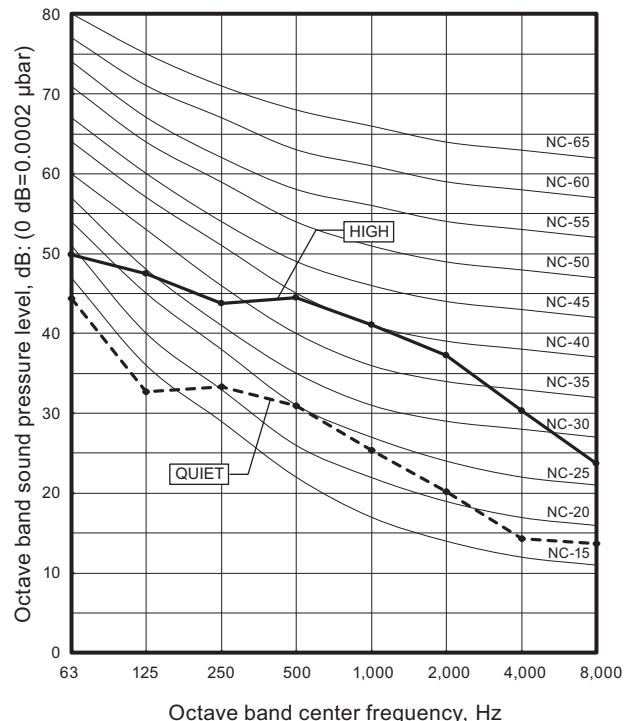


● Heating

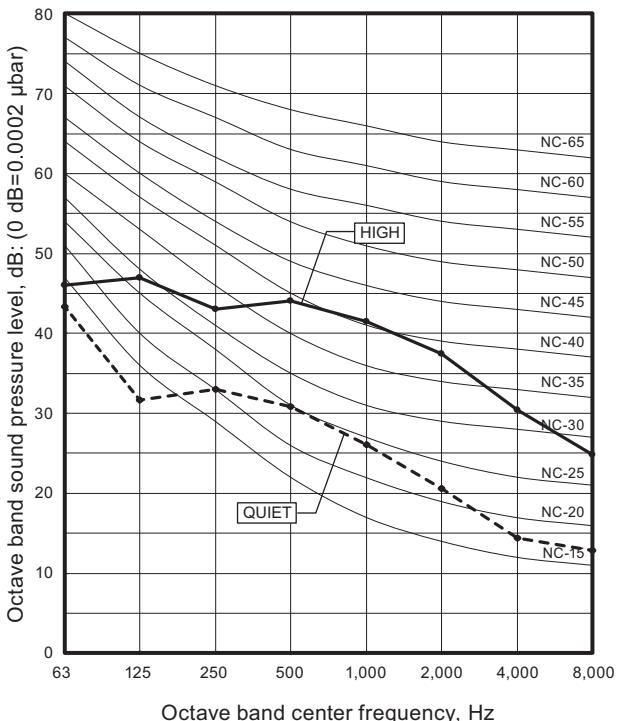

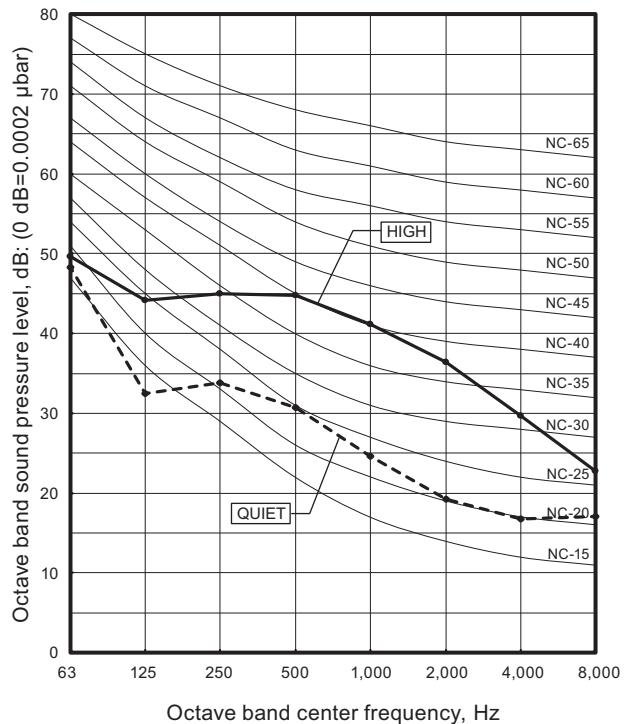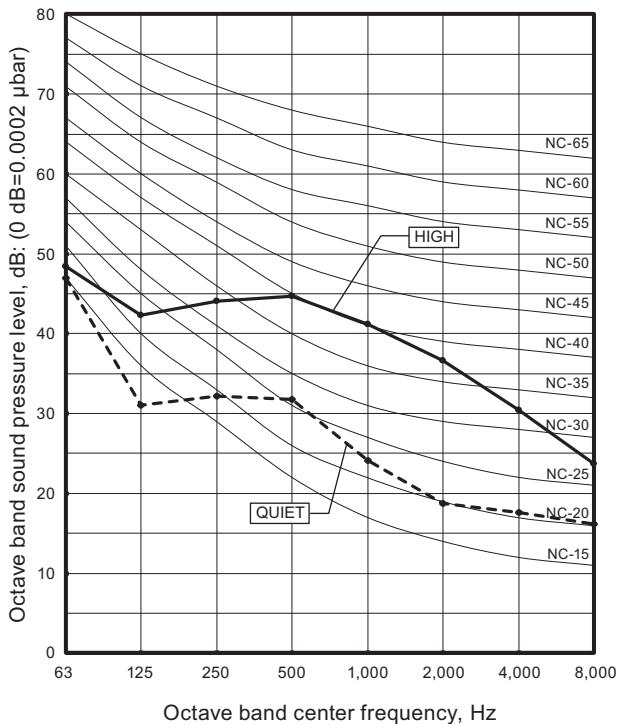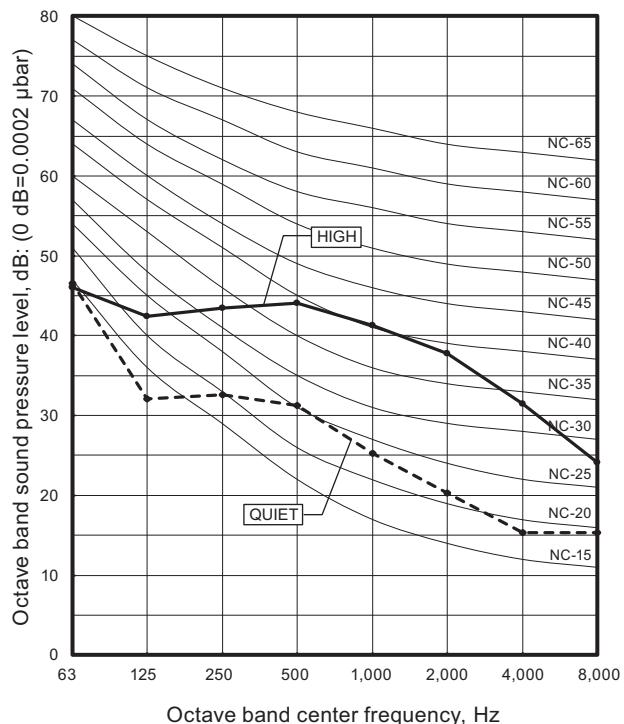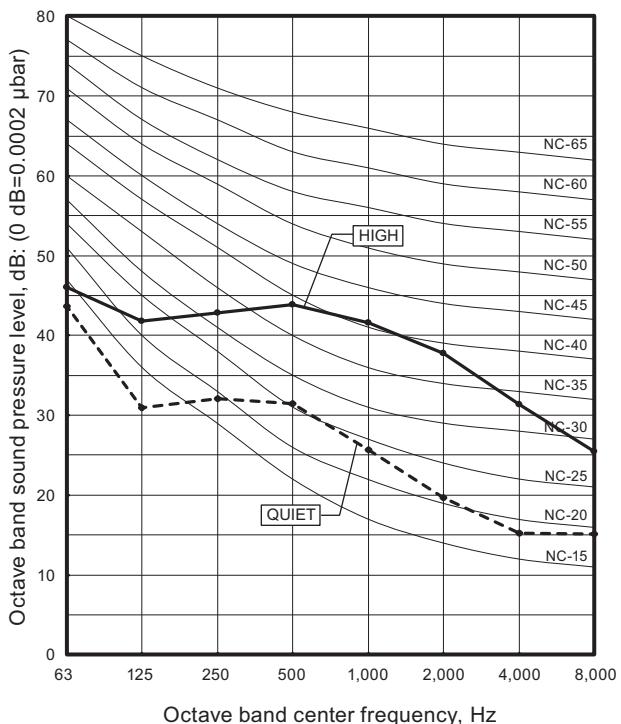■ Model: ABYG24KRTA**● Cooling****● Heating****■ Model: ABYG30KRTA****● Cooling****● Heating**

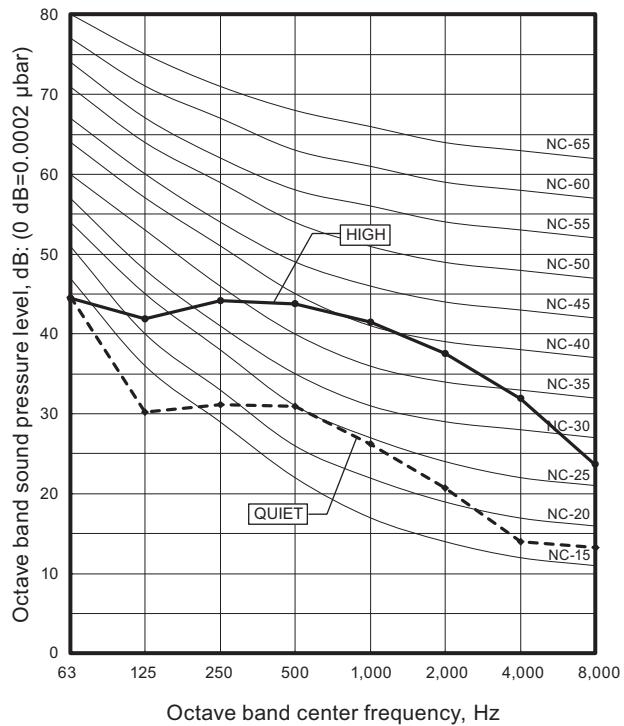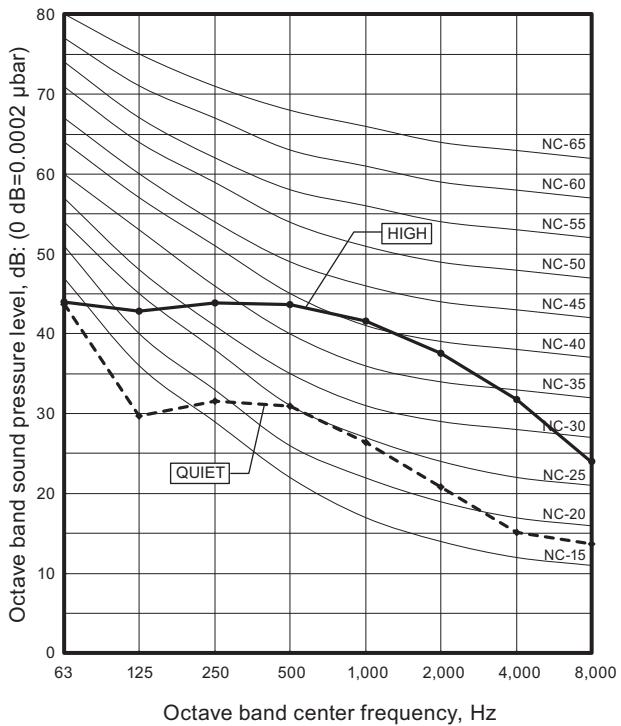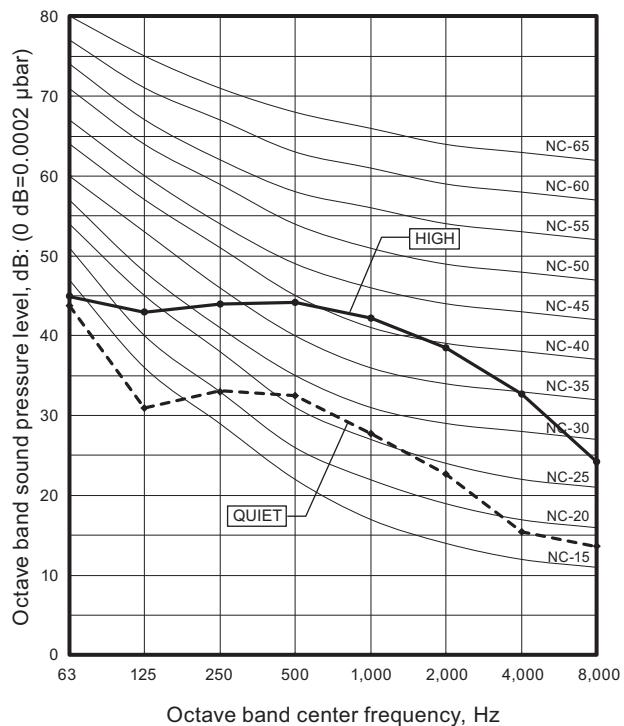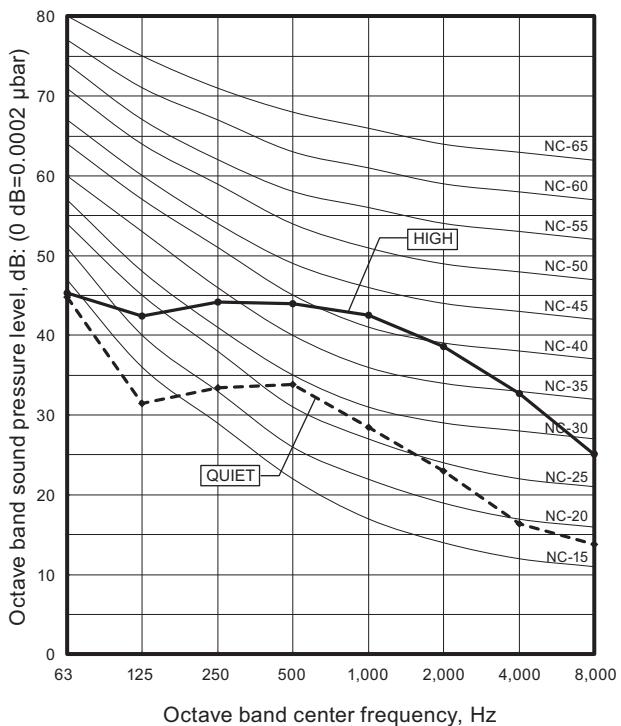■ Model: ABYG36KRTA**● Cooling****● Heating****■ Model: ABYG45KRTA****● Cooling****● Heating**

6-2. Sound level check point

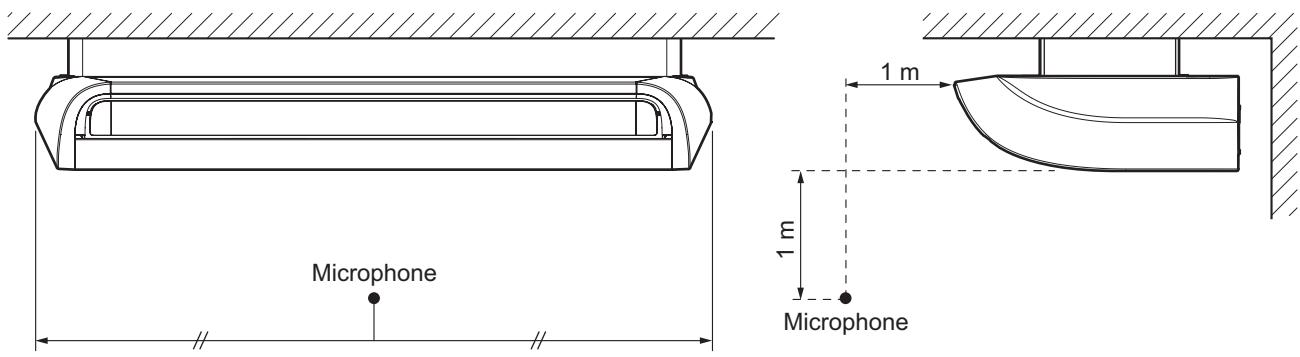

7. Safety devices

Type of protection	Protection form	Model	
		ABYG18KRTA	ABYG22KRTA
Circuit protection	Current fuse (PCB*)		250 V, 5.0 A
Fan motor protection	Thermal protection program	Activate	135±15 °C Fan motor stop
		Reset	105±15 °C Fan motor restart

Type of protection	Protection form	Model	
		ABYG24KRTA	ABYG30KRTA
Circuit protection	Current fuse (PCB*)		250 V, 5.0 A
Fan motor protection	Thermal protection program	Activate	135±15 °C Fan motor stop
		Reset	105±15 °C Fan motor restart

Type of protection	Protection form	Model	
		ABYG36KRTA	ABYG45KRTA
Circuit protection	Current fuse (PCB*)		250 V, 5.0 A
Fan motor protection	Thermal protection program	Activate	135±15 °C Fan motor stop
		Reset	105±15 °C Fan motor restart

*PCB: Printed Circuit Board

8. External input and output

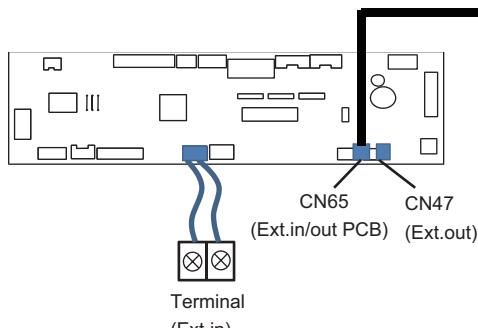


Fig. Indoor unit PCB

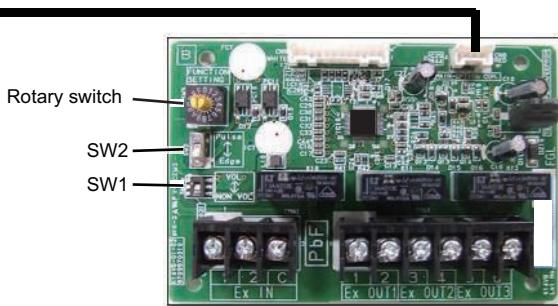


Fig. External input and output PCB


PCB	External input	External output	Connector	Input select	Input signal	External connect kit (Optional parts)
Indoor unit	Operation/Stop Forced stop	—	Terminal CN47	Dry contact	Edge	—
	—	Operation status		—	—	UTY-XWZXZG
	—	Error status		—	—	
	—	Indoor unit fan operation status		—	—	
External input and output (UTY-XCSX)	External heater output	—	Input 1/ Input 2	Dry contact/ Apply voltage	Edge/ Pulse	—
	Operation/Stop	—			Edge	
	Forced thermostat off	—	Input 1		—	
	—	Operation status	Output 1 Output 2 Output 3	—	—	—
	—	Error status			—	
	—	Indoor unit status			—	
	—	External heater output			—	

8-1. External input

- “Operation/Stop” mode or “Forced stop” mode can be selected with function setting of indoor unit.
- A twisted pair cable (22AWG) should be used. Maximum length of cable is 150 m.
- The wire connection should be separate from the power cable line.

■ Indoor unit

Indoor unit functions such as Operation/Stop can be done by using indoor unit terminals.

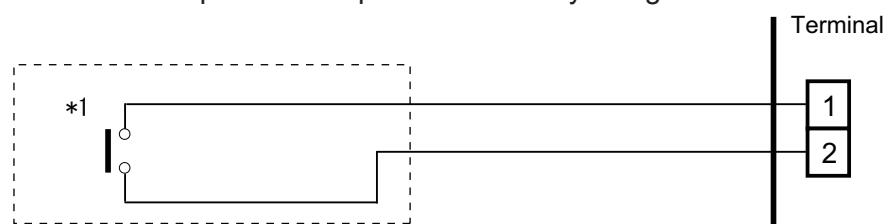

*1: The switch can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

■ External input and output PCB


The indoor unit Operation/Stop can be set by using the input terminal on the PCB.

● Input select

Use either one of these types of terminals according to the application. (Both types of terminals cannot be used simultaneously.)

- Dry contact


In case of internal power supply, set the slide switch of SW1 to "NON VOL" side.

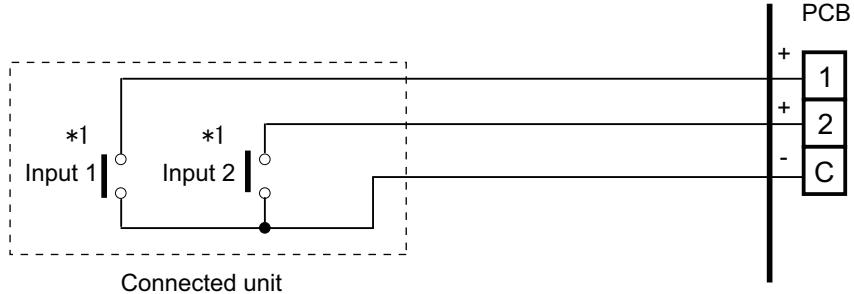

*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

- Apply voltage

In case of external power supply, set the slide switch of SW1 to "VOL" side.

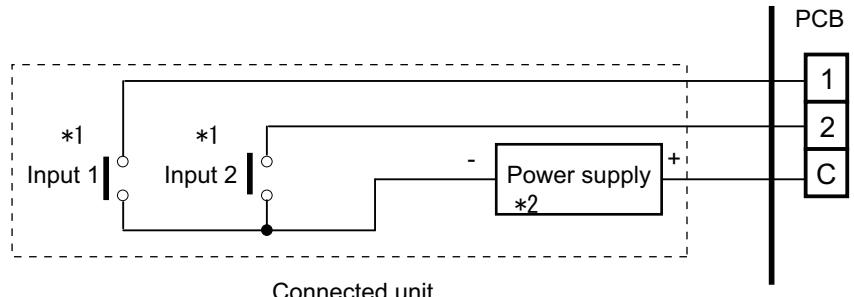

*1: The switches can be used on the following condition: DC 12 V to 24 V, 1 mA to 15 mA.

*2: Make the power supply DC 12 V to 24 V 10 mA or more.

8-2. External output


Use an external output cable with appropriate external dimension, depending on the number of cables to be installed.

■ Indoor unit

- A twisted pair cable (22AWG) should be used. Maximum length of cable is 25 m.
- Output voltage: High DC 12 V ± 2 V, Low 0 V.
- Permissible current: 50 mA
- For details, refer to Chapter 8-3. "[Combination of external input and output](#)" on page 41.


● When indicator, etc. are connected directly

Example: Function setting 60 is set to "00"

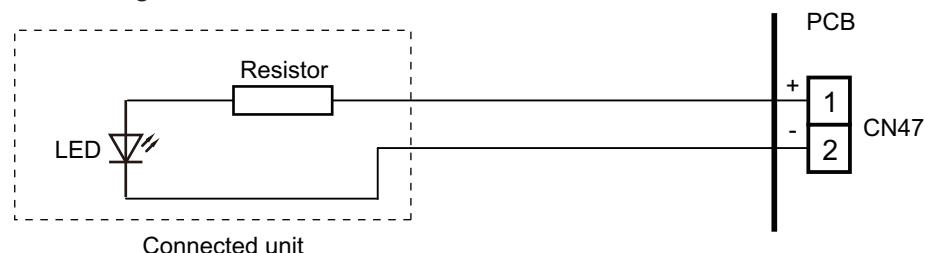

● When connecting with a device equipped with a power supply


Example: Function setting 60 is set to "00"

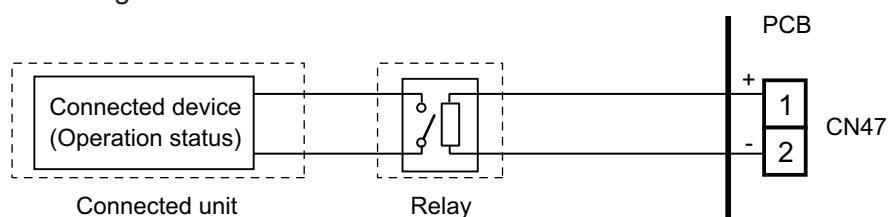

■ External input and output PCB

- A twisted pair cable (22AWG) should be used.
- Permissible voltage and current: DC 5 V to 30 V / 3 A, AC 30 V to 250 V / 3 A
- For details, refer to Chapter 8-3. "[Combination of external input and output](#)" on page 41.

Example

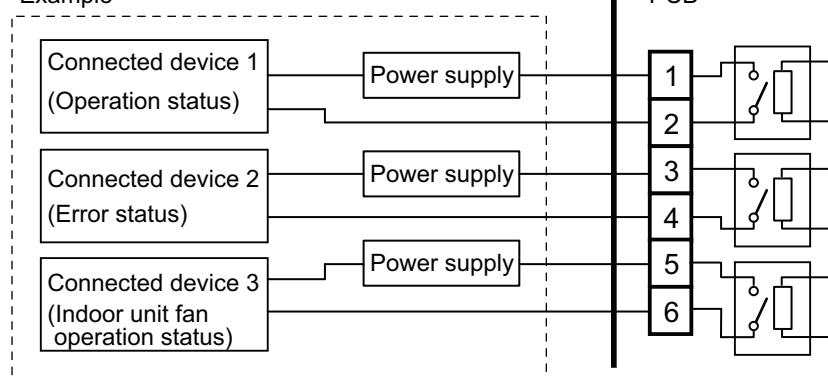

8-3. Combination of external input and output

By combining the function setting of the indoor unit and rotary switch setting of the External input and output PCB, you can select various combinations of functions.

Combination examples of external input and output are as follows:

Mode	Function setting	External input and output PCB (Rotary SW)	External input			
			Indoor unit Input	External input and output PCB		
			Terminal	Input 1	Input 2	Signal type
0-1	60-00	1	Operation/Stop	Operation/Stop	Not available	Edge
				Operation	Stop	Pulse
0-2	60-00	2	Operation/Stop	Forced Thermostat OFF	Not available	Edge
1-8	60-01 to 60-08	3 - 9, A	(Setting prohibited)			
9	60-09	B	Operation/Stop	Forced Thermostat OFF	Not available	Edge
10	60-10	C	Operation/Stop	Forced Thermostat OFF	Not available	Edge
11	60-11	D	Operation/Stop	Forced Thermostat OFF	Not available	Edge

Mode	Function setting	External input and output PCB (Rotary SW)	External output			
			Indoor unit Output	External input and output PCB		
			CN47	Output 1	Output 2	Output 3
0-1	60-00	1	Operation/Stop	Operation/Stop	Error status	Indoor unit fan operation status
0-2	60-00	2	Operation/Stop	Error status	Indoor unit fan operation status	External heater output
1-8	60-01 to 60-08	3 - 9, A	(Setting prohibited)			
9	60-09	B	Error status	Operation/Stop	Indoor unit fan operation status	External heater output
10	60-10	C	Indoor unit fan operation status	Operation/Stop	Error status	External heater output
11	60-11	D	External heater output	Operation/Stop	Indoor unit fan operation status	Error status

NOTE: Input of Operation/Stop depends on the setting of function setting 46.

- 00: Operation/Stop mode 1 (R.C. enabled)
- 01: (Setting prohibited)
- 02: Forced stop
- 03: Operation/Stop mode 2 (R.C. disabled)

■ Input signal type

- Indoor unit


Input signal type is only "Edge".



- External input and output PCB

The input signal type can be selected.

Signal type (edge or pulse) can be switched by the DIP switch 2 (SW2) on the External input and output PCB.

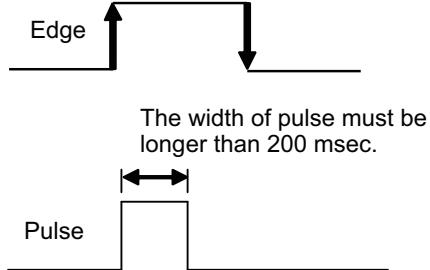


8-4. Details of function

■ Control input function

● When function setting is "Operation/Stop" mode 1


- In the case of "Edge" input

Function setting /	Rotary SW of External input and output PCB	External input		Input signal	Command
46-00	-	Input of indoor unit	Terminal	Off → On	Operation
	60-00 / 1	External input and output PCB	Input 1	On → Off	Stop
				Off → On	Operation
				On → Off	Stop

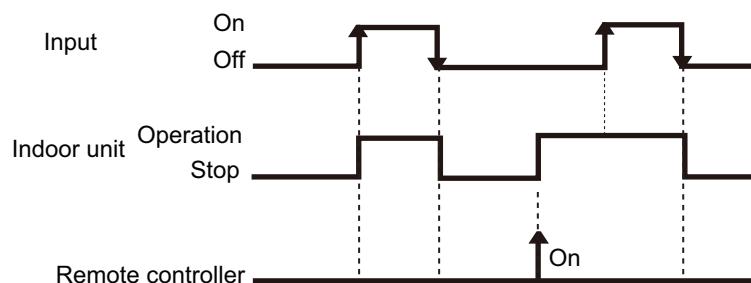

- In the case of "Pulse" input

Function setting /	Rotary SW of External input and output PCB	External input		Input signal	Command
46-00	60-00 / 1	External input and output PCB	Input 1	Pulse	Operation
			Input 2	Pulse	Stop

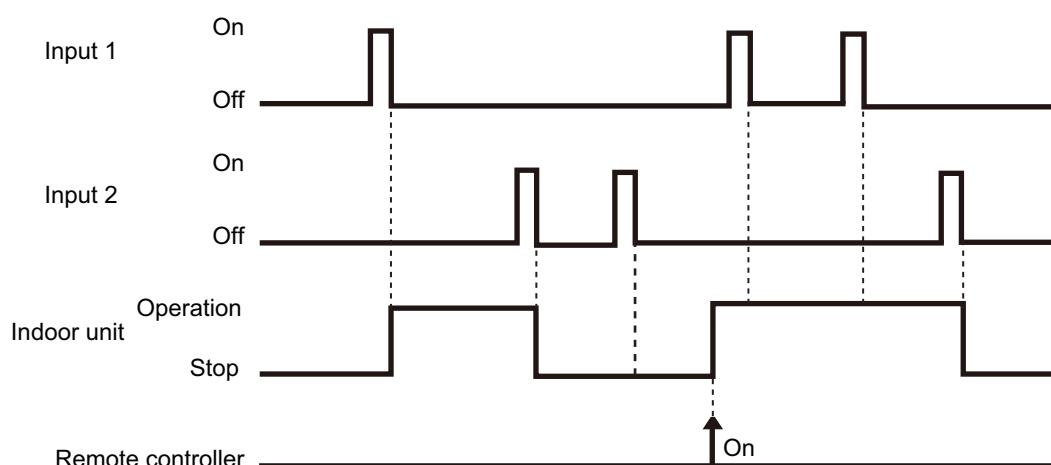


NOTES:

- The last command has priority.
- The indoor units within the same remote controller group operate in the same mode.

● When function setting is "Forced stop" mode


- In the case of "Edge" input

Function setting /	Rotary SW of External input and output PCB	External input		Input signal	Command
46-02	-	Input of indoor unit	Terminal	Off → On	Forced stop
	60-00 / 1	External input and output PCB	Input 1	On → Off	Normal

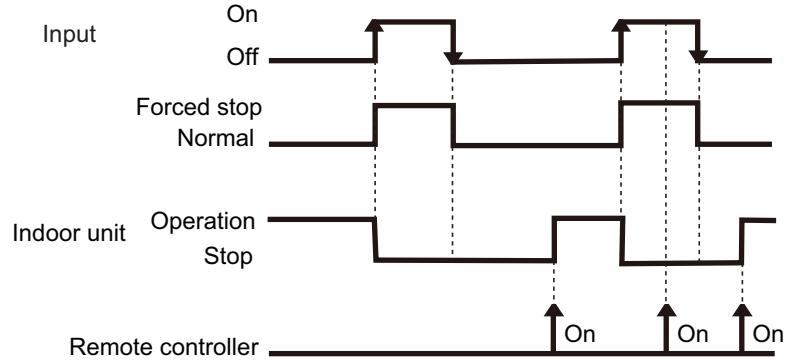

- In the case of "Pulse" input

Function setting /	Rotary SW of External input and output PCB	External input		Input signal	Command
46-02	60-00 / 1	External input and output PCB	Input 1	Pulse	Forced stop
			Input 2	Pulse	Normal

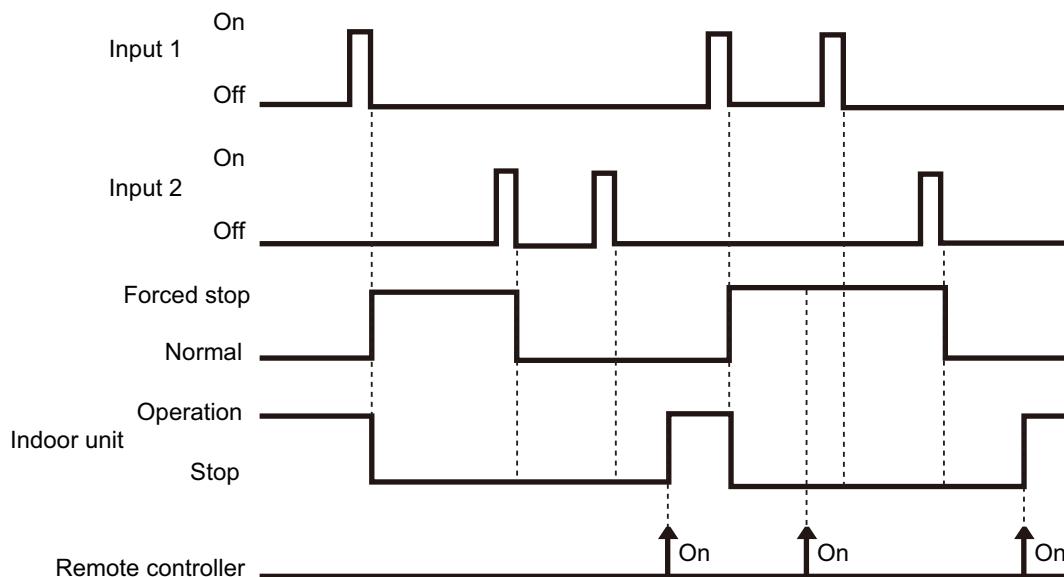


NOTES:

- When the forced stop is triggered, indoor unit stops and Operation/Stop operation by the remote controller is restricted.
- When forced stop function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

● When function setting is "Operation/Stop" mode 2


- In the case of "Edge" input

Function setting /	Rotary SW of External input and output PCB	External input		Input signal	Command
46-03	-	Input of indoor unit	Terminal	Off → On	Operation
	60-00 / 1			On → Off	Stop (R.C. disabled)
	60-00 / 1	External input and output PCB	Input 1	Off → On	Operation
				On → Off	Stop (R.C. disabled)

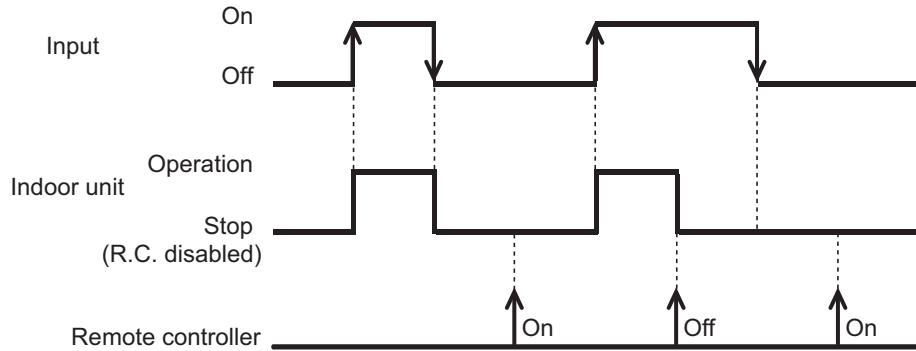

- In the case of "Pulse" input

Function setting /	Rotary SW of External input and output PCB	External input		Input signal	Command
46-03	60-00 / 1	External input and output PCB	Input 1	Pulse	Operation
			Input 2	Pulse	Stop (R.C. disabled)

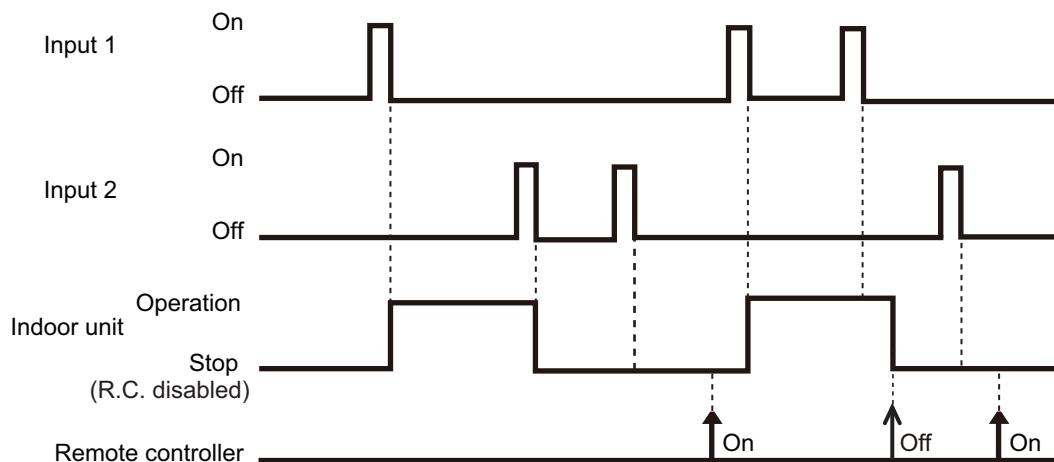


NOTES:

- When "Operation/Stop" mode 2 function is used with forming a remote controller group, connect the same equipment to each indoor unit within the group.

■ Forced thermostat off function


Function setting /	Rotary SW of External input and output PCB	External input	Input signal	Command
60-00 / 2 60-09 / B 60-10 / C 60-11 / D	External input and output PCB	Input 1	Off → On	Thermostat off
			On → Off	Normal operation

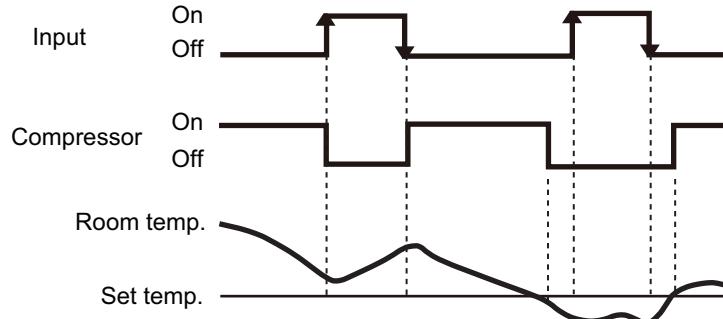

■ Control output function

Function setting /	Rotary SW of External input and output PCB	External output	Output signal	Command
60-00 / 1, 2	Output of indoor unit	CN47	Low → High	Operation
			High → Low	Stop
60-00 / 1 60-09 / B 60-10 / C 60-11 / D	External input and output PCB	Output 1	Off → On	Operation
			On → Off	Stop


The output is low when the unit is stopped.

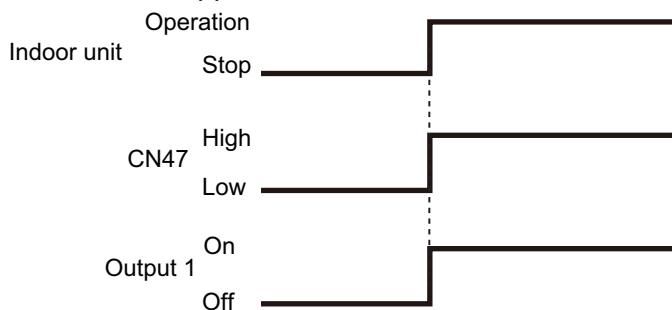

■ Error status

Function setting /	Rotary SW of External input and output PCB	External output		Output signal	Command
60-09 / B		Output of indoor unit	CN47	Low → High	Error
				High → Low	Normal
60-00 / 2				Off → On	Error
				On → Off	Normal
60-00 / 1		External input and output PCB	Output 2	Off → On	Error
60-10 / C				On → Off	Normal
60-11 / D			Output 3	Off → On	Error
				On → Off	Normal


The output is ON when an error is generated for the indoor unit.

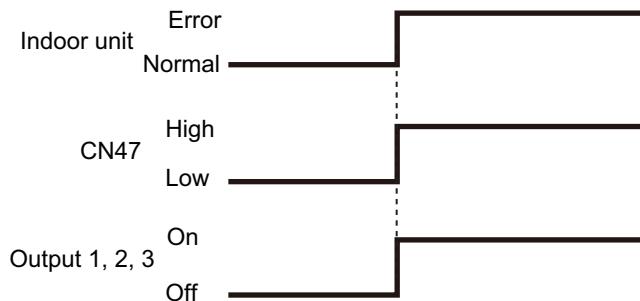

■ Indoor unit fan operation status

Function setting /	Rotary SW of External input and output PCB	External output		Output signal	Command
60-10 / C		Output of indoor unit	CN47	Low → High	Fan run
				High → Low	Fan stop
60-00 / 2				Off → On	Fan run
60-09 / B		External input and output PCB	Output 2	On → Off	Fan stop
60-11 / D				Off → On	Fan run
60-00 / 1			Output 3	On → Off	Fan stop

Output signal	Condition
On Low → High	The indoor unit fan is operating.
Off High → Low	The fan is stopped or during cold air prevention. During thermostat off when in dry mode operation.

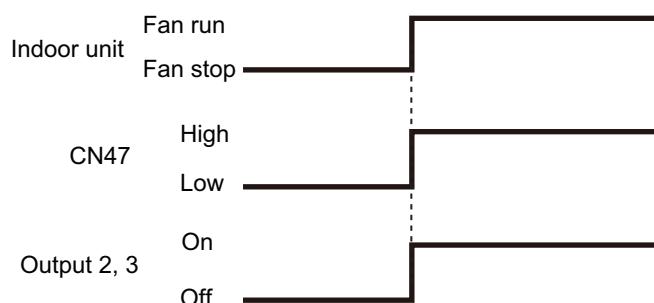

■ External heater output


Function setting /	Rotary SW of External input and output PCB	External output		Output signal	Command
60-11 / D		Output of indoor unit		CN47	Low → High Heater on
60-00 / 2 60-09 / B 60-10 / C		External input and output PCB			High → Low Heater off
		Output 3		Off → On On → Off	Heater on
					Heater off

Output signal	Condition
Low → High Off → On	Heater turns on as shown in diagram of heating temperature
High → Low On → Off	Heater turns off as shown in diagram of heating temperature <ul style="list-style-type: none"> • Other than Heating mode • Error occurred • Forced thermo off • Fan stop protection

Specifications of the signal output performance are as shown as follows:

Example: When set temperature (T_s) is set at 22 °C;

- And room temperature (Tr) increase above 12 °C, signal output is on.
- And Tr increase above 21 °C, signal output is off.
- And Tr decrease below 19 °C, signal output is on.
- And Tr decrease below 10 °C, signal output is off.

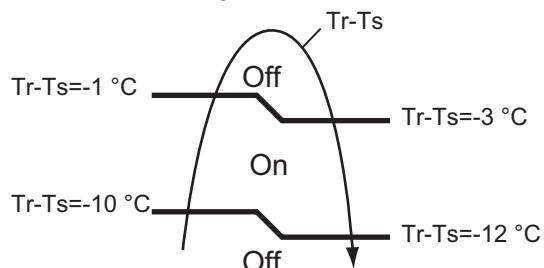

The output also turns off in defrost operation.


9. Group connection

Installation procedure for group control system:

A number of indoor units can be operated at the same time using a single remote controller.

NOTE: When different type of indoor units (such as wall mounted type and cassette type, cassette type and duct type, or other combinations) are connected using group control system, some functions may no longer be available.

1. Connect up to 16 indoor units in a system.

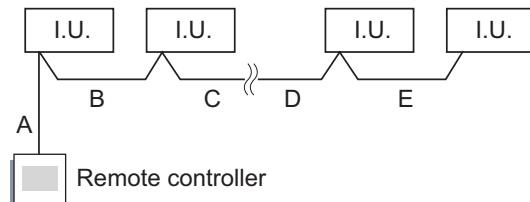


A, B, C, D, E: Remote controller cable

Wiring length limitation

$A + B + C + D + E \leq 500 \text{ m}$

Example of wiring method

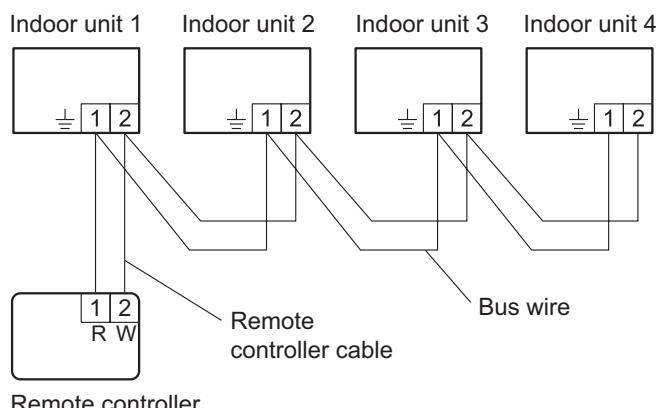

2. Set the R.C. address. (Function setting)


- Addresses will be automatically set when initially starting up this unit. In such a case, do not change the remote controller address for the indoor unit, and keep it at the initial setting of "00".
- Only set addresses manually when using different numbers for addresses.
Set the R.C. address of each indoor unit using the function setting. (Refer to "Remote controller address setting" in "[Contents of function setting](#)" on page 50.)

NOTES:

- Do not use the same setting value.
- Setting is reflected after the power is turned on again.
Also set the R.C. address for the remote controller. For details, refer to the remote controller installation manual.

NOTE: In manual setting, connect up to 15 indoor units in a system.

Example of wiring method

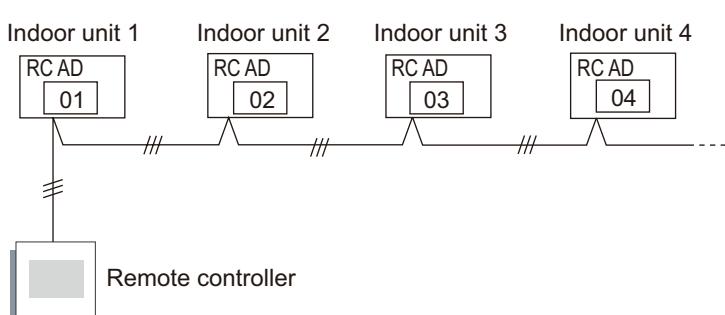

10. Function settings

To adjust the functions of this product according to the installation environment, various types of function settings are available.

NOTE: Incorrect settings can cause a product malfunction.

10-1. Function settings by using remote controller

Some function settings can be changed on the remote controller. After confirming the setting procedure and the content of each function setting, select appropriate functions for your installation environment.

■ Setting procedure by using remote controller

Remote controller is not attached for this product. For details of the installing remote controller, refer to following information.

- Overview information: Operating manual of the remote controller
- Setting procedure: Installation manual of the remote controller

■ Contents of function setting

Each function setting listed in this section is adjustable in accordance with the installation environment.

NOTE: Setting will not be changed if invalid numbers or setting values are selected.

● Function setting list

	Function no.	Functions
1)	11	Filter sign
2)	20	Ceiling height
3)	28	Horizontal louver direction switching for dew condensation prevention
4)	30/31	Room temperature control for indoor unit sensor
5)	35/36	Room temperature control for wired remote controller sensor
6)	40	Auto restart
7)	42	Room temperature sensor switching
8)	44	Remote controller custom code
9)	46	External input control
10)	48	Room temperature sensor switching (Aux.)
11)	49	Indoor unit fan control for energy saving for cooling
12)	60	Switching functions for external output terminal

1) Filter sign

Select appropriate intervals for displaying the filter sign on the indoor unit according to the estimated amount of dust in the air of the room.

If the indication is not required, select "No indication" (03).

Function number	Setting value	Setting description	Factory setting
11	00	Standard (2,500 hours)	
	01	Long interval (4,400 hours)	
	02	Short interval (1,250 hours)	
	03	No indication	◆

2) Ceiling height

Select the appropriate ceiling height according to the place of installation.

Function number	Setting value	Setting description	Factory setting
20	00	Standard	◆
	01	High ceiling	

For the specific height for each setting value, refer to "Installation space" in Chapter 2. "[Dimensions](#)" on page 8.

3) Horizontal louver direction switching for dew condensation prevention

Automatically switches the position of the horizontal louver if the airflow direction is set at lower than the dew condensation limit position in cooling or drying operation.

Select suitable adjustment position according to the customer's preference.

Function number	Setting value	Setting description	Factory setting
28	00	Adjust to dew condensation limit position	◆
	01	Adjust to cooling standard position	

4) Room temperature control for indoor unit sensor

Depending on the installed environment, correction of the room temperature sensor may be required. Select the appropriate control setting according to the installed environment.

The temperature of the room temperature sensor is corrected as follows:

$$\text{Corrected temp.} = \text{Temp. of the room temp. sensor} - \text{Correction temp. value}$$

Example of correction:

When the temperature of the room temp. sensor is 26°C and the setting value is "03" (-1.0°C), corrected temp. will be 27°C (26°C - [-1.0°C]).

The temperature correction values show the difference from the Standard setting "00" (manufacturer's recommended value).

Function number	Setting value	Setting description	Factory setting
30 (For cooling)	00	Standard setting	◆
	01	No correction 0.0 °C	
	02	-0.5 °C	More cooling Less heating
	03	-1.0 °C	
	04	-1.5 °C	
	05	-2.0 °C	
	06	-2.5 °C	
	07	-3.0 °C	
	08	-3.5 °C	
	09	-4.0 °C	
	10	+0.5 °C	Less cooling More heating
	11	+1.0 °C	
	12	+1.5 °C	
	13	+2.0 °C	
	14	+2.5 °C	
	15	+3.0 °C	
	16	+3.5 °C	
	17	+4.0 °C	

5) Room temperature control for wired remote controller sensor

Depending on the installed environment, correction of the wire remote temperature sensor may be required. Select the appropriate control setting according to the installed environment.

To change this setting, set Function 42 to Both "01".

Ensure that the Thermo Sensor icon is displayed on the remote controller screen.

Function number	Setting value	Setting description	Factory setting		
35 (For cooling)	36 (For heating)	00	Standard setting		
		01	No correction 0.0°C		
		02	-0.5 °C		
		03	-1.0 °C		
		04	-1.5 °C		
		05	-2.0 °C		
		06	-2.5 °C		
		07	-3.0 °C		
		08	-3.5 °C		
		09	-4.0 °C		
		10	+0.5 °C		
		11	+1.0 °C		
		12	+1.5 °C		
		13	+2.0 °C		
		14	+2.5 °C		
		15	+3.0 °C		
		16	+3.5 °C		
		17	+4.0 °C		
More cooling Less heating			◆		
Less cooling More heating					

6) Auto restart

Enables or disables automatic restart after a power interruption.

Function number	Setting value	Setting description	Factory setting
40	00	Enable	◆
	01	Disable	

NOTE: Auto restart is an emergency function such as for power outage etc. Do not attempt to use this function in normal operation. Be sure to operate the unit by remote controller or external device.

7) Room temperature sensor switching

(Only for wired remote controller)

When using the wired remote controller temperature sensor, change the setting to "Both" (01).

Function number	Setting value	Setting description	Factory setting
42	00	Indoor unit	◆
	01	Both	

00: Sensor on the indoor unit is active.

01: Sensors on both indoor unit and wired remote controller are active.

NOTE: Remote controller sensor must be turned on by using the remote controller.

8) Remote controller custom code

(Only for wireless remote controller)

The indoor unit custom code can be changed. Select the appropriate custom code.

Function number	Setting value	Setting description	Factory setting
44	00	A	◆
	01	B	
	02	C	
	03	D	

9) External input control

"Operation/Stop" mode or "Forced stop" mode can be selected.

Function number	Setting value	Setting description	Factory setting
46	00	Operation/Stop mode 1	◆
	01	(Setting prohibited)	
	02	Forced stop mode	
	03	Operation/Stop mode 2	

10) Room temperature sensor switching (Aux.)

To use the temperature sensor on the wired remote controller only, change the setting to "Wired remote controller" (01).

This function will only work if the function setting 42 is set at "Both" (01).

When the setting value is set to "Both" (00), more suitable control of the room temperature is possible by setting function setting 30 and 31 too.

Function number	Setting value	Setting description	Factory setting
48	00	Both	◆
	01	Wired remote controller	

11) Indoor unit fan control for energy saving for cooling

Enables or disables the power-saving function by controlling the indoor unit fan rotation when the outdoor unit is stopped during cooling operation.

Function number	Setting value	Setting description	Factory setting
49	00	Disable	
	01	Enable	
	02	Remote controller	◆

00: When the outdoor unit is stopped, the indoor unit fan operates continuously following the setting on the remote controller.

01: When the outdoor unit is stopped, the indoor unit fan operates intermittently at a very low speed.

02: Enable or disable this function by remote controller setting.

NOTES:

- As the factory setting, this setting is initially activated.
- Set to "00" or "01" when connecting a remote controller that cannot set the Fan control for energy saving function or connecting a network converter.
To confirm if the remote controller has this setting, refer to the operating manual of each remote controller.





12) Switching functions for external output terminal

Functions of the external output terminal can be switched. For details, refer to "External input and output".









Function number	Setting value	Setting description	Factory setting
60	00	Operation status	◆
	01—08	(Setting prohibited)	
	09	Error status	
	10	Indoor unit fan operation status	
	11	External heater	

11. Accessories

11-1. Models: ABYG18KRTA and ABYG22KRTA


Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Operating manual		1	Insulation		1
Operating manual (CD-ROM)		1	Drain hose		1
Installation manual		1	Hose band		1
Template		1	Cable tie (large)		4
M10 nut A (with flange)		4	Cable tie (small)		1
M10 nut B (with spring lock washer)		4	Remote controller cable hole cap		1
Washer		8	Tapping screw (White)		6
Coupler heat insulation (large)		1	Tapping screw		3
Coupler heat insulation (small)		1			

11-2. Models: ABYG24KRTA, ABYG30KRTA, ABYG36KRTA, and ABYG45KRTA

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Operating manual		1	Insulation		1
Operating manual (CD-ROM)		1	Drain hose		1
Installation manual		1	Hose band		1
Template		1	Cable tie (large)		4
M10 nut A (with flange)		4	Cable tie (small)		1
M10 nut B (with spring lock washer)		4	Remote controller cable hole cap		1
Washer		8	Tapping screw (White)		6
Coupler heat insulation (large)		1	Casing guard		1
Coupler heat insulation (small)		1	Tapping screw		3







12. Optional parts

12-1. Controllers

Exterior	Part name	Model name	Summary
	Wired remote controller	UTY-RNRYZ*	Easy finger touch operation with LCD panel. Backlit LCD enables easy operation in a dark room. Wire type: Non-polar 2-wire
	Wired remote controller	UTY-RLRY	High visibility and easy operation. Room temperature can be accurately controlled using the built-in thermo sensor. Wire type: Non-polar 2-wire
	Simple remote controller	UTY-RSRY	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, temperature setting, and operation mode. Wire type: Non-polar 2-wire
	Simple remote controller	UTY-RHRY	Compact remote controller concentrates on the basic functions such as Start/Stop, fan control, and temperature setting. Wire type: Non-polar 2-wire
	IR receiver kit with wireless remote controller	UTY-LBTYH	Unit control is performed by wireless remote controller.

NOTE: Available functions may differ by the remote controller. For details, refer to the operation manual.

12-2. Others

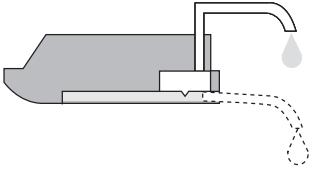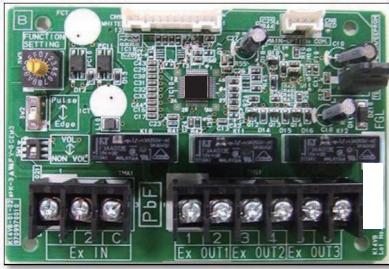Exterior	Part name	Model name	Summary
	Drain pump unit	UTR-DPB24T	Optional drain lift-up mechanism allows more flexible installation.
	Auxiliary pipe assembly	UTP-FX24A	For piping of upward direction only. <ul style="list-style-type: none">For liquid: 6.35 mm (1/4 in)For gas: 12.70 mm (1/2 in)
	Auxiliary pipe assembly	UTP-FX35A	For piping of upward direction only. <ul style="list-style-type: none">For liquid: 9.52 mm (3/8 in)For gas: 15.88 mm (5/8 in)
	External connect kit	UTY-XWZXZG	Use to connect with various peripheral devices and air conditioner PCB. For control output port.
	External input and output PCB	UTY-XCSX	Use to connect with external devices and air conditioner PCB.
	External input and output PCB box	UTZ-GXEA	For installing the External input and output PCB.
	Wireless LAN adapter	UTY-TFSXZ1	Remotely manage an air conditioning system using mobile devices such as smartphones and tablets. For connection indoor unit with UART interface.
	Modbus converter	UTY-VMSX	For connection between indoor unit with UART interface and a Modbus open network.

Exterior	Part name	Model name	Summary
	KNX converter	UTY-VKSX	For connection between indoor unit with UART interface and a KNX open network.
	Split system converter	UTY-VTGX	This converter is required when connecting single split system to VRF network system.
	Split system converter (AC power supply)	UTY-VTGXV	This converter is required when connecting single split system to VRF network system.
	External switch controller	UTY-TERX	Air conditioner switching can be controlled by connecting other external sensor switches.

NOTE: Combined use of following optional parts and Wireless LAN adapter (UTY-TFSXZ1) is not allowed.

- External input and output PCB (UTY-XCSX)
- Modbus converter
- KNX converter

Part 2. OUTDOOR UNIT

SINGLE TYPE:

**AOYG18KBTB
AOYG22KBTB
AOYG24KBTB
AOYG30KBTB
AOYG36KBTB
AOYG45KBTB**

1. Specifications

Type	Inverter heat pump			
Model name	AOYG18KBTB		AOYG22KBTB	
Power supply	230 V ~ 50 Hz			
Power supply intake	Outdoor unit			
Available voltage range	198—264 V			
Starting current	A	7.1	8.2	
Fan	Airflow rate	Cooling	2,160	
		Heating	1,830	
Type × Q'ty		Propeller × 1		
Motor output		49		
Sound pressure level *1		dB (A)	50	
Cooling		50	51	
Heating		50	51	
Sound power level		dB (A)	62	
Cooling		62	63	
Heating		62	63	
Heat exchanger type	Dimensions (H × W × D)		mm	
	Main1: 588 × 881 × 18.19			
	Main2: 588 × 851 × 18.19			
	Fin pitch		1.3	
	Rows × Stages		1 × 28	
	Pipe type		Copper	
Compressor	Type	Fin		
		Type (Material)	Aluminum	
Refrigerant	Motor output	Surface treatment		
		PC fin		
DC Twin rotary				
R32 (675)				
Factory charge		g	1,020	
1,250				
Refrigerant oil		Type	FW68S	
RmM68AF				
Amount		cm ³	350	
400				
Enclosure		Material	Steel sheet	
Color		Beige		
Approximate color of Munsell 10YR 7.5/1.0				
Dimensions		Net	632 × 799 × 290	
(H × W × D)		Gross	692 × 940 × 375	
Weight		Net	36	
Gross		kg	40	
38				
Connection pipe	Size	Liquid	Ø6.35 (Ø1/4)	
		Gas	Ø12.70 (Ø1/2)	
	Method		Flare	
	Pre-charge length		20	
Max. length		m	30	
Max. height difference			20	
25				
Operation range		°C	-15 to 46	
Cooling			-15 to 24	
Heating			PP	
Drain hose		Material		
Tip diameter		mm	Ø13.0 (I. D.), Ø16.0 to Ø16.8 (O. D.)	

NOTES:

- Specifications are based on the following conditions:
 - Cooling: Indoor temperature of 27 °CDB/19 °CWB, and outdoor temperature of 35 °CDB/24 °CWB.
 - Heating: Indoor temperature of 20 °CDB/15 °CWB, and outdoor temperature of 7 °CDB/6 °CWB.
 - Pipe length: 5 m, Height difference: 0 m. (Between outdoor unit and indoor unit.)
- Protective function might work when using it outside the operation range.
- *1: Sound pressure level
- Measured values in manufacturer's anechoic chamber.
- Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- This data is based on EN 14511 standard.

Type	Inverter heat pump			
Model name	AOYG24KBTB		AOYG30KBTB	
Power supply	230 V ~ 50 Hz			
Power supply intake	Outdoor unit			
Available voltage range	198—264 V			
Starting current	A	8.4	11.1	
Fan	Airflow rate	Cooling	2,700	3,750
		Heating	2,700	3,750
	Type × Q'ty		Propeller × 1	
Motor output	W	49	100	
Sound pressure level *1	Cooling	53	53	
		54	55	
Sound power level	Cooling	65	68	
		66	69	
Heat exchanger type	Dimensions (H × W × D)	mm	Main1: 672 × 881 × 18.19	Main1: 756 × 905 × 18.19
			Main2: 672 × 851 × 18.19	Main2: 756 × 905 × 18.19
			1.30	1.45
	Fin pitch		1 × 32	1 × 36
	Pipe type		Copper	
Compressor	Type		Aluminum	
		W	PC fin	Blue fin
Refrigerant	Type (Global warming potential)		DC Twin rotary	
		g	1,060	1,500
Refrigerant oil	Type		R32 (675)	
		Amount	1,250	1,900
Enclosure	Material		RmM68AF	FW68D
		Color	Steel sheet	
Dimensions (H × W × D)	Net	mm	Beige	Approximate color of Munsell 10YR 7.5/1.0
	Gross			
Weight	Net	kg	716 × 820 × 315	788 × 940 × 320
	Gross		776 × 961 × 450	966 × 1,027 × 445
Connection pipe	Size	Liquid	42	52
		Gas	46	60
	Method		Ø6.35 (Ø1/4) Ø12.70 (Ø1/2)	
	Pre-charge length	m	Flare	Ø9.52 (Ø3/8) Ø15.88 (Ø5/8)
	Max. length		20	30
Operation range	Max. height difference		30	50
	Cooling	°C	25	30
Drain hose	Heating		-15 to 46	
	Material		-15 to 24	
	Tip diameter	mm	PP	LDPE
NOTES:				
<ul style="list-style-type: none"> Specifications are based on the following conditions: <ul style="list-style-type: none"> Cooling: Indoor temperature of 27 °CDB/19 °CWB, and outdoor temperature of 35 °CDB/24 °CWB. Heating: Indoor temperature of 20 °CDB/15 °CWB, and outdoor temperature of 7 °CDB/6 °CWB. Pipe length: 5 m, Height difference: 0 m. (Between outdoor unit and indoor unit.) Protective function might work when using it outside the operation range. *1: Sound pressure level Measured values in manufacturer's anechoic chamber. Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here. This data is based on EN 14511 standard. 				

Type	Inverter heat pump			
Model name	AOYG36KBTB		AOYG45KBTB	
Power supply	230 V ~ 50 Hz			
Power supply intake	Outdoor unit			
Available voltage range	198—264 V			
Starting current	A	13.0	18.6	
Fan	Airflow rate	Cooling	3,750	4,450
		Heating	3,750	4,450
	Type × Q'ty		Propeller × 1	
Motor output		W	100	120
Sound pressure level *1		Cooling	55	57
		Heating	55	57
Sound power level		Cooling	70	71
		Heating	70	71
Heat exchanger type	Dimensions (H × W × D)		mm	Main1: 756 × 905 × 18.19 Main2: 756 × 905 × 18.19
	Fin pitch			1.45
	Rows × Stages			1 × 36
	Pipe type			Copper
	Fin	Type (Material)		Aluminum
		Surface treatment		Blue fin
Compressor	Type × Q'ty		DC Twin rotary × 1	
	Motor output	W	1,500	2,180
Refrigerant		Type (Global warming potential)	R32 (675)	
		Factory charge	g	1,900
Refrigerant oil		Type	FW68D	
		Amount	cm ³	600
Enclosure		Material	Steel sheet	
		Color	Beige Approximate color of Munsell 10YR 7.5/1.0	
Dimensions (H × W × D)	Net	mm	788 × 940 × 320	998 × 940 × 320
	Gross		966 × 1,027 × 445	1,176 × 1,027 × 445
Weight	Net	kg	52	67
	Gross		60	75
Connection pipe	Size	Liquid	Ø9.52 (Ø3/8)	
		Gas	Ø15.88 (Ø5/8)	
	Method		Flare	
	Pre-charge length		m	30
Operation range		°C		50
				30
Max. length		°C		-15 to 46
Max. height difference				-15 to 24
Drain hose		Material	LDPE	
		Tip diameter	mm	Ø13.0 (I. D.), Ø16.0 to Ø16.7 (O. D.)


NOTES:

- Specifications are based on the following conditions:
 - Cooling: Indoor temperature of 27 °CDB/19 °CWB, and outdoor temperature of 35 °CDB/24 °CWB.
 - Heating: Indoor temperature of 20 °CDB/15 °CWB, and outdoor temperature of 7 °CDB/6 °CWB.
 - Pipe length: 5 m, Height difference: 0 m. (Between outdoor unit and indoor unit.)
- Protective function might work when using it outside the operation range.
- *1: Sound pressure level
 - Measured values in manufacturer's anechoic chamber.
 - Because of the surrounding sound environment, the sound levels measured in actual installation conditions might be higher than the specified values here.
- This data is based on EN 14511 standard.

2. Dimensions



2-1. Models: AOYG18KBTB and AOYG22KBTB

Unit: mm

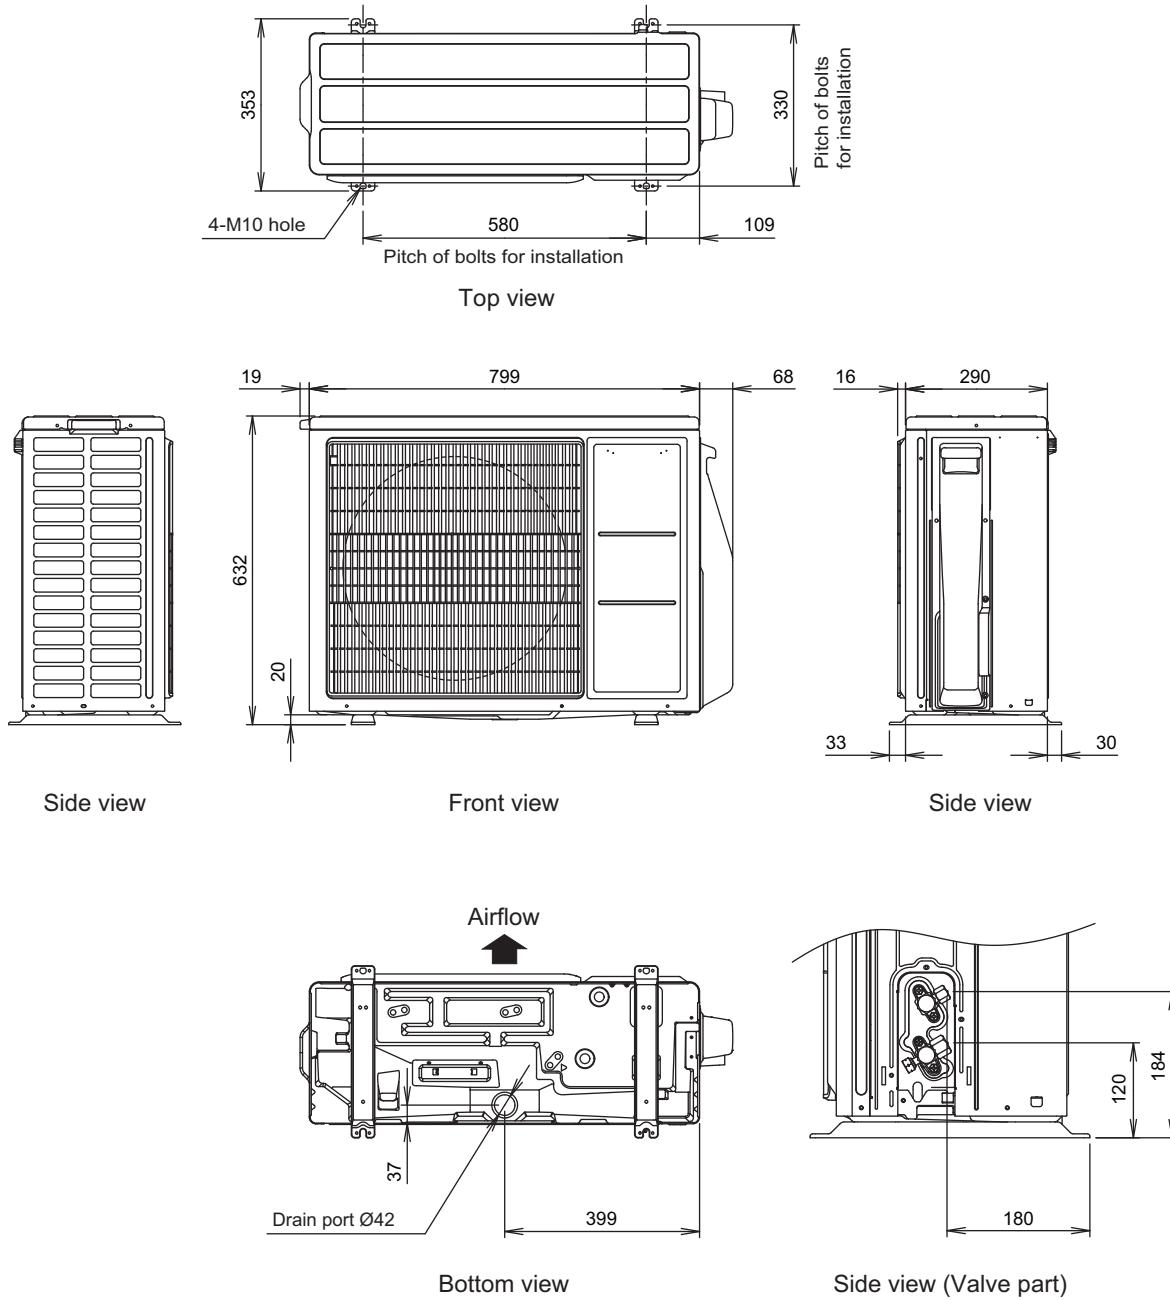


2-2. Model: AOYG24KBTB


Unit: mm

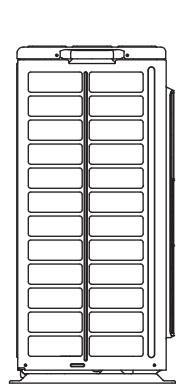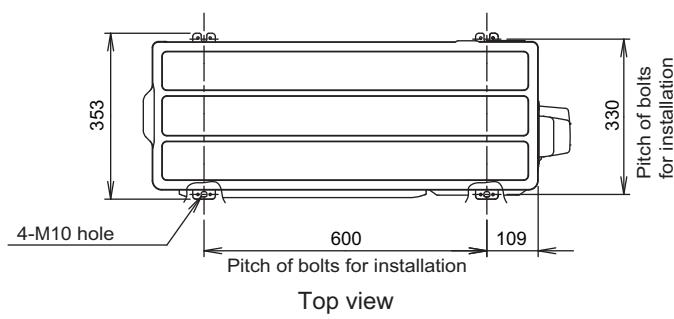OUTDOOR UNIT
AOYG18-45KBTBOUTDOOR UNIT
AOYG18-45KBTB


Side view

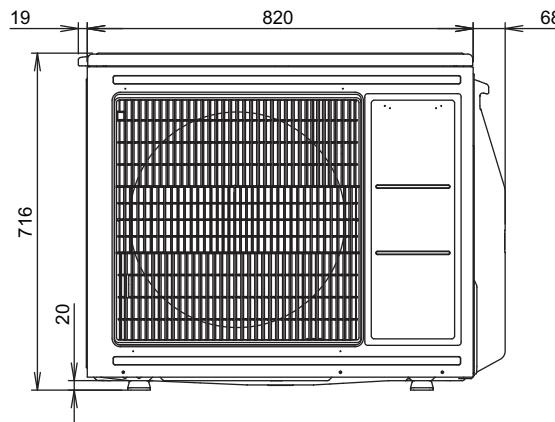


Front view

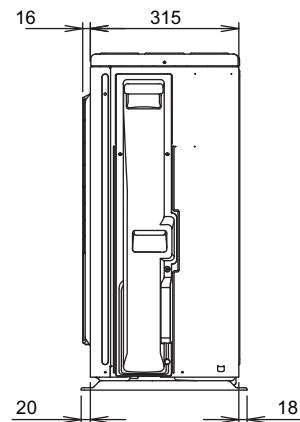

Side view

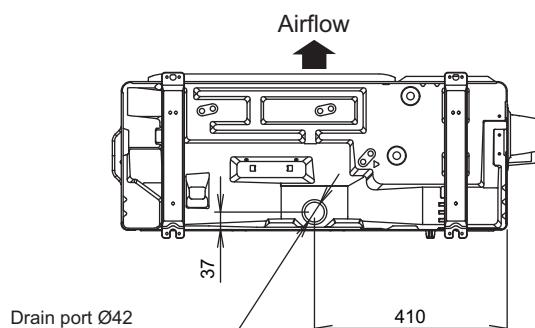






Bottom view

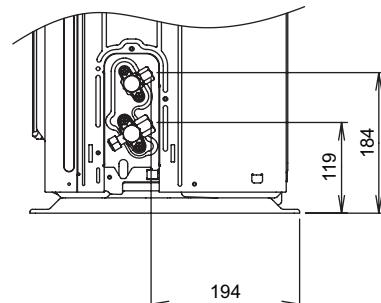

Side view (Valve part)


2-3. Models: AOYG30KBTB and AOYG36KBTB

Unit: mm

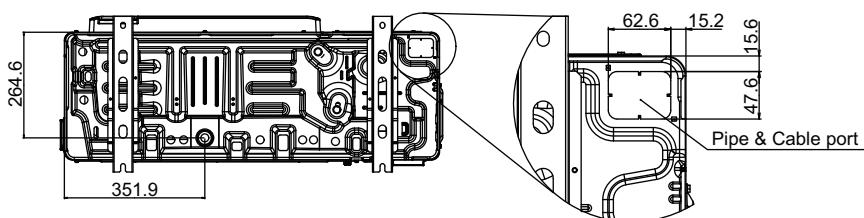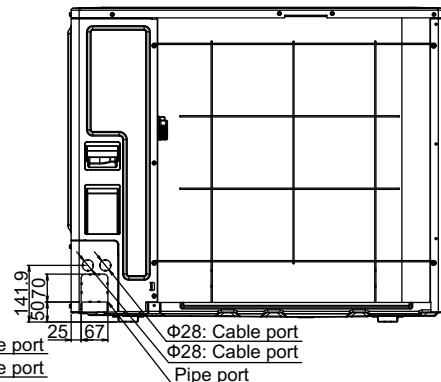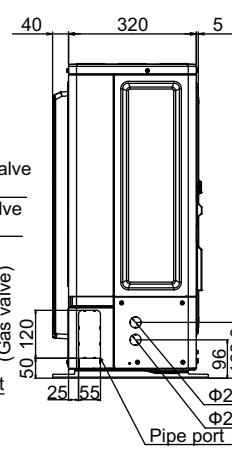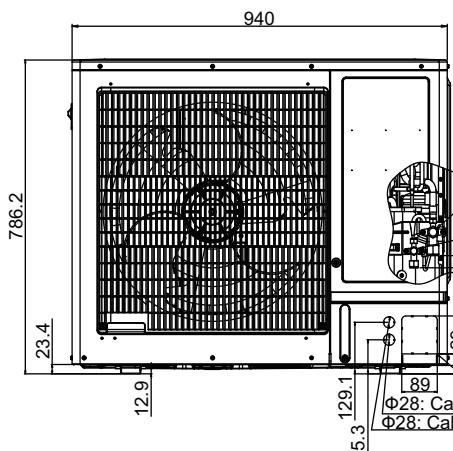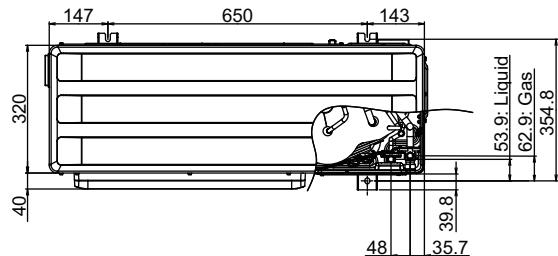


2-4. Model: AOYG45KBTB


Unit: mm

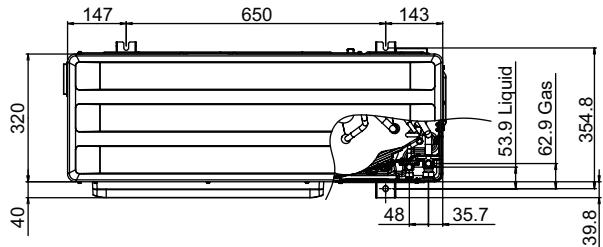OUTDOOR UNIT
AOYG18-45KBTBOUTDOOR UNIT
AOYG18-45KBTB


Top view

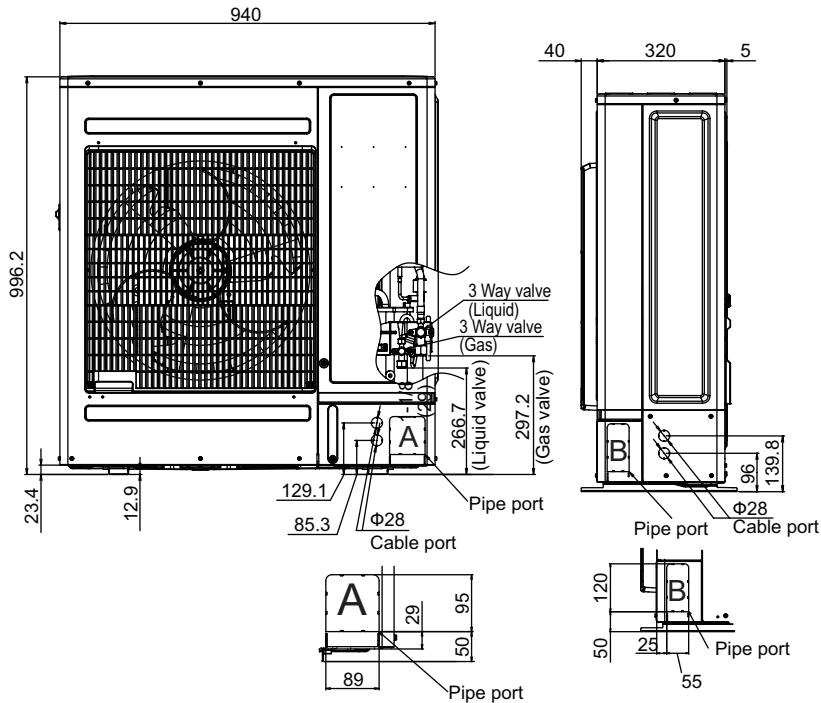


Front view

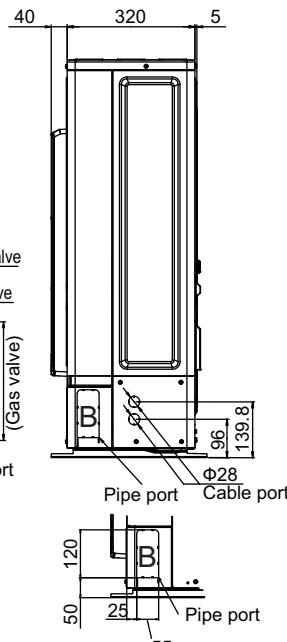

Side view

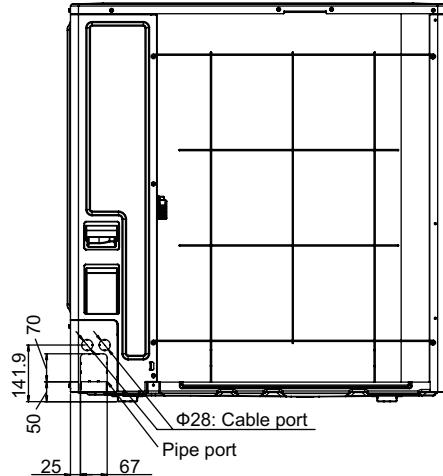

Rear view

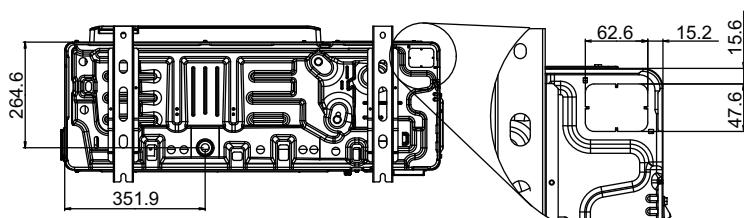

Bottom view

3. Installation space

3-1. Models: AOYG18KBTB, AOYG22KBTB, and AOYG24KBTB

■ Space requirement

Provide sufficient installation space for product safety.

⚠ CAUTION

Keep the space shown in the installation examples.


If the installation is not performed accordingly, it could cause a short circuit and result in a lack of operating performance.

● Single outdoor unit installation


- When the upper space is open:

Unit: mm


Obstacles at rear only

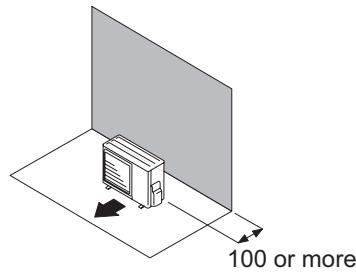


Obstacles at rear and sides

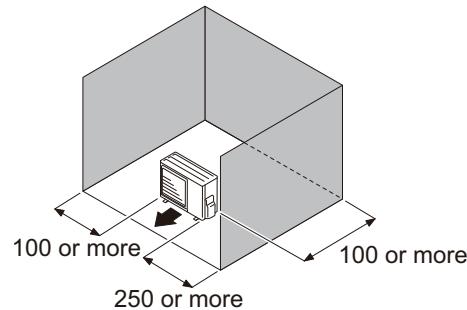

Obstacles at front

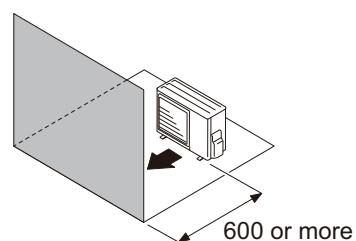


Obstacles at front and rear

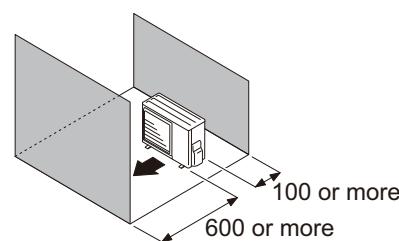


- When an obstruction in the upper space:

Unit: mm

Obstacles at rear and above

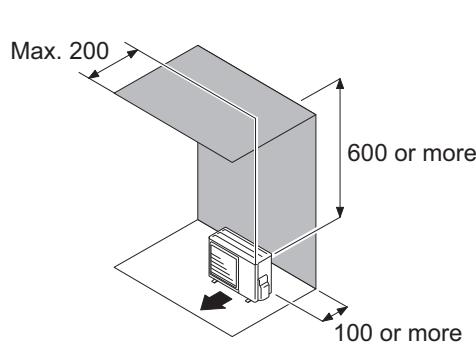

Obstacles at rear, sides, and above

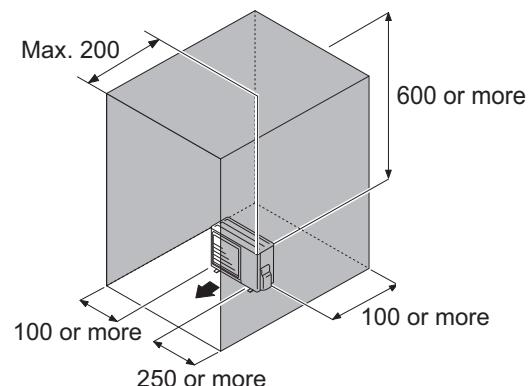


● Multiple outdoor unit installation

- Provide at least 250 mm of space between the outdoor units if multiple units are installed.
 - When routing the piping from the side of an outdoor unit, provide space for piping.
 - No more than 3 units must be installed side by side.
- When 4 units or more are arranged in a line, provide the space as shown in the following example **"When an obstruction in the upper space:"**.


- When the upper space is open:**

Unit: mm


Obstacles at rear only

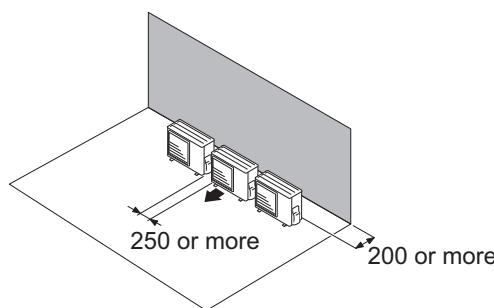

Obstacles at front only

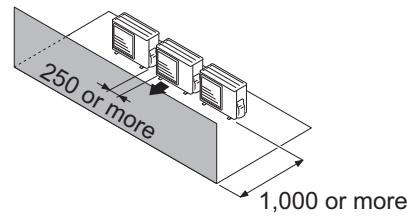


Obstacles at front and rear

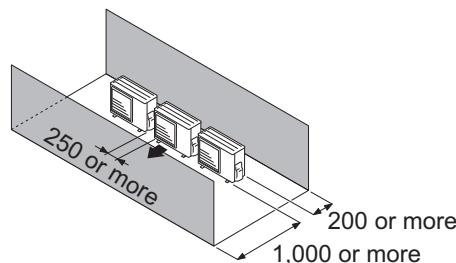

- When an obstruction in the upper space:**

Unit: mm


Obstacles at rear and above.

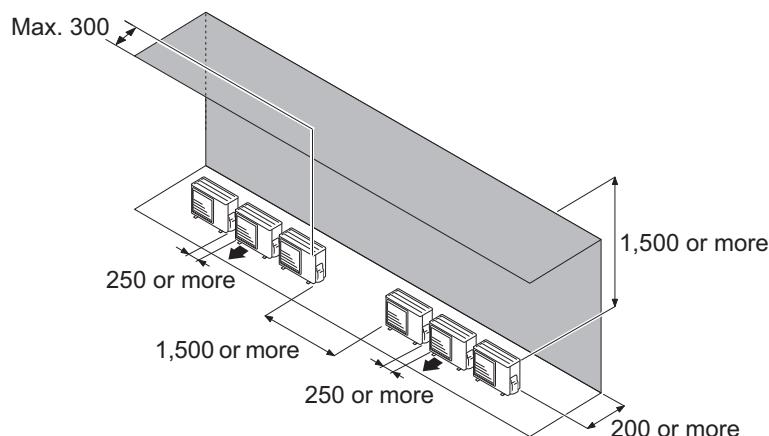



● Outdoor units installation in multi-row

Unit: mm

Single parallel unit arrangement

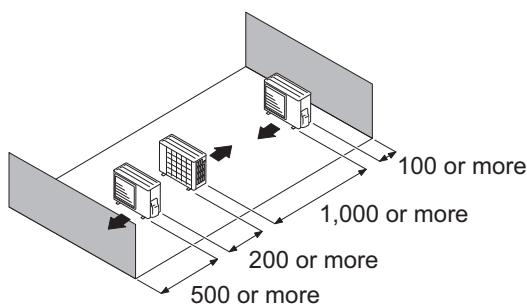


Multiple parallel unit arrangement

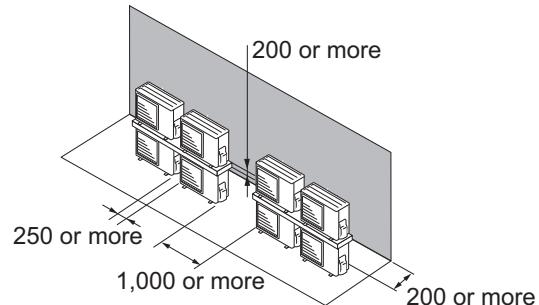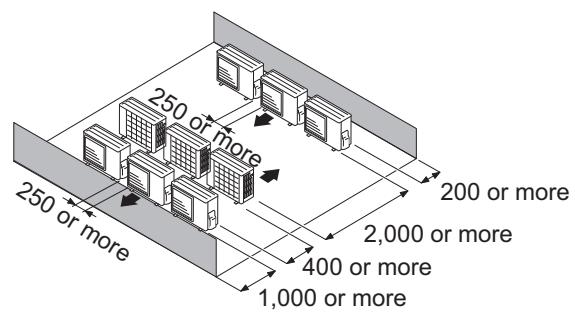**NOTES:**

- If the space is larger than stated above, the condition will be the same as when there is no obstacle.
- When installing the outdoor unit, be sure to open the front and left side to obtain better operation efficiency.

△ CAUTION

- Do not install the outdoor unit in two-stage where the drain water could freeze. Otherwise the drainage from the upper unit may form ice and cause a malfunction of the lower unit.
- When the outdoor temperature is 0 °C or less, do not use the accessory drain pipe and drain cap. If the drain pipe and drain cap are used, the drain water in the pipe may freeze in extremely cold climate. (For reverse cycle model only.)
- In area with heavy snowfall, if the inlet and outlet of the outdoor unit is blocked with snow, it might become difficult to get warm, and it is likely to cause product malfunction. Construct a canopy and a pedestal, or place the unit on a high stand that is locally installed.



3-2. Models: AOYG30KBTB, AOYG36KBTB, and AOYG45KBTB

■ Space requirement


Provide sufficient installation space for product safety.

● Single outdoor unit installation


- When the upper space is open:

Unit: mm


When there are obstacles at the rear only.

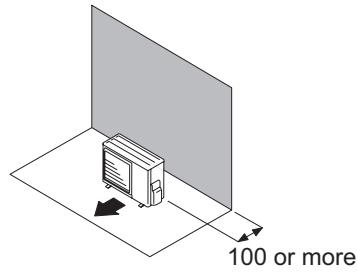


When there are obstacles at the rear and sides.

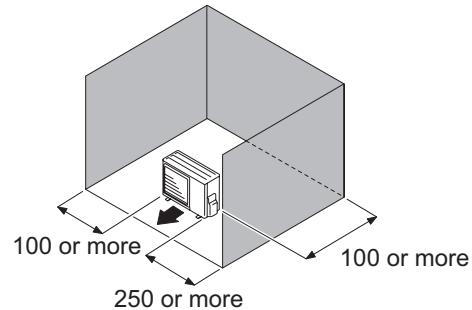

When there are obstacles at the front only.

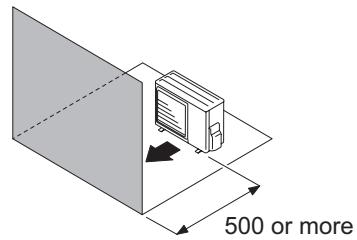


When there are obstacles at the front and rear.

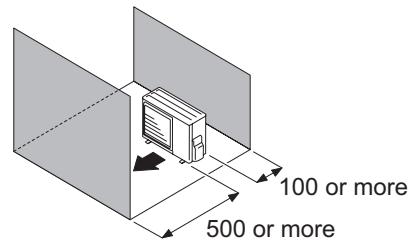


- When there is an obstruction in the upper space:

Unit: mm

When there are obstacles at the rear and above.

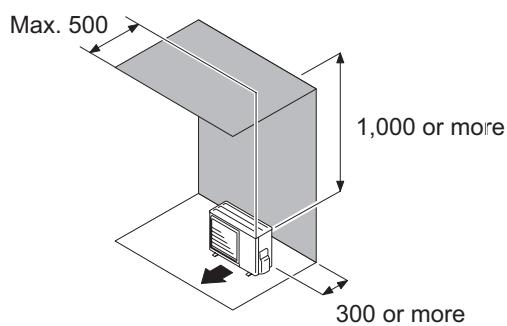

When there are obstacles at the rear, sides, and above.

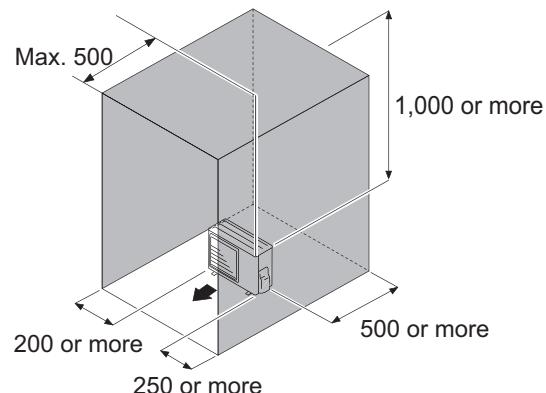


● Multiple outdoor unit installation


- When the upper space is open:

Unit: mm


When there are obstacles at the rear only.

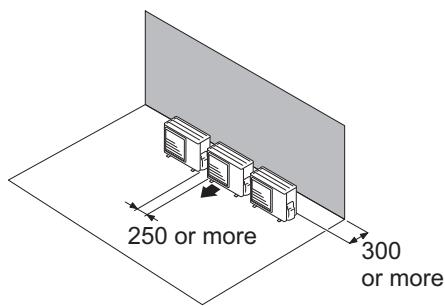

When there are obstacles at the front only.

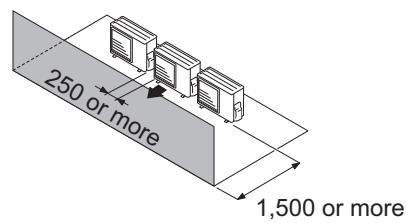


When there are obstacles at the front and rear.

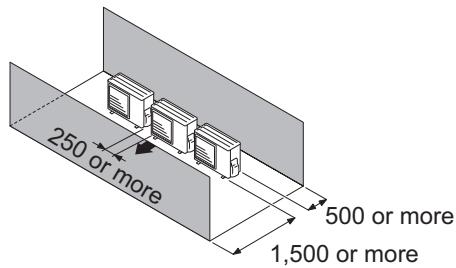

- When there is an obstruction in the upper space:

Unit: mm


When there are obstacles at the rear and above.

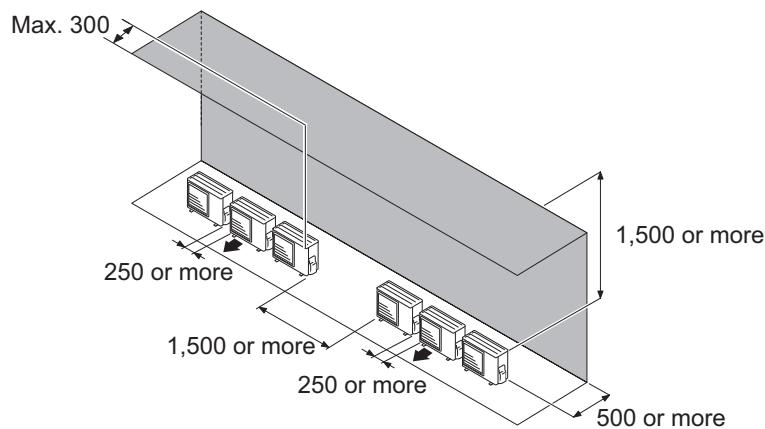



● Outdoor unit installation in multi-row

Unit: mm

Single parallel unit arrangement

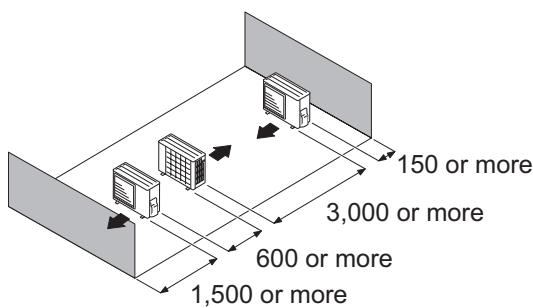


Multiple parallel unit arrangement

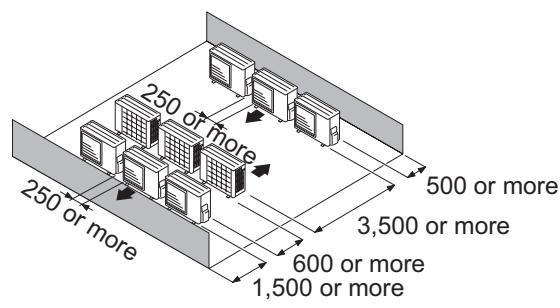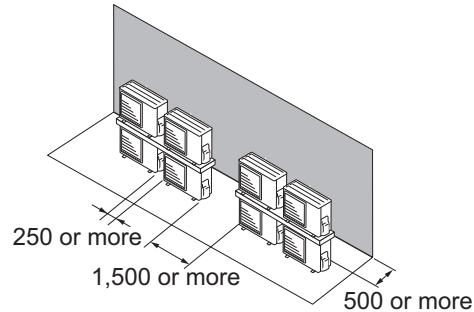OUTDOOR UNIT
AOYG18-45KBTB**NOTES:**

- If the space is larger than stated above, the condition will be the same as when there is no obstacle.
- Height above the floor level should be 50 mm or more.
- When installing the outdoor unit, be sure to open the front and left side to obtain better operation efficiency.


△ CAUTION

- Do not install the outdoor unit in two-stage where the drain water could freeze. Otherwise the drainage from the upper unit may form ice and cause a malfunction of the lower unit.
- When the outdoor temperature is 0 °C or less, do not use the accessory drain pipe and drain cap. If the drain pipe and drain cap are used, the drain water in the pipe may freeze in extremely cold climate. (For reverse cycle model only.)
- In area with heavy snowfall, if the inlet and outlet of the outdoor unit is blocked with snow, it might become difficult to get warm, and it is likely to cause product malfunction. Construct a canopy and a pedestal, or place the unit on a high stand that is locally installed.



4. Refrigerant circuit

4-1. Model: AOYG18KBTB

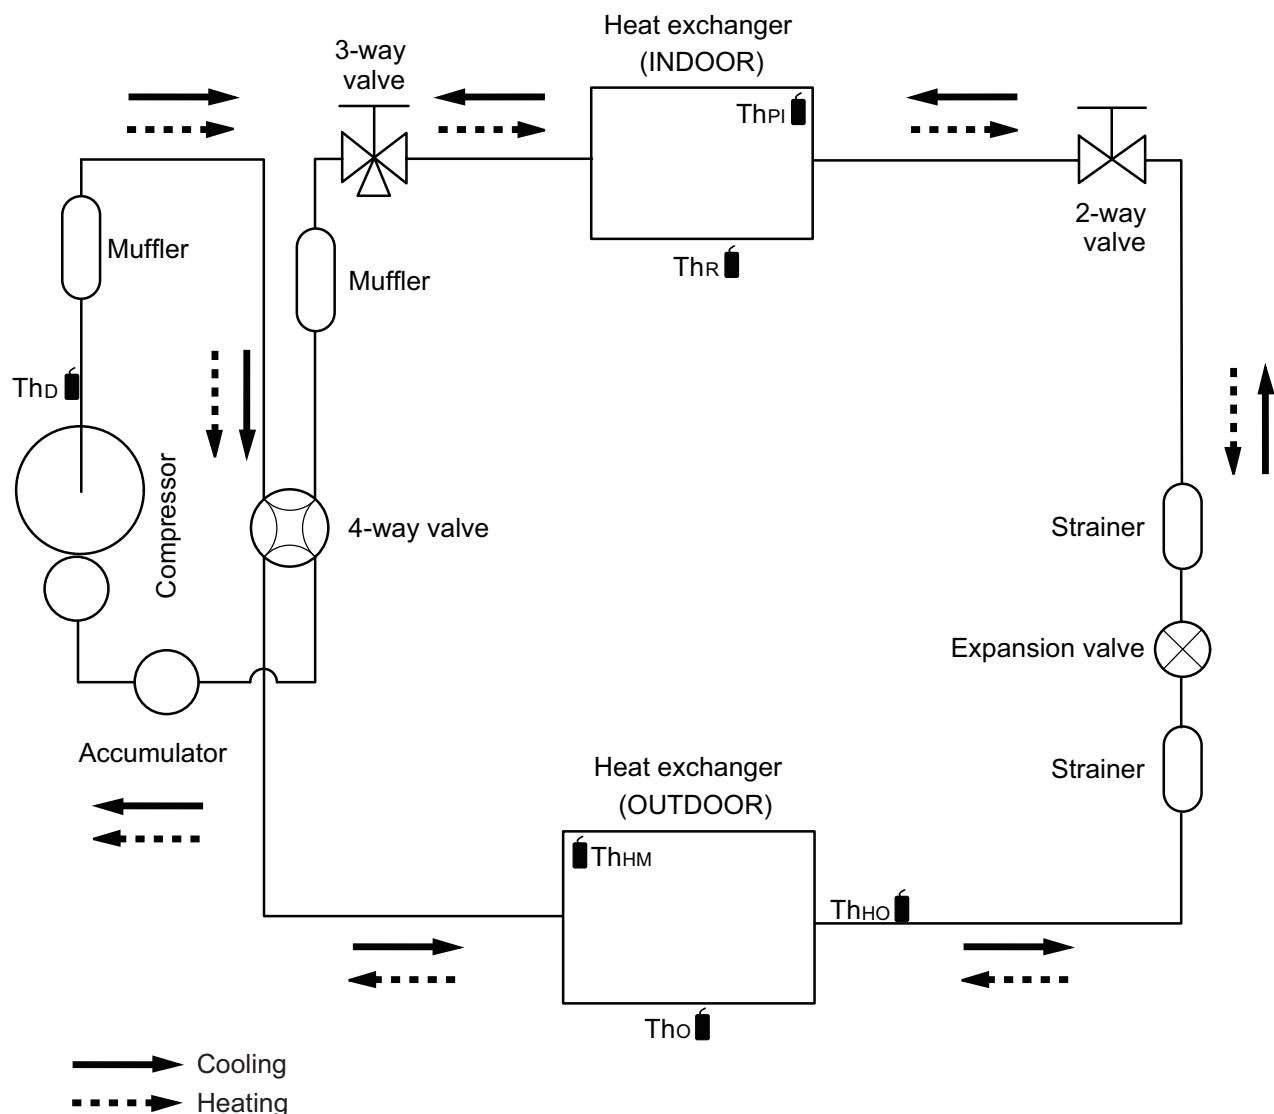

ThD : Thermistor (Discharge temperature)

Tho : Thermistor (Outdoor temperature)


ThHO : Thermistor (Heat exchanger out temperature)

ThHM : Thermistor (Heat exchanger middle temperature)

ThR : Thermistor (Room temperature)

ThPI : Thermistor (Pipe temperature)

4-2. Model: AOYG22KBTB

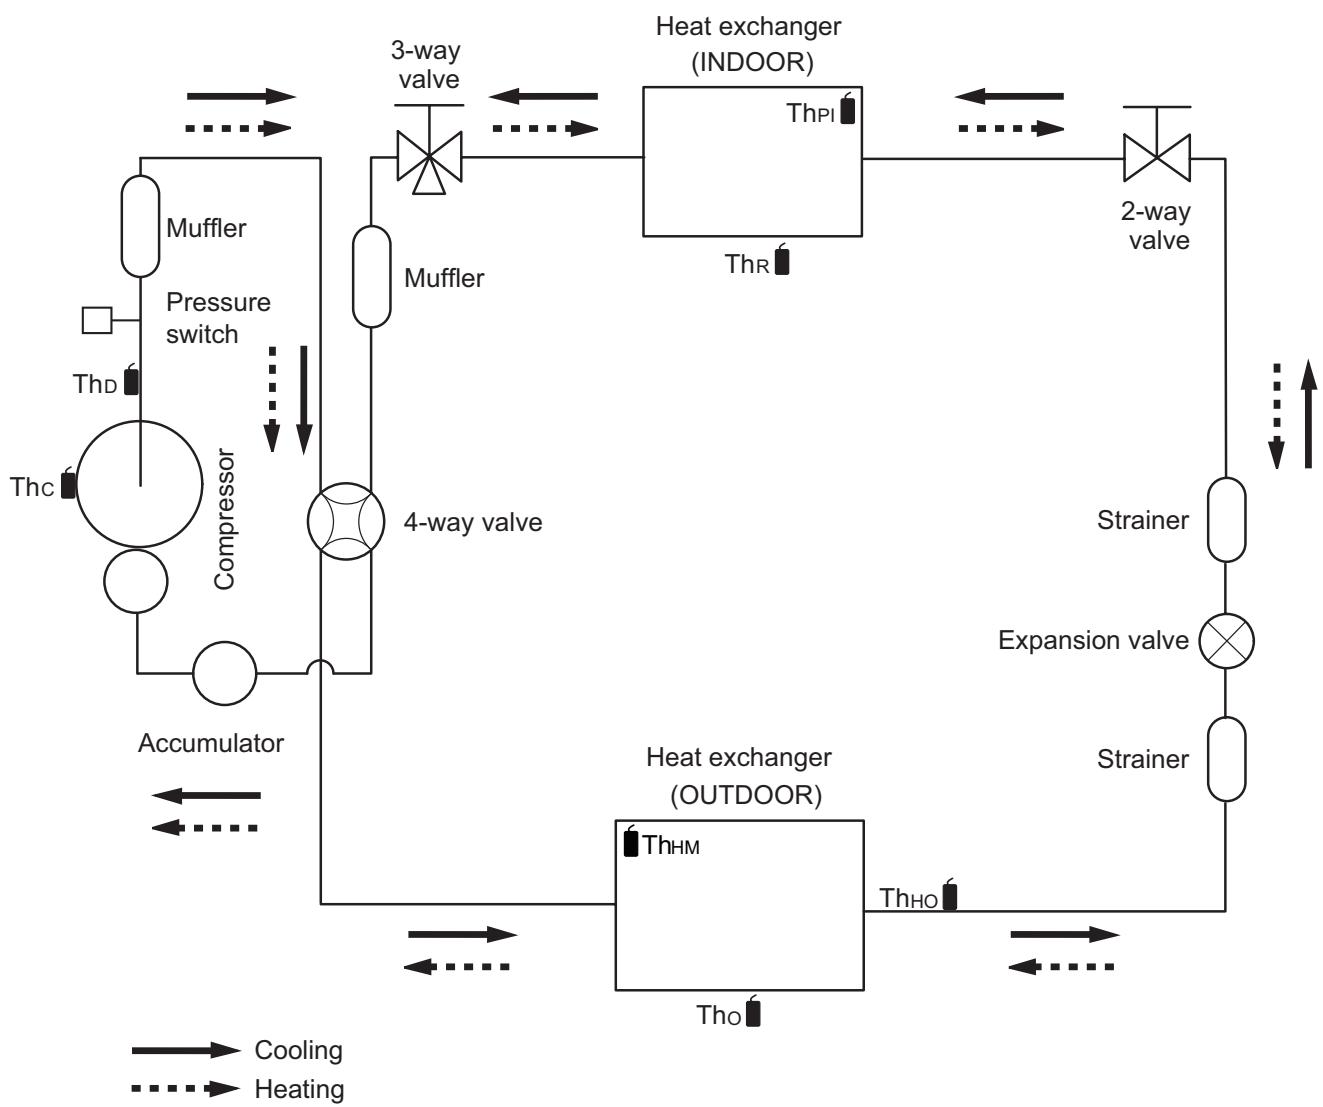OUTDOOR UNIT
AOYG18-45KBTBOUTDOOR UNIT
AOYG18-45KBTB

Thc : Thermistor (Compressor temperature)

Thd : Thermistor (Discharge temperature)

Tho : Thermistor (Outdoor temperature)


Thho : Thermistor (Heat exchanger out temperature)

Thhm : Thermistor (Heat exchanger middle temperature)

Thr : Thermistor (Room temperature)

Thpi : Thermistor (Pipe temperature)

4-3. Models: AOYG24KBTB and AOYG30KBTB

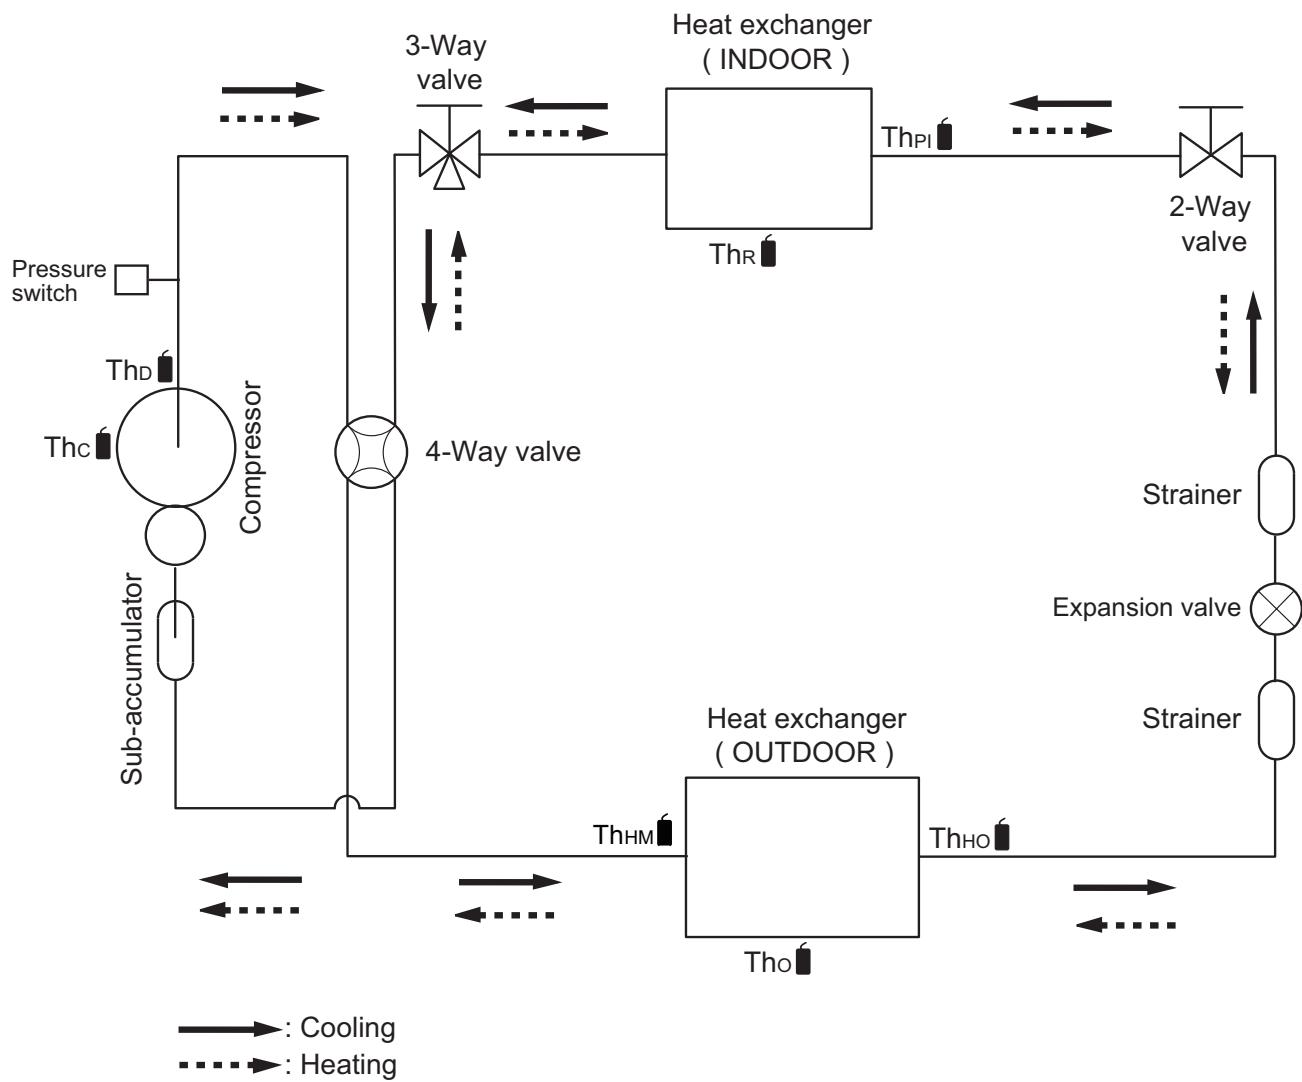OUTDOOR UNIT
AOYG18-45KBTBOUTDOOR UNIT
AOYG18-45KBTB

Thc : Thermistor (Compressor temperature)

Thd : Thermistor (Discharge temperature)

Th_{HM} : Thermistor (Heat Exchanger Med temperature)


Tho : Thermistor (Outdoor temperature)

Th_{HO} : Thermistor (Heat Exchanger Out temperature)

ThR : Thermistor (Room temperature)

ThPI : Thermistor (Pipe temperature)

4-4. Models: AOYG36KBTB and AOYG45KBTB

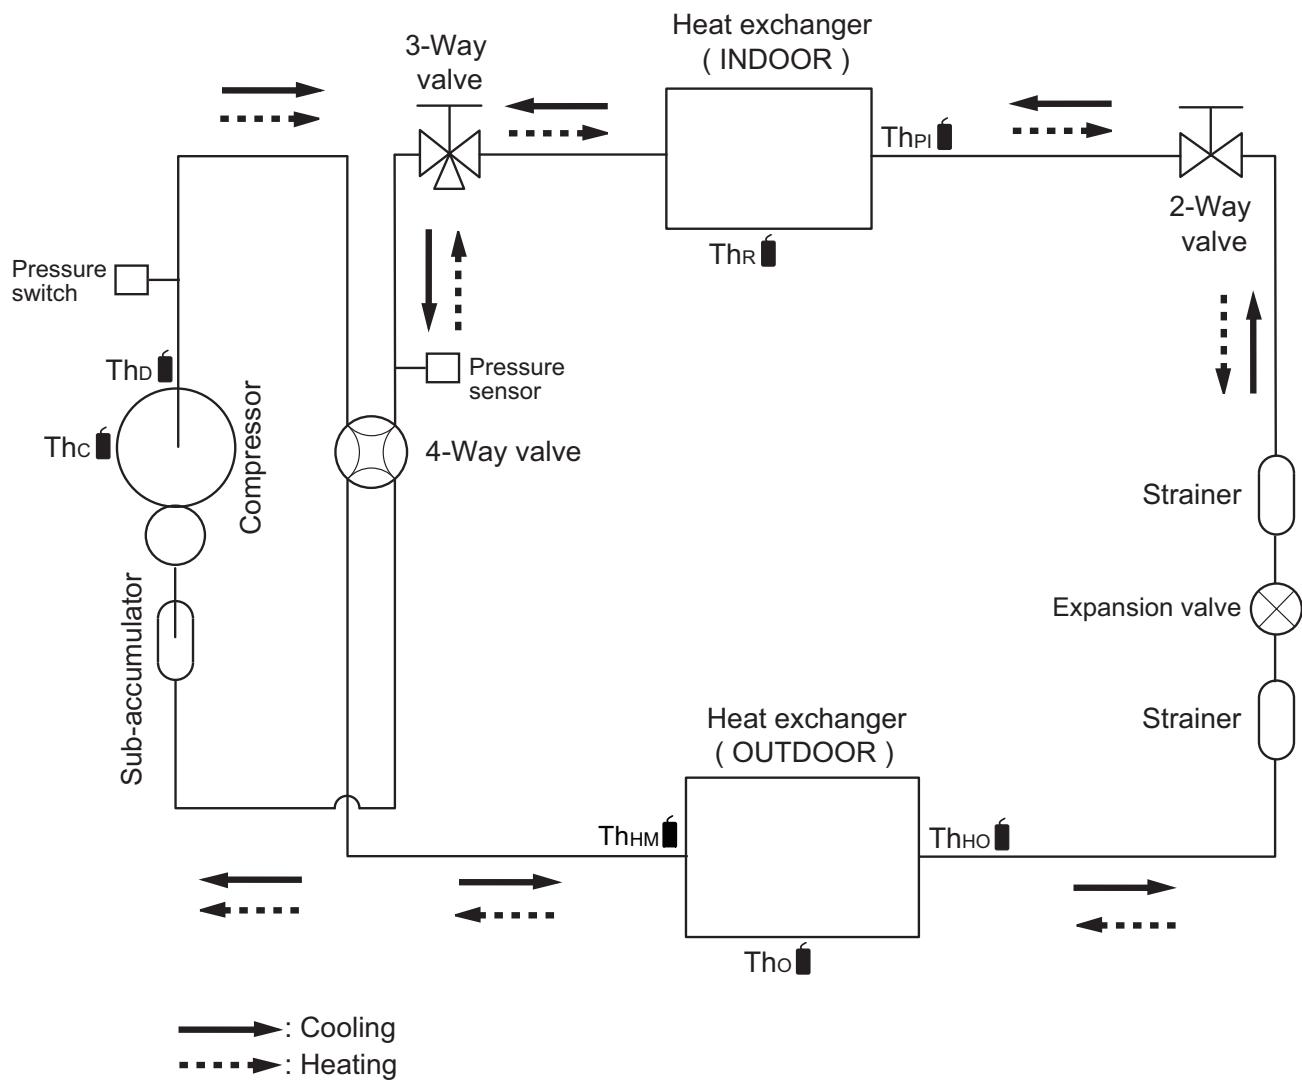OUTDOOR UNIT
AOYG18-45KBTBOUTDOOR UNIT
AOYG18-45KBTB

Thc : Thermistor (Compressor temperature)

Thd : Thermistor (Discharge temperature)

ThHM : Thermistor (Heat Exchanger Med temperature)

Tho : Thermistor (Outdoor temperature)


ThHO : Thermistor (Heat Exchanger Out temperature)

ThR : Thermistor (Room temperature)


ThPI : Thermistor (Pipe temperature)

5. Wiring diagrams

5-1. Model: AOYG18KBTB

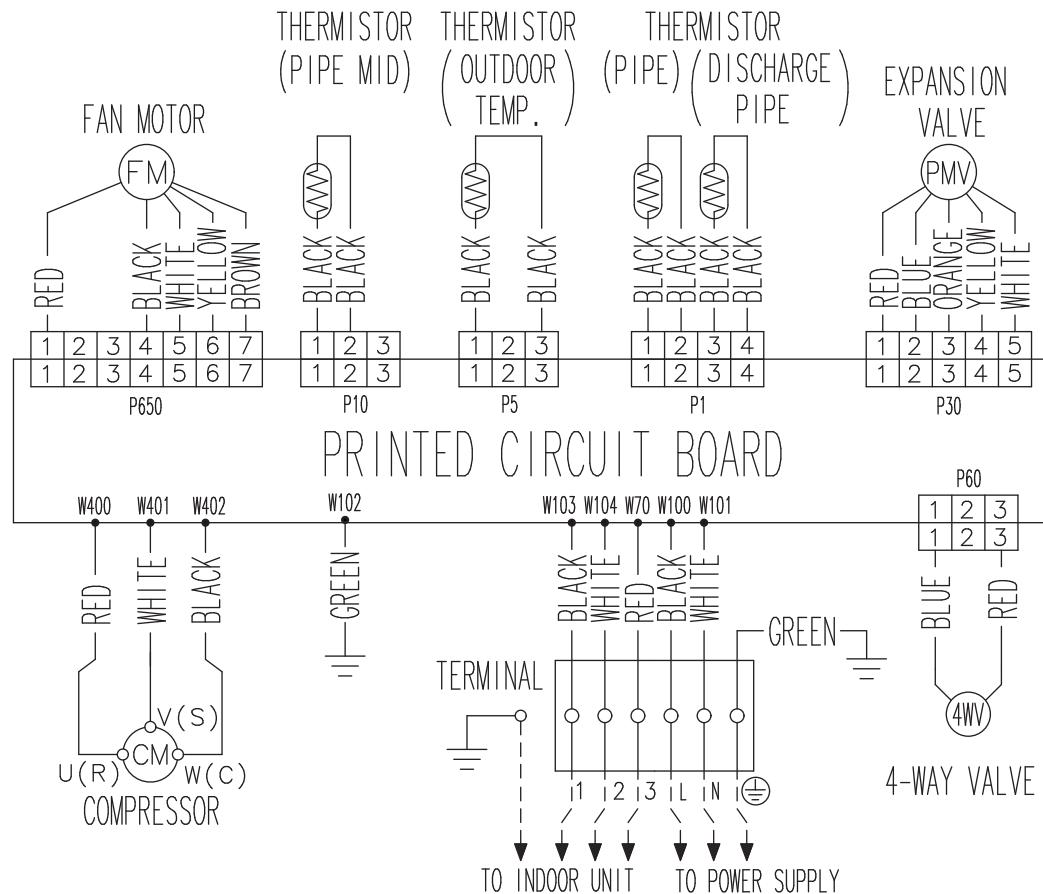


5-2. Models: AOYG22KBTB and AOYG24KBTB

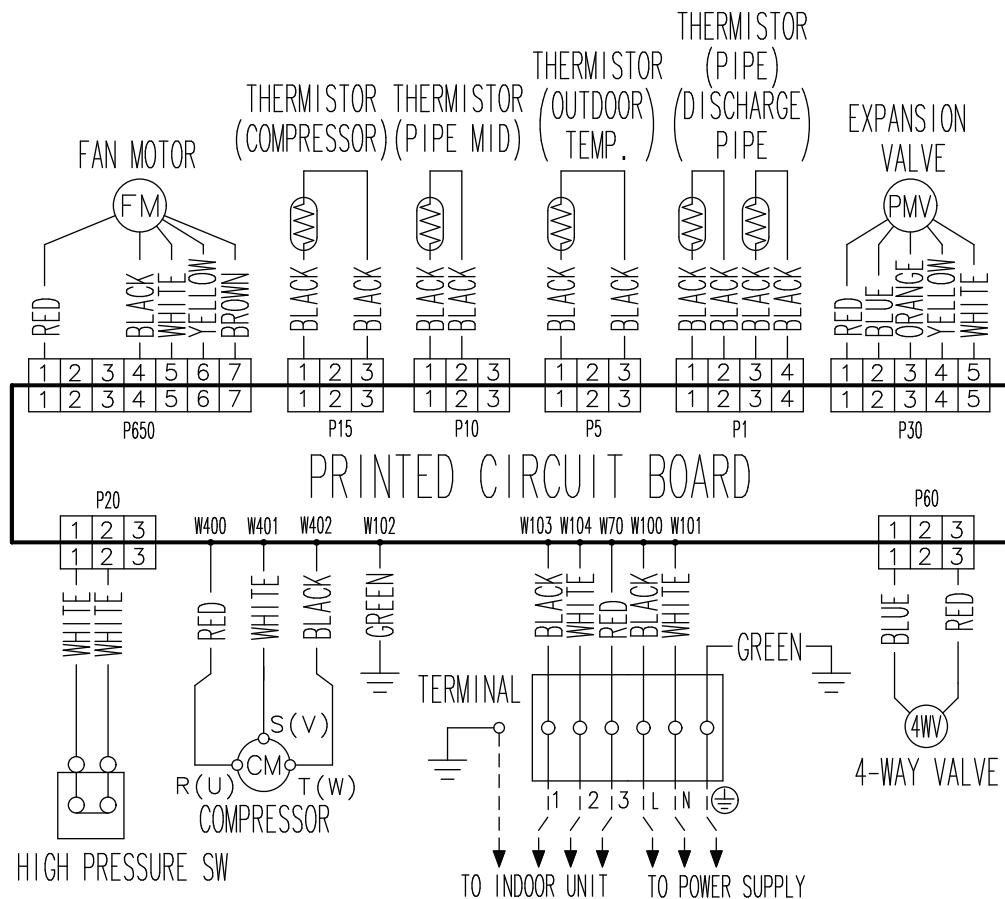


5-3. Model: AOYG30KBTB

OUTDOOR UNIT
AOYG18-45KBTB

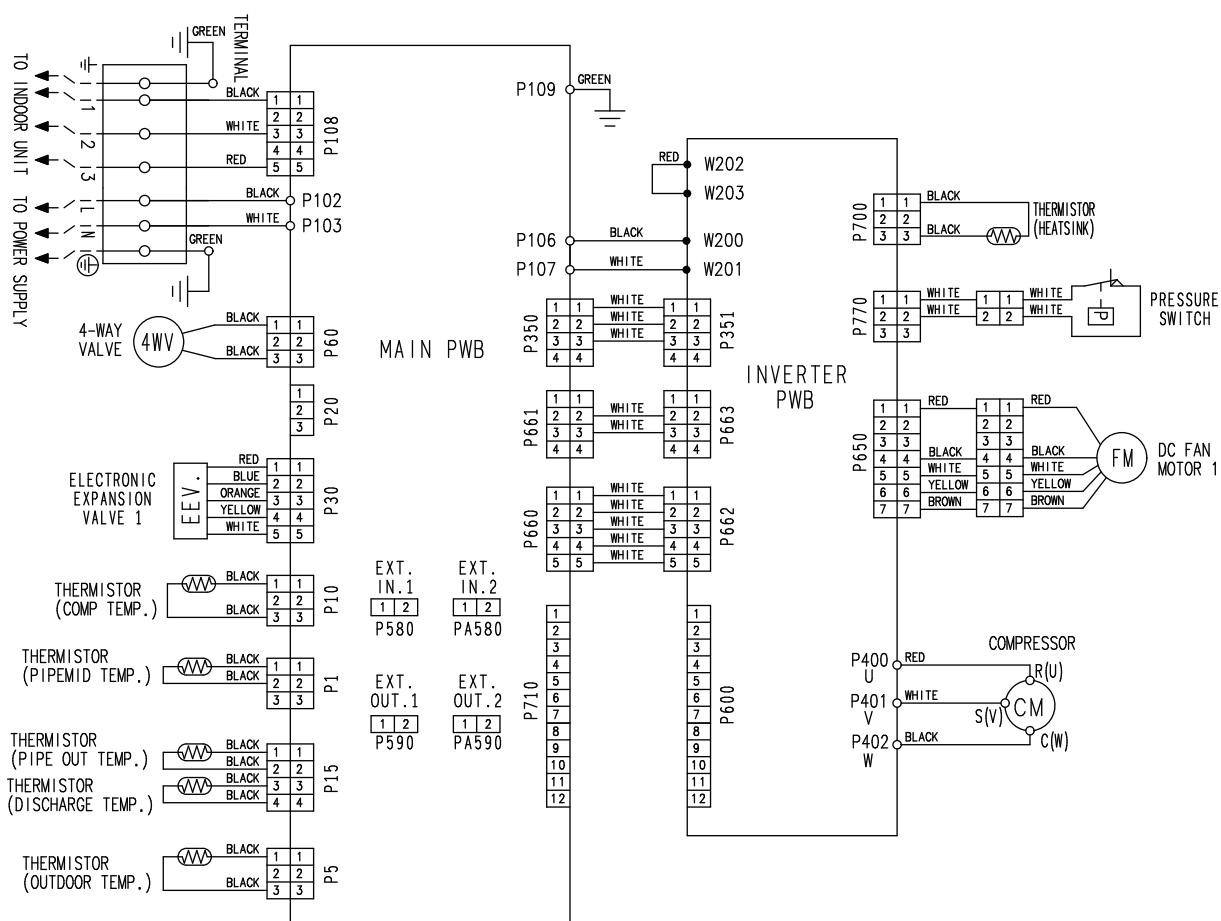


OUTDOOR UNIT
AOYG18-45KBTB


5-4. Model: AOYG36KBTB

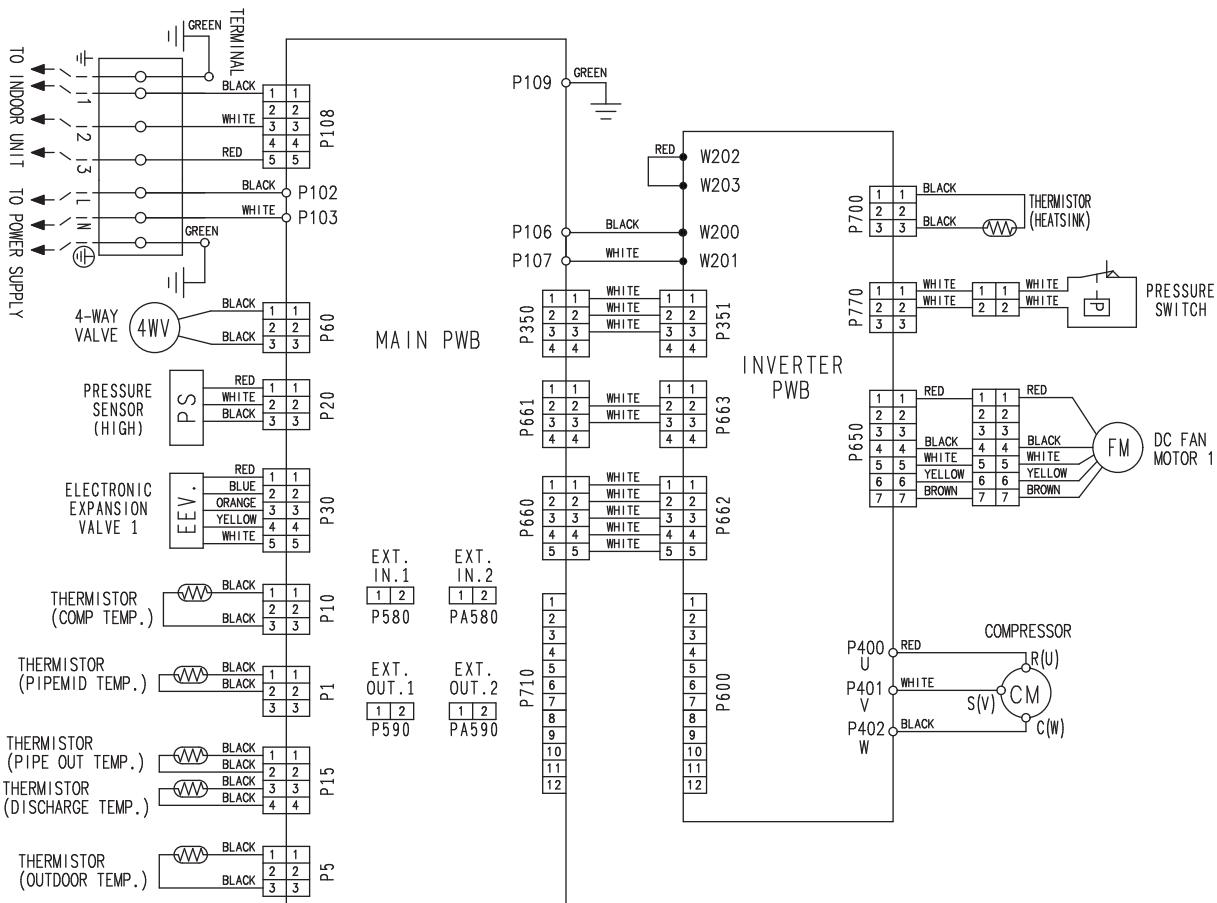

5-5. Model: AOYG45KBTB

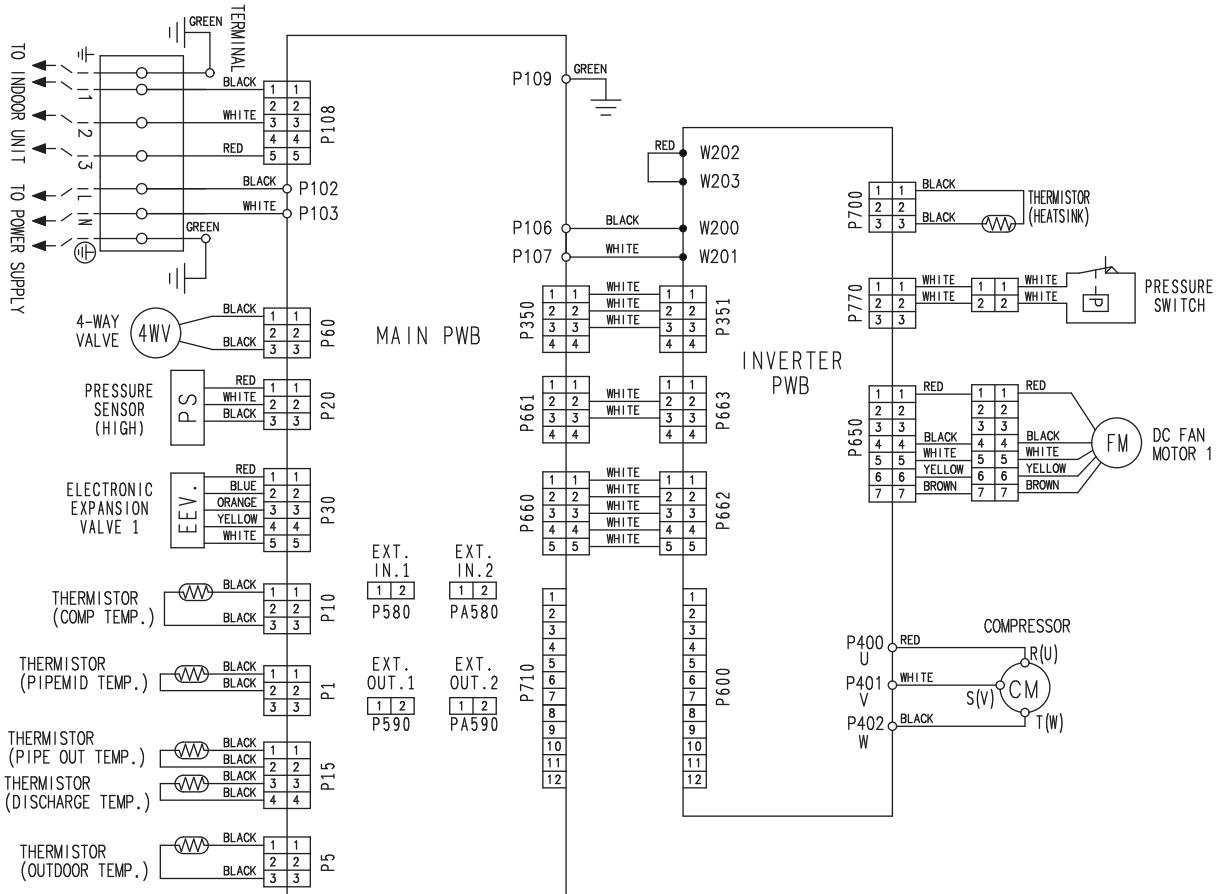

6. Capacity compensation rate for pipe length and height difference

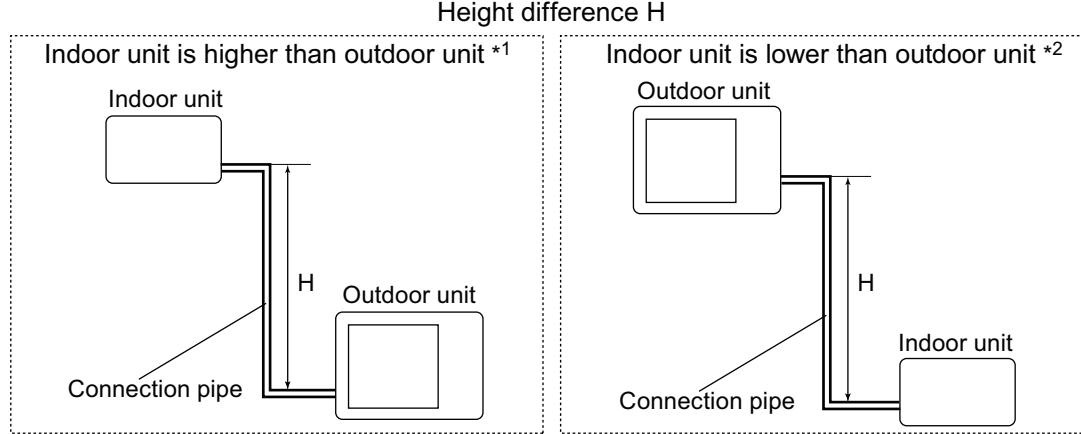

6-1. Model: AOGY18KBTB

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING		Pipe length (m)							
		5	7.5	10	15	20	25	30	
Height difference H (m)	Indoor unit is higher than outdoor unit * ¹	20	—	—	—	—	0.932	0.930	0.924
		15	—	—	—	0.953	0.950	0.947	0.941
		10	—	—	0.983	0.968	0.966	0.962	0.956
		7.5	—	0.988	0.987	0.972	0.970	0.966	0.960
		5	0.992	0.992	0.991	0.976	0.974	0.970	0.964
	Indoor unit is lower than outdoor unit * ²	0	1.000	1.000	0.999	0.984	0.982	0.978	0.972
		-5	1.000	1.000	0.999	0.984	0.982	0.978	0.972
		-7.5	—	1.000	0.999	0.984	0.982	0.978	0.972
		-10	—	—	0.999	0.984	0.982	0.978	0.972
		-15	—	—	—	0.984	0.982	0.978	0.972
		-20	—	—	—	—	0.982	0.978	0.972

HEATING		Pipe length (m)							
		5	7.5	10	15	20	25	30	
Height difference H (m)	Indoor unit is higher than outdoor unit * ¹	20	—	—	—	—	0.894	0.867	0.839
		15	—	—	—	0.920	0.894	0.867	0.839
		10	—	—	0.982	0.920	0.894	0.867	0.839
		7.5	—	1.000	0.982	0.920	0.894	0.867	0.839
		5	1.000	1.000	0.982	0.920	0.894	0.867	0.839
	Indoor unit is lower than outdoor unit * ²	0	1.000	1.000	0.982	0.920	0.894	0.867	0.839
		-5	0.995	0.995	0.977	0.916	0.889	0.862	0.836
		-7.5	—	0.993	0.975	0.913	0.887	0.860	0.832
		-10	—	—	0.972	0.911	0.885	0.858	0.830
		-15	—	—	—	0.902	0.876	0.849	0.821
		-20	—	—	—	—	0.863	0.834	0.809

6-2. Model: AOYG22KBTB

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING		Pipe length (m)						
		5	7.5	10	15	20	25	30
Height difference H (m)	Indoor unit is higher than outdoor unit * ¹	25	—	—	—	0.909	0.909	0.903
		15	—	—	—	0.953	0.950	0.947
		10	—	—	0.983	0.968	0.966	0.962
		7.5	—	0.988	0.987	0.972	0.970	0.966
		5	0.992	0.992	0.991	0.976	0.974	0.970
	Indoor unit is lower than outdoor unit * ²	0	1.000	1.000	0.999	0.984	0.982	0.978
		-5	1.000	1.000	0.999	0.984	0.982	0.978
		-7.5	—	1.000	0.999	0.984	0.982	0.978
		-10	—	—	0.999	0.984	0.982	0.978
		-15	—	—	—	0.984	0.982	0.978
		-25	—	—	—	—	0.982	0.978

HEATING		Pipe length (m)							
		5	7.5	10	15	20	25	30	
Height difference H (m)	Indoor unit is higher than outdoor unit * ¹	25	—	—	—	—	0.894	0.867	0.839
		15	—	—	—	0.920	0.894	0.867	0.839
		10	—	—	0.982	0.920	0.894	0.867	0.839
		7.5	—	1.000	0.982	0.920	0.894	0.867	0.839
		5	1.000	1.000	0.982	0.920	0.894	0.867	0.839
	Indoor unit is lower than outdoor unit * ²	0	1.000	1.000	0.982	0.920	0.894	0.867	0.839
		-5	0.995	0.995	0.977	0.916	0.889	0.862	0.836
		-7.5	—	0.993	0.975	0.913	0.887	0.860	0.832
		-10	—	—	0.972	0.911	0.885	0.858	0.830
		-15	—	—	—	0.902	0.876	0.849	0.821
		-25	—	—	—	—	0.851	0.821	0.795

6-3. Model: AOYG24KBTB

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING		Pipe length (m)						
		5	7.5	10	15	20	25	30
Height difference H (m) Indoor unit is higher than outdoor unit *1	25	—	—	—	—	—	0.893	0.877
	20	—	—	—	—	0.917	0.900	0.885
	10	—	—	0.966	0.947	0.932	0.914	0.899
	7.5	—	0.979	0.970	0.951	0.936	0.918	0.903
	5	0.992	0.983	0.974	0.955	0.939	0.922	0.906
	0	1.000	0.991	0.981	0.963	0.946	0.930	0.914
	-5	1.000	0.991	0.981	0.963	0.946	0.930	0.914
	-7.5	—	0.991	0.981	0.963	0.946	0.930	0.914
	-10	—	—	0.981	0.963	0.946	0.930	0.914
	-20	—	—	—	—	0.946	0.930	0.914
	-25	—	—	—	—	—	0.930	0.914

HEATING		Pipe length (m)						
		5	7.5	10	15	20	25	30
Height difference H (m) Indoor unit is higher than outdoor unit *1	25	—	—	—	—	—	0.871	0.855
	20	—	—	—	—	0.887	0.871	0.855
	10	—	—	0.952	0.903	0.887	0.871	0.855
	7.5	—	0.976	0.952	0.903	0.887	0.871	0.855
	5	1.000	0.976	0.952	0.903	0.887	0.871	0.855
	0	1.000	0.976	0.952	0.903	0.887	0.871	0.855
	-5	0.995	0.971	0.947	0.899	0.883	0.866	0.850
	-7.5	—	0.969	0.945	0.897	0.881	0.865	0.849
	-10	—	—	0.942	0.894	0.879	0.863	0.847
	-20	—	—	—	—	0.869	0.854	0.838
	-25	—	—	—	—	—	0.850	0.834

6-4. Model: AOYG30KBTB

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING		Pipe length (m)						
		5	7.5	10	20	30	40	50
Height difference H (m) Indoor unit is higher than outdoor unit *1	30	—	—	—	—	0.926	0.916	0.906
	20	—	—	—	0.953	0.942	0.931	0.920
	10	—	—	0.979	0.968	0.958	0.946	0.936
	7.5	—	0.988	0.983	0.972	0.961	0.951	0.939
	5	0.992	0.992	0.987	0.976	0.965	0.954	0.943
	0	1.000	1.000	0.995	0.984	0.973	0.962	0.951
	-5	1.000	1.000	0.995	0.984	0.973	0.962	0.951
	-7.5	—	1.000	0.995	0.984	0.973	0.962	0.951
	-10	—	—	0.995	0.984	0.973	0.962	0.951
	-20	—	—	—	0.984	0.973	0.962	0.951
	-30	—	—	—	—	0.973	0.962	0.951

HEATING		Pipe length (m)						
		5	7.5	10	20	30	40	50
Height difference H (m) Indoor unit is higher than outdoor unit *1	30	—	—	—	—	0.931	0.914	0.899
	20	—	—	—	0.954	0.931	0.914	0.899
	10	—	—	0.990	0.954	0.931	0.914	0.899
	7.5	—	1.000	0.990	0.954	0.931	0.914	0.899
	5	1.000	1.000	0.990	0.954	0.931	0.914	0.899
	0	1.000	1.000	0.990	0.954	0.931	0.914	0.899
	-5	0.995	0.995	0.986	0.949	0.926	0.909	0.895
	-7.5	—	0.993	0.983	0.946	0.924	0.907	0.892
	-10	—	—	0.981	0.944	0.921	0.904	0.890
	-20	—	—	—	0.935	0.912	0.895	0.881
	-30	—	—	—	—	0.903	0.886	0.872

6-5. Model: AOYG36KBTB

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING		Pipe length (m)						
		5	7.5	10	20	30	40	50
Height difference H (m) Indoor unit is higher than outdoor unit *1	30	—	—	—	—	0.902	0.882	0.862
	20	—	—	—	0.938	0.917	0.897	0.876
	10	—	—	0.973	0.953	0.933	0.912	0.891
	7.5	—	0.988	0.977	0.957	0.936	0.916	0.895
	5	0.992	0.992	0.981	0.961	0.940	0.919	0.898
	0	1.000	1.000	0.989	0.968	0.947	0.926	0.905
	-5	1.000	1.000	0.989	0.968	0.947	0.926	0.905
	-7.5	—	1.000	0.989	0.968	0.947	0.926	0.905
	-10	—	—	0.989	0.968	0.947	0.926	0.905
	-20	—	—	—	0.968	0.947	0.926	0.905
	-30	—	—	—	—	0.947	0.926	0.905

HEATING		Pipe length (m)						
		5	7.5	10	20	30	40	50
Height difference H (m) Indoor unit is higher than outdoor unit *1	30	—	—	—	—	0.978	0.968	0.958
	20	—	—	—	0.988	0.978	0.968	0.958
	10	—	—	0.998	0.988	0.978	0.968	0.958
	7.5	—	1.000	0.998	0.988	0.978	0.968	0.958
	5	1.000	1.000	0.998	0.988	0.978	0.968	0.958
	0	1.000	1.000	0.998	0.988	0.978	0.968	0.958
	-5	0.995	0.995	0.993	0.983	0.973	0.963	0.953
	-7.5	—	0.993	0.991	0.981	0.971	0.961	0.951
	-10	—	—	0.988	0.978	0.968	0.958	0.948
	-20	—	—	—	0.968	0.958	0.949	0.939
	-30	—	—	—	—	0.949	0.939	0.929

6-6. Model: AOYG45KBTB

NOTE: Values mentioned in the table are calculated based on the maximum capacity.

COOLING		Pipe length (m)						
		5	7.5	10	20	30	40	50
Height difference H (m) Indoor unit is higher than outdoor unit *1	30	—	—	—	—	0.900	0.879	0.858
	20	—	—	—	0.937	0.915	0.894	0.872
	10	—	—	0.973	0.952	0.931	0.908	0.887
	7.5	—	0.988	0.977	0.956	0.934	0.913	0.891
	5	0.992	0.992	0.981	0.960	0.938	0.916	0.894
	0	1.000	1.000	0.989	0.967	0.945	0.923	0.901
	-5	1.000	1.000	0.989	0.967	0.945	0.923	0.901
	-7.5	—	1.000	0.989	0.967	0.945	0.923	0.901
	-10	—	—	0.989	0.967	0.945	0.923	0.901
	-20	—	—	—	0.967	0.945	0.923	0.901
	-30	—	—	—	—	0.945	0.923	0.901

HEATING		Pipe length (m)						
		5	7.5	10	20	30	40	50
Height difference H (m) Indoor unit is higher than outdoor unit *1	30	—	—	—	—	0.978	0.968	0.958
	20	—	—	—	0.988	0.978	0.968	0.958
	10	—	—	0.998	0.988	0.978	0.968	0.958
	7.5	—	1.000	0.998	0.988	0.978	0.968	0.958
	5	1.000	1.000	0.998	0.988	0.978	0.968	0.958
	0	1.000	1.000	0.998	0.988	0.978	0.968	0.958
	-5	0.995	0.995	0.993	0.983	0.973	0.963	0.953
	-7.5	—	0.993	0.991	0.981	0.971	0.961	0.951
	-10	—	—	0.988	0.978	0.968	0.958	0.948
	-20	—	—	—	0.968	0.958	0.949	0.939
	-30	—	—	—	—	0.949	0.939	0.929

7. Additional charge calculation

7-1. Model: AOYG18KBTB

Refrigerant type	R32
Refrigerant amount	1,020

■ Refrigerant charge

Total pipe length	m	20 or less	25	30 (Max.)	20 g/m
Additional charge	g	0	100	200	

7-2. Models: AOYG22KBTB and AOYG24KBTB

Refrigerant type	R32
Refrigerant amount	1,250

■ Refrigerant charge

Total pipe length	m	20 or less	25	30 (Max.)	20 g/m
Additional charge	g	0	100	200	

7-3. Models: AOYG30KBTB and AOYG36KBTB

Refrigerant type	R32
Refrigerant amount	1,900

■ Refrigerant charge

Total pipe length	m	30 or less	40	50 (Max.)	40 g/m
Additional charge amount	g	0	400	800	

7-4. Model: AOYG45KBTB

Refrigerant type	R32
Refrigerant amount	2,700

■ Refrigerant charge

Total pipe length	m	30 or less	40	50 (Max.)	40 g/m
Additional charge amount	g	0	400	800	

8. Airflow

8-1. Model: AOYG18KBTB

● Cooling

m ³ /h	2,160
l/s	600
CFM	1,271

● Heating

m ³ /h	1,830
l/s	508
CFM	1,077

8-2. Model: AOYG22KBTB

● Cooling

m ³ /h	2,240
l/s	622
CFM	1,318

● Heating

m ³ /h	1,960
l/s	544
CFM	1,154

8-3. Model: AOYG24KBTB

● Cooling

m ³ /h	2,700
l/s	750
CFM	1,589

● Heating

m ³ /h	2,700
l/s	750
CFM	1,589

8-4. Models: AOYG30KBTB and AOYG36KBTBOUTDOOR UNIT
AOYG18-45KBTBOUTDOOR UNIT
AOYG18-45KBTB**● Cooling**

m ³ /h	3,750
l/s	1,042
CFM	2,207

● Heating

m ³ /h	3,750
l/s	1,042
CFM	2,207

8-5. Model: AOYG45KBTB**● Cooling**

m ³ /h	4,450
l/s	1,236
CFM	2,619

● Heating


m ³ /h	4,450
l/s	1,236
CFM	2,619

9. Operation noise (sound pressure)


9-1. Noise level curve

■ Model: AOYG18KBTB

● Cooling

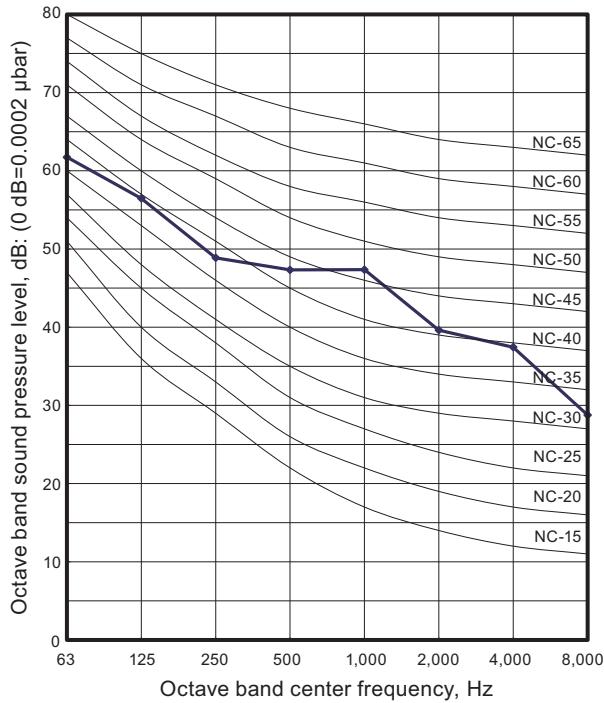


● Heating

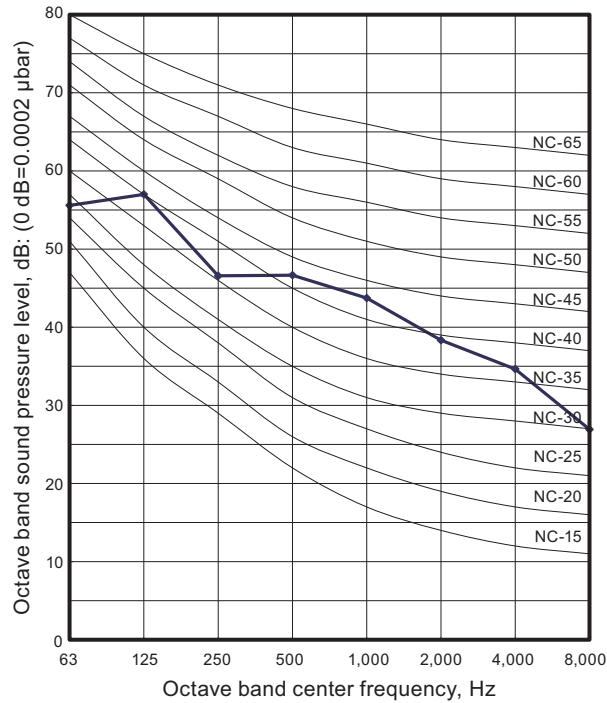


■ Model: AOYG22KBTB

● Cooling

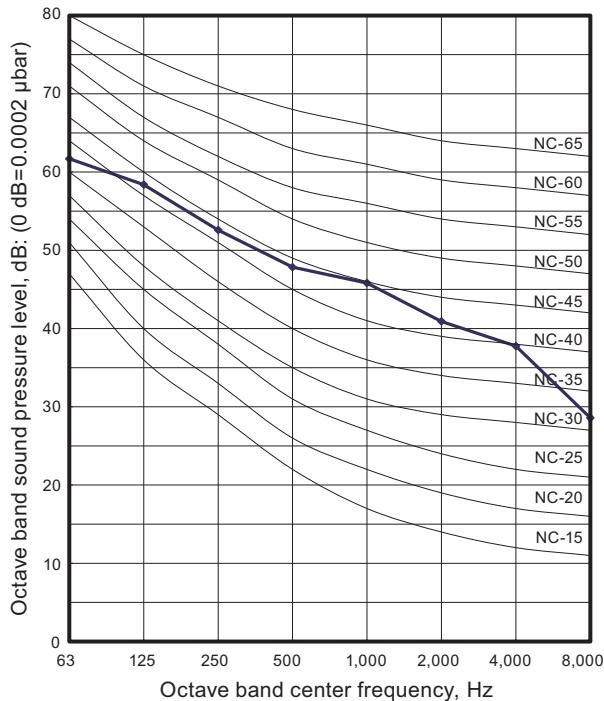


● Heating

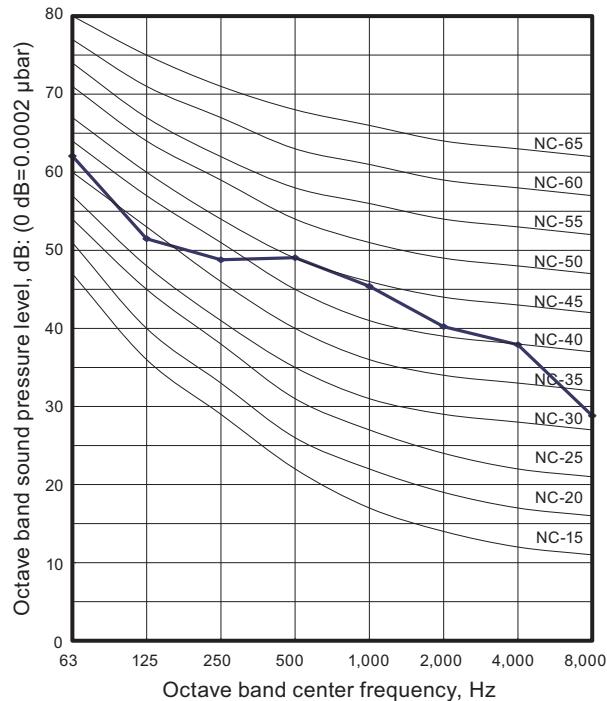


■ Model: AOYG24KBTB

● Cooling

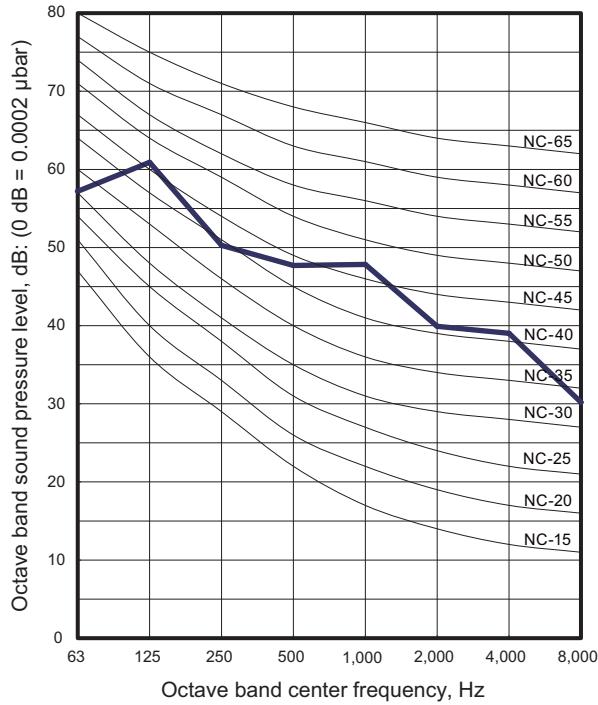


● Heating

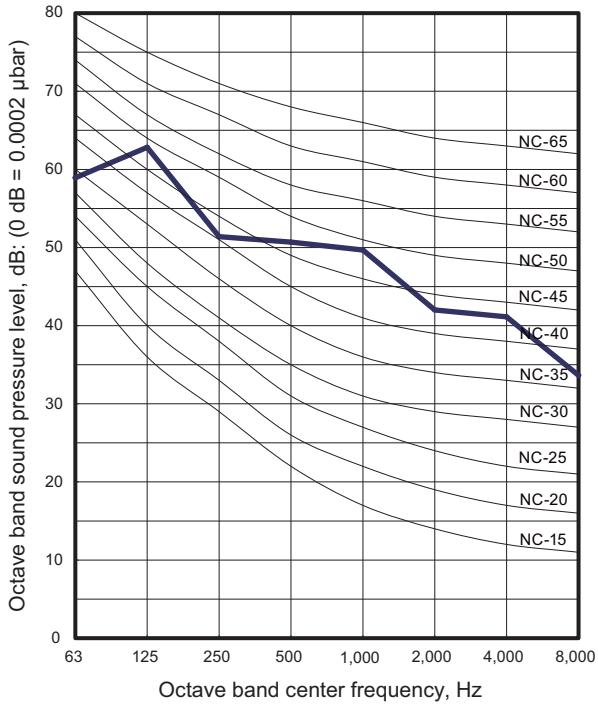
OUTDOOR UNIT
AOYG18-45KBTB

■ Model: AOYG30KBTB

● Cooling

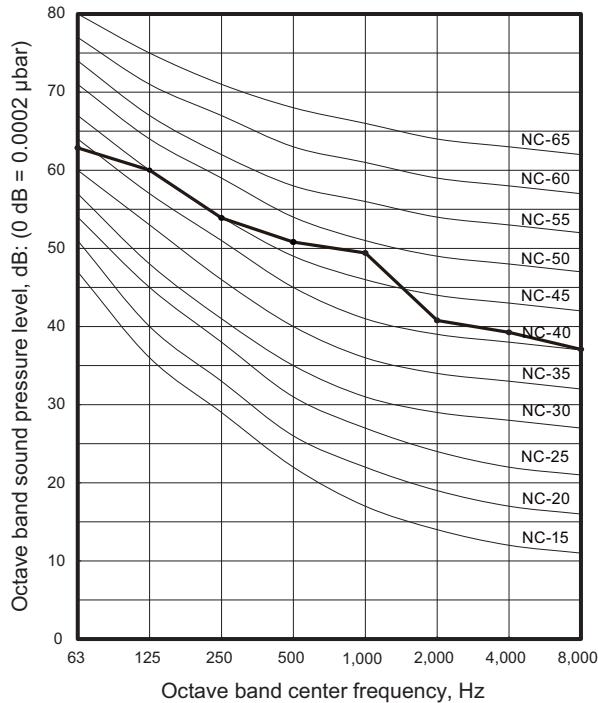


● Heating

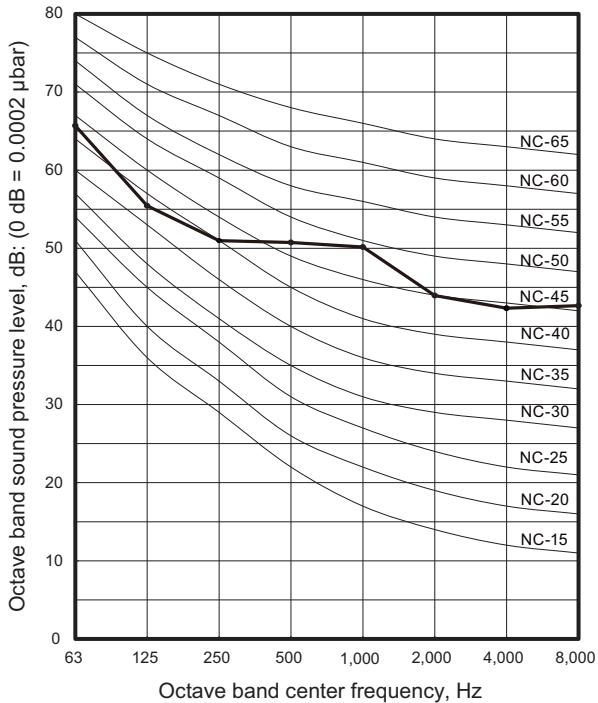
OUTDOOR UNIT
AOYG18-45KBTB

■ Model: AOYG36KBTB

● Cooling

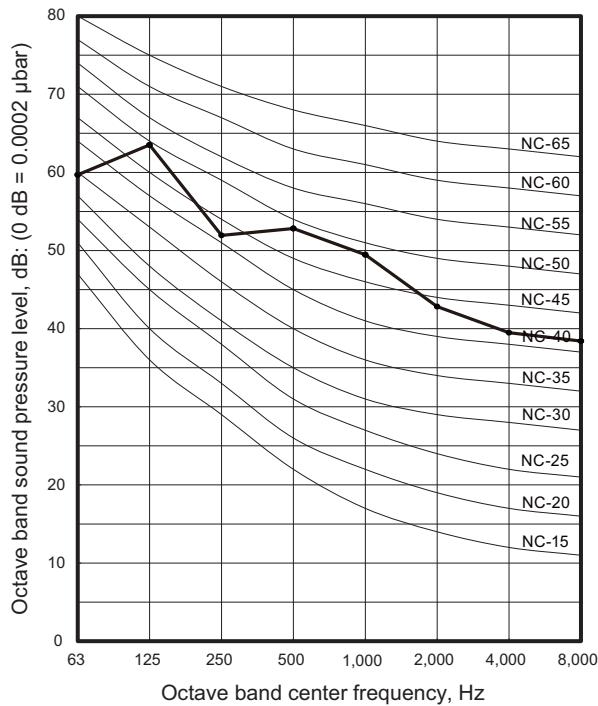


● Heating

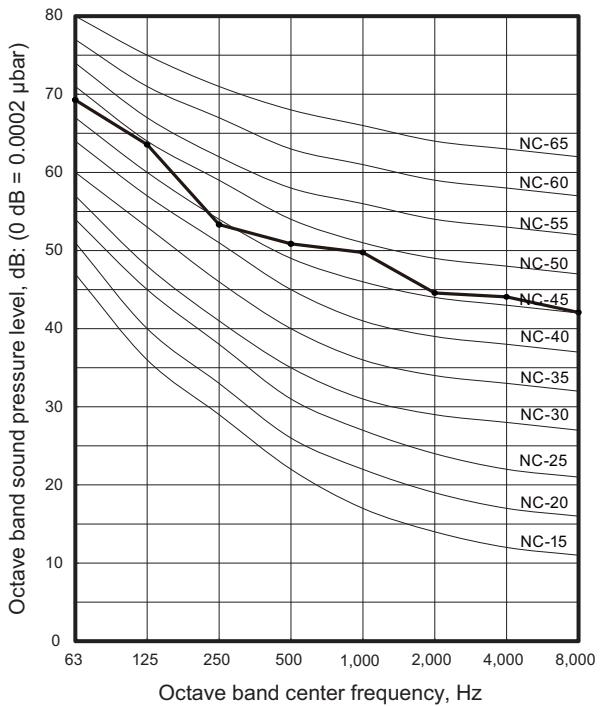


■ Model: AOYG45KBTB


● Cooling

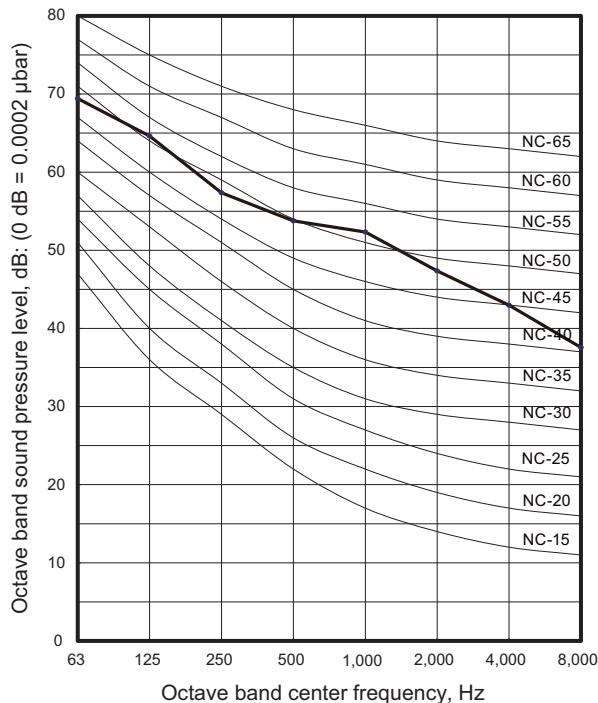

● Heating

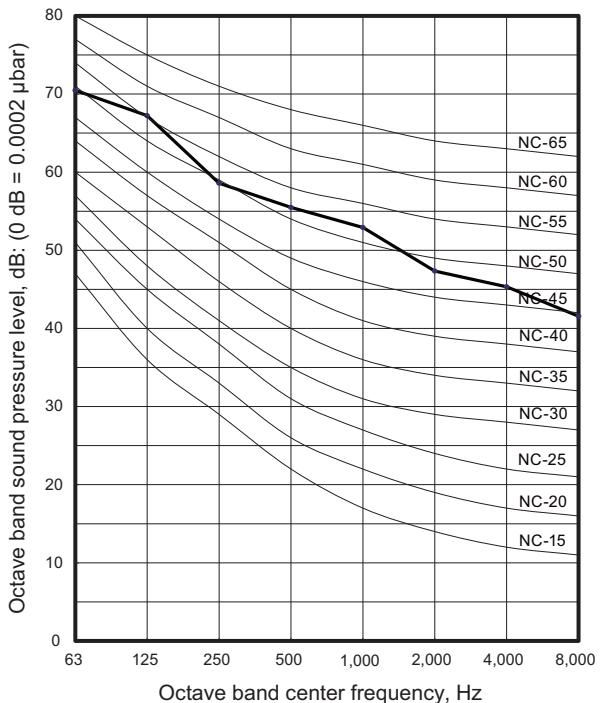

9-2. Sound level check point

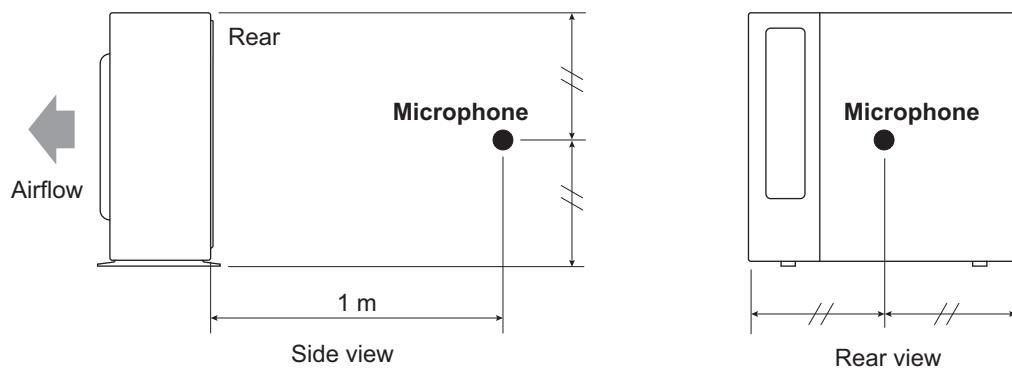

NOTE: Detailed shape of the actual outdoor unit might be slightly different from the one illustrated above.

10. Electrical characteristics

Model name			AOYG18KBTB	AOYG22KBTB
Power supply	Voltage	V	230 ~	
	Frequency	Hz	50	
Max operating current *1		A	12.1	12.6
Starting current		A	7.1	8.2
Wiring spec. *2	Circuit breaker current	A	16	
	Power cable	mm ²	1.5	
	Connection cable *3	mm ²	1.5	
	Limited wiring length	m	31	

Model name			AOYG24KBTB	AOYG30KBTB
Power supply	Voltage	V	230 ~	
	Frequency	Hz	50	
Max operating current *1		A	13.6	22.6
Starting current		A	8.4	11.1
Wiring spec. *2	Circuit breaker current	A	20	25
	Power cable	mm ²	2.5	4.0
	Connection cable *3	mm ²	1.5	
	Limited wiring length	m	31	51

Model name			AOYG36KBTB	AOYG45KBTB
Power supply	Voltage	V	230 ~	
	Frequency	Hz	50	
Max operating current *1		A	22.6	28.5
Starting current		A	13.0	18.6
Wiring spec. *2	Circuit breaker current	A	25	32
	Power cable	mm ²	4.0	
	Connection cable *3	mm ²	1.5	
	Limited wiring length	m	51	

*1: Maximum current is the total current of the indoor unit and the outdoor unit.

*2: Selected sample based on Japan Electrotechnical Standards and Codes Committee E0005. As the regulations of wire size and circuit breaker differ in each country or region, select appropriate devices complied to the regional standard.

*3: Limit voltage drop to less than 2%. Increase conductor size if voltage drop is 2% or more.

11. Safety devices

Type of protection	Protection form	Model	
		AOYG18KBTB	AOYG22KBTB
Circuit protection	Current fuse (Main PCB)	250 V, 25 A	
		250 V, 5 A	
		250 V, 3.15 A	
Fan motor protection	Terminal protection program	Activate	125±10 °C Fan motor stop
		Reset	120±10 °C Fan motor restart
Compressor protection	Terminal protection program (Discharge temp.)	Activate	110 °C Compressor stop
		Reset	After 7 minutes Compressor restart
	Terminal protection program (Compressor temp.)	Activate	— 108 °C Compressor stop
		Reset	— After 3 minutes, and 80 °C or less Compressor restart
High pressure protection	Pressure switch	Activate	— 4.2 ⁺⁰ _{-0.15} MPa Compressor stop
		Reset	— 3.2 ±0.15 MPa Compressor restart

Type of protection	Protection form	Model	
		AOYG24KBTB	AOYG30KBTB
Circuit protection	Current fuse (Main PCB)	250 V, 25 A	250 V, 30 A
		250 V, 5 A	250 V, 3.15 A
		250 V, 3.15 A	250 V, 10 A × 2
Fan motor protection	Thermal protection program	Activate	125 ±10 °C Fan motor stop
		Reset	120 ±10 °C Fan motor restart
Compressor protection	Thermal protection program (Discharge temp.)	Activate	110 °C Compressor stop
		Reset	After 7 minutes Compressor restart
	Thermal protection program (Compressor temp.)	Activate	108 °C Compressor stop
		Reset	80 °C or less Compressor restart
Thermal protection program (Outdoor temp.) (Only in COOL or DRY mode)		Activate	-20 °C Compressor stop
		Reset	-15 °C Compressor restart

Type of protection	Protection form	Model	
		AOYG36KBTB	AOYG45KBTB
Circuit protection	Current fuse (Main PCB)	250 V, 30 A 250 V, 3.15 A 250 V, 10 A × 2	
Fan motor protection	Thermal protection program	Activate	122 ±9 °C Fan motor stop
		Reset	107—126 °C Fan motor restart
Compressor protection	Thermal protection program (Discharge temp.)	Activate	110 °C Compressor stop
		Reset	After 7 minutes Compressor restart
	Thermal protection program (Compressor temp.)	Activate	108 °C Compressor stop
		Reset	80 °C or less Compressor restart
	Thermal protection program (Outdoor temp.) (Only in COOL or DRY mode)	Activate	-20 °C Compressor stop
		Reset	-15 °C Compressor restart

12. External input and output

With using external input and output functions, this product can be operated inter-connectedly with an external device.

Connector	Input	Output	Remarks
P580	Low noise mode	—	See external input/output settings for details.
PA580	Peak cut mode	—	
P590	—	Error status	
PA590	—	Compressor status	

12-1. External input

With using external input function, on/off status of "Low noise mode" and "Peak cut mode" can be specified by the external signal.


■ Low noise mode

In following condition, the operating noise of the outdoor unit reduces comparing from the one in normal operating condition:


The air conditioner is set to the "Low noise mode" when closing the contact input of a commercial timer or on/off switch to a connector on the control PCB of the outdoor unit.

NOTE: Product performance may drop depending on some conditions such as the outdoor temperature.

- **Circuit diagram example**

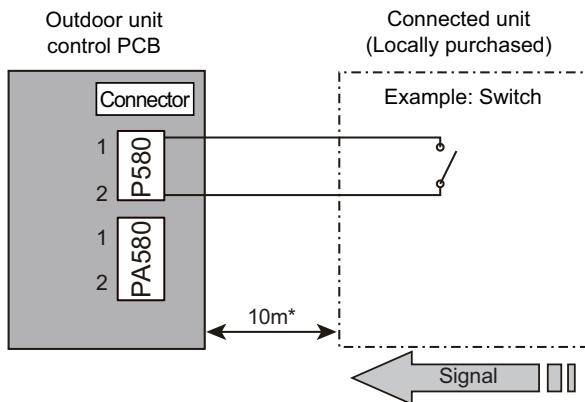

- Contact capacity: DC 24 V or more, 10 mA or more.
- *: Make the distance from the PCB to the connected unit within 10 m.
- Construct a circuit as shown in this figure with using optional parts mentioned below.
- Input signal: On in "Low noise mode"
- Input signal: Off in normal operation
- To set the level of "Low noise mode", refer to "["Low noise mode"](#)" on page 104.

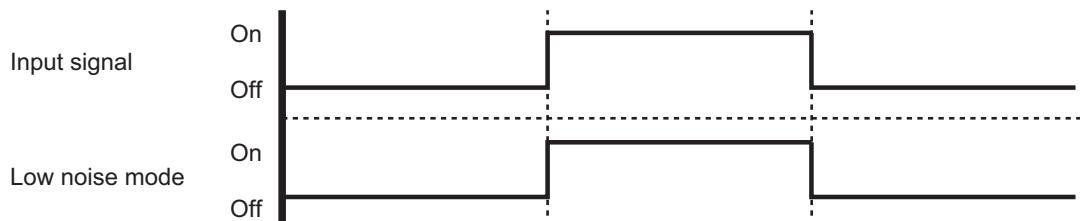


- **Optional part**

Part name	Model name	Exterior
External connect kit	UTY-XWZXZ3	External input wire


■ Peak cut mode

By performing following on-site work, operation that suppresses the current value can be enabled:
The air conditioner is set to the “Peak cut mode” when closing the contact input of a commercial timer or on/off switch to a connector on the control PCB of the outdoor unit.

- **Circuit diagram example**

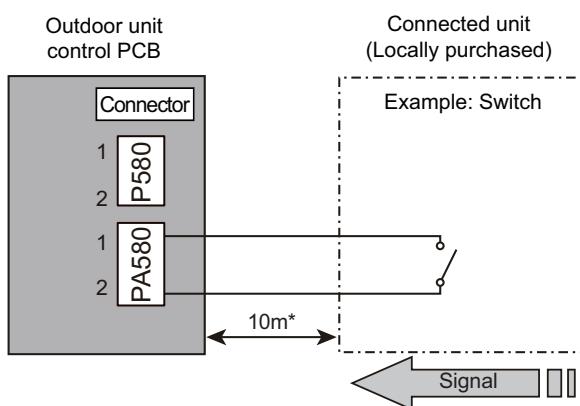

- Contact capacity: DC 24 V or more, 10 mA or more.
- *: Make the distance from the PCB to the connected unit within 10 m.
- Construct a circuit as shown in this figure with using optional parts mentioned below.
- Input signal: On in “Peak cut mode”
- Input signal: Off in normal operation
- To set the level of “Peak cut mode”, refer to “[Peak cut mode](#)” on page 105.

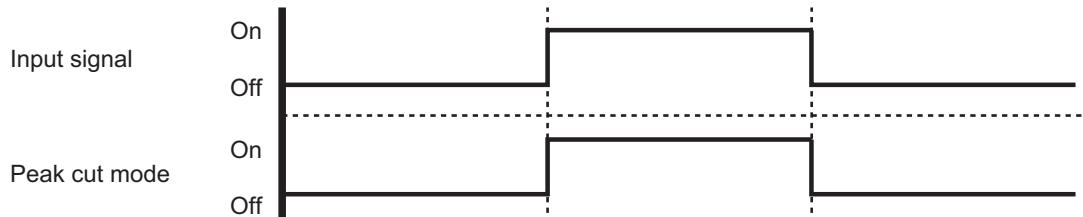

- **Optional part**

Part name	Model name	Exterior
External connect kit	UTY-XWZXZ3	External input wire


12-2. External output

With using external output function, some status signals are transmitted to the control PCB, and the related LED lamp indicates the status of this product.


■ Error status output

Signal on air conditioner error status is generated when a malfunction occurs.

- **Circuit diagram example**

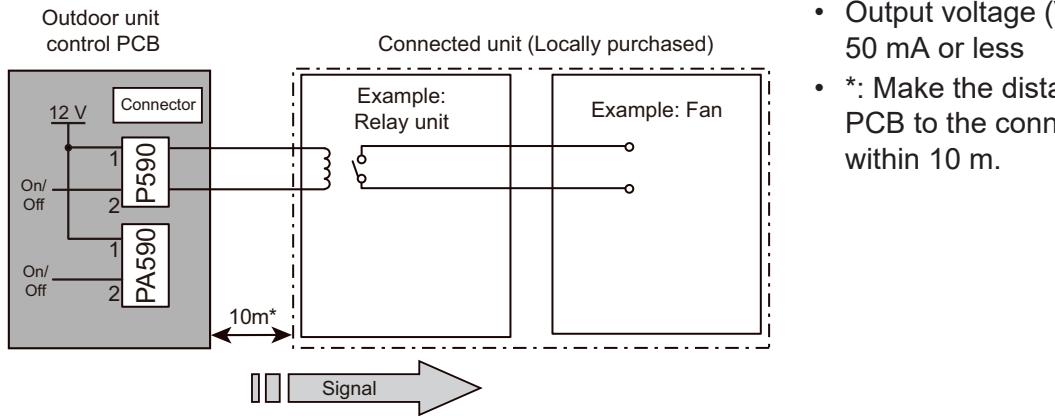

- Output voltage (Vcc): DC 12 V
50 mA or less
- *: Make the distance from the PCB to the connected unit within 10 m.

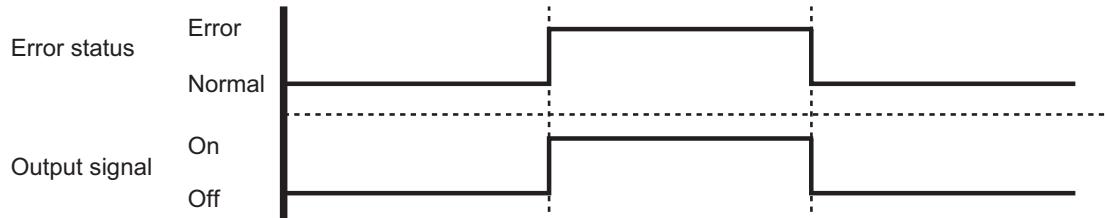


- **Optional part**

Part name	Model name	Exterior
External connect kit	UTY-XWZXZ3	External output wire


■ Compressor status output

Signal on compressor operation status is generated when the compressor is running.

- **Circuit diagram example**

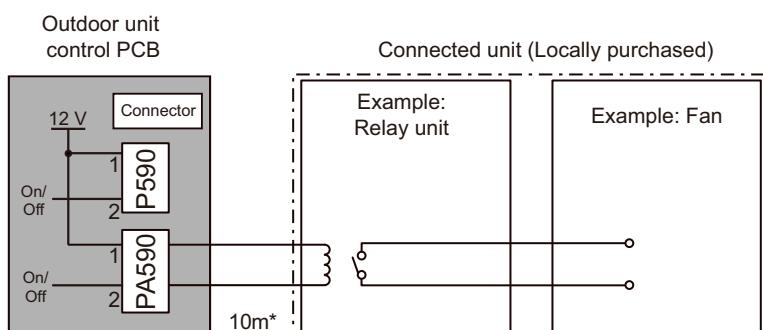

- Output voltage (Vcc): DC 12 V
50 mA or less
- *: Make the distance from the PCB to the connected unit within 10 m.

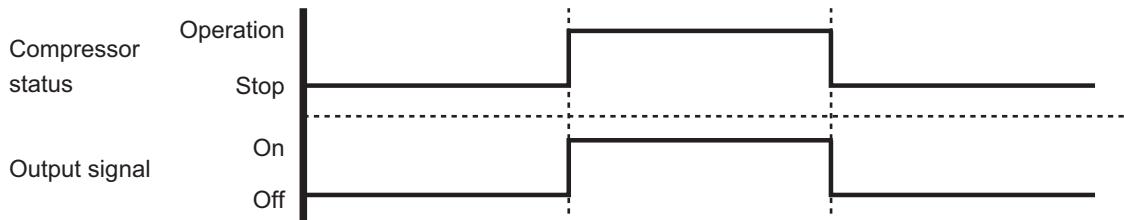

- **Optional part**

Part name	Model name	Exterior
External connect kit	UTY-XWZXZ3	External output wire

13. Function settings

Perform appropriate function setting locally according to the installation environment.


NOTE: Incorrect settings can cause a product malfunction.

⚠ CAUTION


- Before setting up the switch buttons, discharge the static electricity from your body.
- Never touch the terminals or the patterns on the parts that are mounted on the PCB.

13-1. Control PCB and switch buttons location

Control PCB of the outdoor unit is located as shown in the following figure.

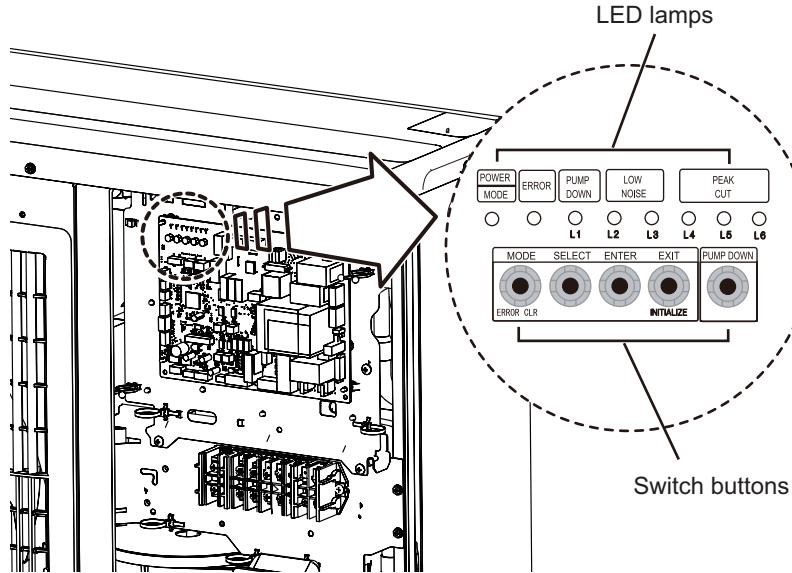

■ Switch buttons and the functions

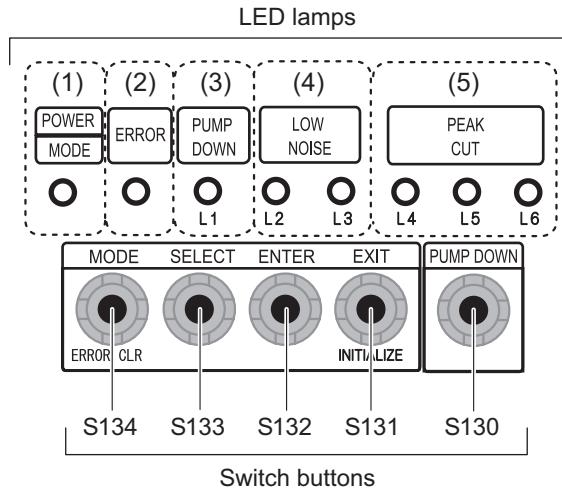

LED lamp			Function or operation method
(1)	POWER/MODE	Green	Lights on while power on. Local setting in outdoor unit or error code is displayed with blink.
(2)	ERROR	Red	Blinks during error operation.
(3)	PUMP DOWN (L1)	Orange	Lights on during pump down operation.
(4)	LOW NOISE MODE (L2 and L3)	Orange	Lights on during "Low noise mode" when local setting is activated. (Lighting pattern of L2 and L3 indicates low noise level.)
(5)	PEAK CUT MODE (L4, L5, and L6)	Orange	Lights on during "Peak cut mode" when local setting is activated. (Lighting pattern of L4, L5, and L6 indicates peak cut level.)

Switch button		Function or operation method
S134	MODE	Switches between "Local setting" and "Error code display".
S133	SELECT	Switches between the individual "Local settings" and the "Error code displays".
S132	ENTER	Switches between the individual "Local settings" and the "Error code displays".
S131	EXIT	Returns to "Operation status display".
S130	PUMP DOWN	Starts the pump down operation.

13-2. Local setting procedure

NOTE: Before performing the function setting, be sure to stop the operation of the air conditioner.


■ Low noise mode

1. Press the MODE switch button (S134) for 3 seconds or more to switch to “Local setting mode”.
2. After confirming the LED lamp of POWER/MODE blinks 9 times, press the ENTER switch button (S132).


POWER	ERROR	PUMP DOWN (L1)	LOW NOISE (L2)	LOW NOISE (L3)	PEAK CUT (L4)	PEAK CUT (L5)	PEAK CUT (L6)
MODE							
Blinks (9 times)	○	○	○	○	○	○	○

Sign “○”: Lights off

3. Press the SELECT switch button (S133), and adjust the LED lamp as shown below. Then the LED lamp indicates the current setting.

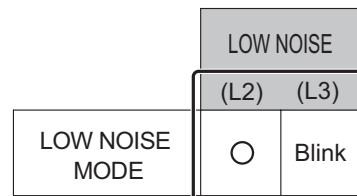

4. Press the ENTER switch button (S132).

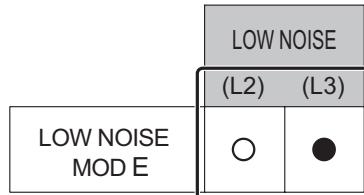


Sign “●”: Lights on

5. Press the SELECT switch button (S133), and adjust the LED lamps as shown below.



6. Press the ENTER switch button (S132) and fix it.

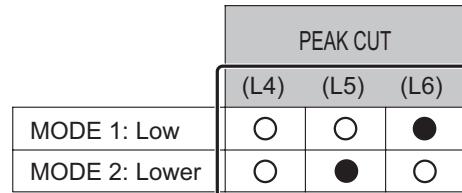

7. To return to “Operating status display (Normal operation)”, press the EXIT switch button (S131).

In case of missing how many times you pressed the SELECT and ENTER switch buttons:

1. To return to “Operation status display (Normal operation)”, press the EXIT switch button once.
2. Restart from the beginning of setting procedure.

NOTE: In case of missing how many times you pressed the SELECT and ENTER switch buttons, you must redo the setting procedure. Return to “Operation status display (Normal operation)” by pressing the EXIT switch button once, and restart from the beginning of the setting procedure.


■ Peak cut mode

1. Press the MODE switch button (S134) for 3 seconds or more to switch to “Local setting mode”.
2. After confirming the LED lamp of POWER/MODE blinks 9 times, press the ENTER switch button (S132).


POWER	ERROR	PUMP DOWN (L1)	LOW NOISE (L2) (L3)		PEAK CUT (L4) (L5) (L6)		
MODE							
Blinks (9 times)	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>	<input type="radio"/>

Sign “ ”: Lights off

3. Press the SELECT switch button (S133), and adjust the LED lamp as shown below. Then the LED lamp indicates the current setting.

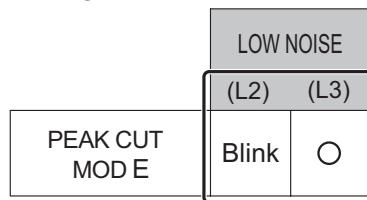

4. Press the ENTER switch button (S132).

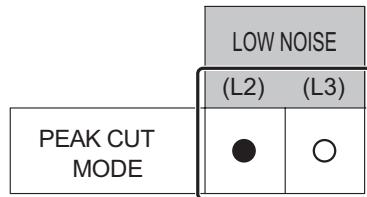

Sign “ ● ”: Lights on

5. Press the SELECT switch button (S133), and adjust the LED lamps as shown below.

PEAK CUT		
(L4)	(L5)	(L6)
<input type="radio"/>	<input type="radio"/>	Blink
<input type="radio"/>	Blink	<input type="radio"/>
<input type="radio"/>	Blink	Blink
Blink	<input type="radio"/>	<input type="radio"/>

6. Press the ENTER switch button (S132) and fix it.

PEAK CUT		
(L4)	(L5)	(L6)
<input type="radio"/>	<input type="radio"/>	●
<input type="radio"/>	●	<input type="radio"/>
<input type="radio"/>	●	●
●	<input type="radio"/>	<input type="radio"/>

7. To return to “Operating status display (Normal operation)”, press the EXIT switch button (S131).

NOTE: When pressed number is lost during setting, you must redo the setting procedure. Return to “Operation status display (Normal operation)” by pressing the EXIT switch button once, and restart from the beginning of the setting procedure.

14. Accessories


14-1. Models: AOYG18KBTB, AOYG22KBTB, and AOYG24KBTB

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Drain pipe		1

14-2. Models: AOYG30KBTB, AOYG36KBTB, and AOYG45KBTB

Part name	Exterior	Q'ty	Part name	Exterior	Q'ty
Installation manual		1	Drain cap		3
Drain pipe		1	One-touch bush		2

15. Optional parts

Exterior	Part name	Model name	Summary
	External connect kit	UTY-XWZXZ3	Use to operate the external input and output functions of outdoor unit.